

TECHNICAL CATALOGUE  
**FIRE-PROTECTION**

PASSIVE FIRE PROTECTION

**GLUE &  
SCREW SYSTEM**

# A FEW SITE REFERENCES


National Library of France Paris



High Court of Paris



The Provincial House Antwerp



Orly airport Paris



Torre Hadid Viale Milan



University Hospital Tanger Morocco



New hospital, Ajaccio Corsica



Hotel Ivoire Côte d'Ivoire



Oran airport, Algeria

**Also:** CDG airport, Roissy - Palais des Congrès - Stade de France - Necker hospital, Paris 15 - Lille Metro - Stade de Lille - Ritz hotel - Paris-Orly airport - Melun hospital - Trocadero Business Centre - Grand Louvre - Georges V hotel - Presidential palace, Congo - AIG Tour Majunga - Toulon military hospital.



**INTERACTIVE  
CONTENT**  
Click to access



# CONTENT

<b>INTRODUCTION</b>	<b>04</b>
Icons	06

## **PRODUCTS 13**

<b>1. FIRE PROTECTIVE BOARDS</b>	<b>14</b>
GEOTEC® S30 - S45 EI 60 (S) / EI 120 (S)	15
GEOTEC® SX30 - SX45 EI 60 (S) / EI 120 (S)	16
GEOFLAM® FX50 EI 180 (S)	17
<b>2. FIRE PROTECTIVE CHANNEL</b>	<b>18</b>
PREFAB C-LIGHT - EI 120 (S)18	18
<b>3. FIRE RESISTANT ACCESSORIES</b>	<b>19</b>
GEOTEC® A U-plaster element	19
GEOTEC® A Half shell	20
GEOTEC® A Reinforcement collar	21
GEOTEC® A Cover strip	22
GEOTEC® A Expansion joint element	23
GEOTEC® A Batten	24
<b>4. OTHER</b>	<b>25</b>
GEOFLAM® G ventilation grille	25
GEOCOL® Adhesive	26
Polyurethane foam	27
Mineral fiber rope	27

## **SMOKE EXTRACTION AND VENTILATION DUCTS 29**

<b>1. GEOTEC® SYSTEM GENERAL OVERVIEW</b>	<b>30</b>
<b>2. HORIZONTAL SYSTEM</b>	<b>31</b>
<b>3. VERTICAL SYSTEM</b>	<b>67</b>

## **FIRE PROTECTION FOR CARBON FIBER REINFORCEMENTS 81**

<b>1. SYSTEM GENERAL OVERVIEW</b>	<b>82</b>
<b>2. PROTECTION UNDER A CONCRETE FLOOR SLAB</b>	<b>83</b>
<b>3. PROTECTION UNDER A CONCRETE BEAM</b>	<b>84</b>

## **FIRE RATED INSPECTION HATCHES 85**

<b>1. VERTICAL</b>	<b>86</b>
<b>2. HORIZONTAL</b>	<b>92</b>





## WHO ARE WE ?

Since 1982, **GEOSTAFF** has been specialising in fire-protective products for passive fire protection, designed to meet the highest building industry standards.

The passive fire protection consists of integrating fire-stop systems into constructions, which will limit the spread of fire and smoke. Passive fire protection means:

Protection of individuals, allowing the occupants to evacuate the building in complete safety,

Protection of property, containing the fire for as long as possible while awaiting the emergency services.

As a pioneer in the field, the Geostaff team is constantly innovating in order to push safety standards to the highest level. Tested in certified laboratories, our systems excel in the most drastic tests in line with the latest European standards.

**As a European manufacturer of 100% natural GRG\* products, GEOSTAFF offers the following product ranges:**

**GEOTEC®** for the construction of ventilation and smoke extraction ducts, for the fire-protection of service ducts and shafts and the protection of epoxy bonded reinforcement systems on concrete slabs and beams. The GEOTEC® range allows you to build fire safe solutions up to 120 minutes.

**GEOFLAM®** for the construction of ventilation and smoke extraction ducts and the fire-protection of service ducts and shafts. The GEOFLAM® range allows you to build fire safe solutions up to 240 minutes.

**GEODECO®** decorative range manufactured for the decoration of hotel suspended ceilings, luxury homes and castles.

\*GRG: Glass Reinforced Gypsum (GRG) uses a combination of plaster and fiberglass. Glass Reinforced Gypsum is a more resistant plaster that allows the realization of our fire-protective elements and guarantees the excellent resistance and strength of our boards.




### INTERNATIONAL COMPANY

Head office in France  
Production plant in France  
Research centre in Belgium  
Logistic center in Paris & Nice  
Worldwide references



### KNOWLEDGE

35 years of experience  
CE Marking  
Declaration of Performance



### SOLUTIONS

Certified solutions  
EI 30/60 S, EI 90/120 S, EI 180 S, EI 240 S

**THIS DOCUMENTATION FOCALISES  
ON THE INNOVATIVE GEOTEC®  
SOLUTIONS.**

## **GEOTEC®**

**EI 30/60 S**

**EI 90/120 S**

**Glue & Screw assembly**

**Glue & Staple**

**Glue & Fiber reinforced  
gypsum**

Geostaff offers, through the GEOTEC® and GEOFLAM® ranges, various models and dimensions of fire protective boards for the construction of ventilation and smoke extraction ducts; the fire-protection of service ducts; the protection of carbon fiber bonded beams as well as for the protection of cable trays.

## **Fire protective board GEOTEC®S**

In order to meet all requirements for passive fire protection, Geostaff also produces pre-moulded fire-resistant elements for the protection of service ducts and shafts (for electrical cables, both combustible as non-combustible pipes and ducts : gas, medical fluids/gasses, air, combustibles...), for the protection of metal columns and fire-resistant inspection hatches.

Please download the GEOFLAM® documentation online or contact us at [com@geostaff.fr](mailto:com@geostaff.fr) for more informations on our solutions.

## **GEOFLAM®**

EI 90/120S


EI 180 S

EI 240 S

Glue & Fiber reinforced gypsum



**Prefab C-Light pre-moulded element**

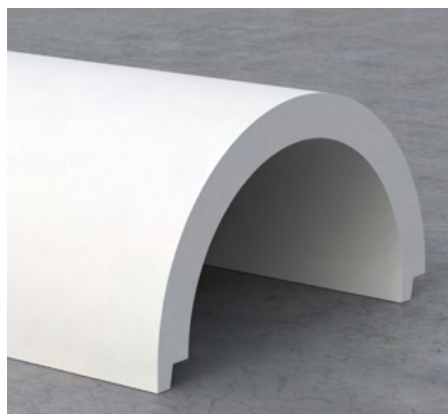

**GEOFLAM®DC pre-moulded element**



**Fire-resistant vertical inspection hatch**

## ICONS



### Reaction to fire

A1 classification in accordance with fire resistance classification standard **EN 13501-1**.



### European Conformity

Based on the European Assessment Document (**EAD**) n° **350142-00-1106** : "Fire-protective board, slab and mat products and kit".



### ETA 18/0343

GEOTEC®S : European Technical Assessment **18/0343**.



### ETA 15/0654

GEOFLAM®F : European Technical Assessment **15/0654**.



### ETA 15/0653

GEOTEC®F-Light : European Technical Assessment **15/0653**.



### Indoor air emission

Labelling of construction products  
Level of volatile pollutant emissions from the product **A+** : Very low emissions.



### Ventilation

Ventilation duct certificate according to the fire resistance test standard **EN 1366-1**.



### Smoke extraction

Smoke extraction duct certificate according to the fire resistance test standard **EN 1366-8**.



### Fire protection services

Service ducts and shafts certificate according to the fire resistance test standard **EN 1366-5**.



### Carbon protection reinforcement

Protection of epoxy bonded reinforcement systems on concrete slabs and beams.



### Fire-resistant inspection hatches

1 and 2 hours fire-protection



### Glue + Screw

[Duct internal dimension  $\leq 2500 \times 1500$  mm].



### Glue + Staple

[Duct internal dimension  $\leq 1250 \times 1000$  mm].



### Glue + Fiber reinforced gypsum

[Duct internal dimension  $\leq 2500 \times 2000$  mm].



### Geocol® Glue

Powder-coated adhesive especially formulated for mounting GEOFLAM® and GEOTEC® boards.



### Paint application

A water-based acrylic paint may be applied to GEOTEC®S products without compromising their fire-protection properties.



### Easy cutting

The product can be cut using a circular saw or a sabre saw.



### Easy cutting

The product can be cut using a handsaw.



### Water-repellent treatment

It is possible to apply a water-repellent treatment that does not alter the A1 classification by addition of water-repellent (option).



### Environmentally friendly products

100% natural gypsum-based products meeting environmental and health standards (FDS) and observing safety standards (FDES).



### Tailored dimensions

Tailored dimensions are delivered according to your project needs.



### Duct palletizing

Palletizing of the products by ducts is possible.



### Online calculation tool

Calculate your material requirements for the construction of all your GEOSTAFF systems online.



### Transportation

Product must be transported and stored on a flat and protected surface.



### Storage

Product must be kept away from water.



### GRG

Glass Reinforced Gypsum.



### Lightweight board

# PROTECTING YOU FROM FIRE IS WHAT WE DO

## How can we fulfil our mission and protect you in case of a fire?

Our first objective is to introduce fire-stop solutions inside all types of buildings (private, public, industrial, etc.) that will limit the spread of fire and smoke. These solutions are defined by the installation of horizontal and vertical smoke extraction and ventilation ducts, the protection of technical

ducts, the fire protection of various electrical cable trays, but also the installation of fire-resistant access hatches. All our products are designed with the aim of making these solutions possible and are tested and classified in accordance with all the existing European standards.

### Ventilation and smoke extraction ducts

The construction of a ventilation or smoke extraction system involves using a flow of air to flush the space to be cleared of smoke. This means clearing smoke on the one hand (smoke extraction duct or high-level ventilation) and bringing in fresh air on the other (ventilation duct or low-level ventilation).

Two cases are therefore possible:



Protecting the internal volume of a duct from fire, the common expression "external fire" using **ventilation ducts or introduction of air** (low-level ventilation).



In the rooms that it crosses, protecting the entire length of ducting from an "internal" fire, using **smoke extraction ducts** (high-level ventilation).

**Please refer to the chapter "SMOKE EXTRACTION AND VENTILATION DUCTS" from page 29.**

### Fire protection of service ducts and shafts



The service duct is defined as a usually accessible enclosed volume containing combustible or non-combustible service installations such as pipes or cables. The main purpose of the fire resistant protection of service ducts and shafts is to prevent fire from spreading from one room to another through these service installations or to protect these installations from fire and guarantee their functionality.

### Protection to epoxy bonded reinforcement systems on concrete slabs and beams



The fire stability of reinforced concrete structures and substrates is obtained by restricting the temperature rise in the steelwork within the concrete.

GEOSTAFF® proposes validated solutions using GEOTEC®S to protect the carbon fibre reinforcements installed under the floor slab and concrete beam, depending on the desired levels of fire performance and the critical temperatures provided by the manufacturer.

### Fire-resistant inspection hatches



GEOSTAFF fire-resistant inspection hatches can be installed both in our fire protective systems as standardized constructions to access inside the service ducts. They allow inspections and enable repairs.

# INTRODUCTION

## Fire classification and tests standards

Geostaff products are tested and classified in accordance with all European standards in force.

### Fire resistance classification standards

#### EN 13501-1

Fire classification of construction products and building elements - Part 1 : Classification using test data from reaction to fire tests.

#### EN 13501-3

Fire classification of products and construction elements - Part 3: Classification using fire resistance test data for the products and elements used in maintenance installations: fire-resistant ducts and fire dampers.

#### EN 13501-2

Fire classification of construction products and building elements - Part 2 : Classification using data from fire resistance tests, excluding ventilation services.

#### EN 13501-4

Fire classification of products and constructional elements - Part 4: Classification based on fire resistance test data for the components of smoke control systems.

### Fire resistance tests standards

#### EN 1366-1

Fire resistance tests for plant installations - Part 1: Ducts. To obtain a ventilation duct certificate, tests in accordance with EN 1366-1 (horizontal and/or vertical ducts type A and B, as defined in the standard) are required.

#### EN 1366-8






Fire resistance tests for service installations - Part 8: Smoke extraction ducts.

To obtain a certificate for a smoke extraction duct, tests in accordance with EN 1366-1 and 8 (horizontal and/or vertical ducts type A, B and C, as defined in the standard) are required.

#### EN 1366-5

Fire resistance tests for service installations - Part 5 : Service ducts and shafts.

**Declaration of performance in accordance with CE product standard EN 12101-7 for factory-made duct sections : contact Geostaff for the possibilities.**

SOLUTION		Fire-rated performance	Classification standards	Fire-resistant tests
	<b>Horizontal and vertical ventilation ducts</b>	EI 30/60 - 90 /120 - 180 - 240 (S)	EN 13501-3	EN 1366-1
	<b>Horizontal and vertical smoke extraction ducts</b>	EI 30/60 - 90/120 - 180 - 240 (S)	EN 13501-4	EN 1366-8
	<b>Service ducts and shafts</b>	EI 30/60 - 90/120 - 180 - 240	EN 13501-2	EN 1366-5
	<b>Fire-resistant inspection hatches</b>	EI 30/60 - 90/120	EN 13501-2	EN 1634-1
	<b>Protection of epoxy bonded reinforcement systems</b>	30 - 60 - 90 -120 -180 min	-	-





## CE Marking

To guarantee the performance of our fire protection systems, Geostaff decided, by means of a daily product inspection, to implement annual third party certification audits to obtain CE marking of fire-protective boards.

The different CE markings of our products have been made according to the European Assessment Document (EAD) n° 350142-00-1106 : "Fire-protective board, slab and mat products and kit". They were created within the framework of the European legislation and certify the conformity of our products with the declared performances.

The ETA numbers corresponding to Geostaff products are as follows:

**GEOFLAM®F : European Technical Assessment ETA n° 15/0654**

**GEOFLAM®F-Light : European Technical Assessment ETA n° 15/0653**

**GEOTEC®S : European Technical Assessment ETA n° 18/0343**

**For all Geostaff products with the CE marking, the Declarations of Performance for these products are available on the [www.geostaff.fr](http://www.geostaff.fr) website.**

## Classification criteria

<b>E:</b> Integrity (flames and hot gases)	<b>o --&gt; i:</b> Direction of the "external" fire
<b>I:</b> Thermal insulation (temperature on the unexposed side < 140°C on average or 180°C at a point)	<b>i --&gt; o:</b> Direction of the "internal" fire
<b>t:</b> Duration of the classification expressed in minutes	<b>i &lt;--&gt; o:</b> Arbitrary direction of the "internal" or "external" fire
<b>S:</b> Smoke leakage (leakage per unit surface area < 10 m <sup>3</sup> /hr.m <sup>2</sup> for ventilation, 5 m <sup>3</sup> /hr.m <sup>2</sup> for smoke extraction)	<b>Multi:</b> Indicates that the smoke extraction duct can extract smoke from several compartmentalised zones
<b>ve:</b> Vertical position of the duct being tested	<b>Service pressure:</b> Indicates the positive and negative pressures at which the duct was tested
<b>ho:</b> Horizontal position of the duct being tested	

## Example of classification

**EI 60 : HORIZONTAL & VERTICAL Fire rated ventilation duct with 30 mm GEOTEC®S fire-protective boards.**  
(Dimension up to 2500 x 1500 mm)

E	I	t	ve	ho	i	<-->	o	S
E	I	60	ve	ho	i	<-->	o	S

**EI 120 : HORIZONTAL & VERTICAL Fire rated multi-compartment smoke extraction duct with 45 mm GEOTEC®S fire-protective boards.** (Dimension up to 2500 x 1500 mm)

E	I	t	S	ve	ho	Service pressure	Multi
E	I	120	S	ve	ho	-1500 Pa / +1500 Pa 500Pa	Multi

**EI 120 : HORIZONTAL & VERTICAL Fire rated protection of service ducts and shafts with 45 mm GEOTEC®S fire-protective boards.** (Dimension up to 2500 x 1500 mm)

E	I	t	ve	ho	i	<-->	o
E	I	120	ve	ho	i	<-->	o

## Why choosing the Geostaff solution ?

By choosing Geostaff fire-protective products you can now have the solution that best fits your needs.

### CERTIFIED SOLUTION



The Geostaff boards are made in France with respect of the highest European quality standards in addition to CE\* certification under a **DOP\***.

Geostaff has tested the widest range of solutions with respect to large dimensions, complex shapes, extra standards pressure levels or wall penetrations. These solutions cover beyond the basic requirements for fire rated ventilation ducts (EN 1366-1), multi compartment smoke evacuation ducts (EN 1366-8) and the protection of services (EN 1366-5).

Geostaff products are meeting environmental and health standards ("Fiche de Déclaration Environnementale et Sanitaire": **FDES**) and are observing safety standards ("Fiche de Données de sécurité" : **FDS**).

**Please visit our website to find our products safety standards : [www.geostaff.fr](http://www.geostaff.fr)**

\*CE : European Conformity

\*DOP : Declaration Of Performance.

### ONE SHOP STOP SOLUTION



The online calculation tool enables you to calculate your material requirements for all the Geostaff solutions. Besides generating a full Bill of Material (BoM) that allows the Geostaff partners to have a perfect view and control on the material costs, a technical drawing is provided for the various duct section.

**Please visit our website and ask for your login to access our online calculation tool.**

Also, Geostaff has an extended stock to meet short delivery times.

### TAILORED AND FLEXIBLE SOLUTION



Geostaff uses Glass Reinforced Gypsum to mould the various board dimensions and accessories. The tailored boards allow a quick installation with a minimum of material waste.



Geostaff material is characterized by an easy manipulation. The boards can be cut both manually as mechanically. The plaster-based GEOCOL® glue is used on the joints both as glue and as a filler (maximally 1/3<sup>rd</sup> of the board thickness). It allows larger tolerances during installation hence minimizing material waste and maximizing installation speed.



The pre-molded accessories have a perfect fit and are easy to install.








Products are easily paintable and a water-repellent treatment is optional.

### EXPERTISE AT YOUR SERVICE

Our engineers and specialists are at your service to search for the best certified solution for your project. In combination with our logistical team, we can deliver specific duct sections on separate pallets to prosper installation time. Please contact us for more details.

## Our installation methods

<p>EI 30 - 60 S EI 90 - 120 S</p>		<p>Glue + screw</p>	<p><b>GEOTEC®</b></p>	<p>Duct internal dimension ≤ 2500 x 1500 mm</p>
<p>EI 30 - 60 S EI 90 S</p>		<p>Glue + staple</p>	<p><b>GEOTEC®</b></p>	<p>Duct internal dimension ≤ 1250 x 1000 mm</p>
<p>EI 30 - 60 S EI 90 - 120 S</p>		<p>Glue + fiber reinforced gypsum</p>	<p><b>GEOTEC®</b></p>	<p>Duct internal dimension ≤ 2500 x 2000 mm</p>
<p>EI 180 S</p>		<p>Glue + fiber reinforced gypsum</p>	<p><b>GEOFLAM® FX</b></p>	<p>Duct internal dimension ≤ 2500 x 2000 mm</p>
<p>EI 90 - 120 S</p>		<p>Glue + fiber reinforced gypsum</p>	<p><b>GEOFLAM® F Light</b></p>	<p>Duct internal dimension ≤ 1250 x 1000 mm</p>



## Additional technical data

### Airflow performance

**Hot sealing: Classification S in accordance with standards EN 1366-1 and 1366-8**

i.e. a leakage flowrate per unit surface area of  $<10 \text{ m}^3/\text{hr.m}^2$  for ventilation ducts and  $< 5 \text{ m}^3/\text{hr.m}^2$  for smoke extraction ducts.

**Cold sealing: Class D in accordance with standard EN 1507**

Class	$\text{m}^3.\text{s}^{-1}.\text{m}^{-2}$	$\text{m}^3.\text{h}^{-1}.\text{m}^{-2}$
A	$0.027 \times p^{0.65} \times 10^{-3}$	$0.0972 \times p^{0.65}$
B	$0.009 \times p^{0.65} \times 10^{-3}$	$0.0324 \times p^{0.65}$
C	$0.003 \times p^{0.65} \times 10^{-3}$	$0.0108 \times p^{0.65}$
<b>D</b>	<b><math>0.001 \times p^{0.65} \times 10^{-3}</math></b>	<b><math>0.0036 \times p^{0.65}</math></b>

### Pressure drop

The GEOTEC® system also addresses the basic principles of air conditioning techniques with a roughness factor for untreated internal walls similar to that of steel ducts, i.e.  $\epsilon = 0.05 \text{ mm}$  (for the smooth surface of the panel only).

### Acoustic performance

#### Acoustic attenuation with lining

With the aim of restricting airborne noise propagated by the ducts and hence providing better acoustic performance, Geostaff proposes solutions for attaching a lining to the GEOTEC® ducts; the characteristics are listed in the table below:

Thickness GEOTEC® S	$R_w(C; C_{tr}) \text{ dB}$		
	1 BA13 + LdV 45 mm	2 BA13 + LdV 45 mm	3 BA13 + LdV 85 mm
30	49 (-3;-9)	53 (-2;-7)	57 (-1;-4)
45	50 (-2;-7)	54 (-1;-6)	60 (-1;-4)

**$R_w + C$**  : Acoustic attenuation to indoor noise

**$R_w + C_{tr}$**  : Acoustic attenuation to outdoor noise

**BA13** : Standard plasterboard (13 mm thickness)

**LdV** : glass wool

**dB** : decibel

### Seismic performance

To guarantee that the GEOTEC® system works properly in seismically active zones or in buildings subject to significant vibration such as airports, stations or even underground car-parks, GEOTEC® ducts have been validated in accordance with the S2 set of spectra at 5% damping as per standard CRT 91 C 112 00. Carried out by the SOPEMEA laboratory (RE 1E31169ME), these calculations showed the excellent resistance to seismic activity and vibration of the GEOTEC® system.

### Performance under damp conditions

Where ventilation or smoke extraction ducts are constructed in rooms where the humidity is high, we propose that our products be treated with a water repellent. This treatment is applied to the bulk of the material, and does not alter the fire resistant properties of the products in any way.

**INTERACTIVE  
CONTENT**

Click to access



# PRODUCTS

## 1. FIRE PROTECTIVE BOARDS 14

GEOTEC® S30 - S45 EI 60 (S) / EI 120 (S) 15

GEOTEC® SX30 - SX45 EI 60 (S) / EI 120 (S) 16

GEOFLAM® FX50 EI 180 (S) 17

## 2. FIRE PROTECTIVE CHANNEL 18

PREFAB C-LIGHT - EI 120 (S) 18

## 3. FIRE RESISTANT ACCESSORIES 19

GEOTEC® A U-plaster element 19

GEOTEC® A Half shell 20

GEOTEC® A Reinforcement collar 21

GEOTEC® A Cover strip 22

GEOTEC® A Expansion joint element 23

GEOTEC® A Batten 24

## 4. OTHER 25

GEOFLAM® G Ventilation grille 25

GEOCOL® Adhesive 26

Polyurethane foam 27

Mineral fiber rope 27



## GEOTEC®S FIRE-PROTECTIVE BOARD



**GEOTEC® S30**



**GEOTEC® SX45**



### Strength and resistance

GEOTEC®S boards are made of **GRG**.

GRG or Glass Reinforced Gypsum is a more resistant plaster that allows the realization of our fire-protective elements and guarantees the excellent resistance and strength of our boards.



### Lightweight board that is easy to handle

Duct with a fire resistance of 60 minutes (EI 60 S) : GEOTEC®S 30mm: 22.5 kg/m<sup>2</sup>.

Duct with a fire resistance of 120 minutes (EI 120 S) : GEOTEC®S 45mm : 34 kg/m<sup>2</sup>.



### A board that fits all types of ducts

The **GEOTEC® S board** is available in sizes from 200 x 1000 mm up to 1100 x 1000 mm with 50 mm intervals. For instance, for a duct of 300 x 500 mm EI 120 S in 45 mm, you will need 900 and 550 mm GEOTEC® S 45 boards.

The **GEOTEC® SX** standard dimensions board is available only in 1200 x 1000 mm.

Please consult our online calculation tool to calculate your bill of materials available for all your projects.



### Reaction to fire

A1 according to the fire classification standard **EN 13501-1**.



### Tested and classified in accordance with all European standards in Force

**CE** marked fire-protective board according to EAD n° 350142-00-1106 and Declaration of Performance available (DOP).

European Technical Assessment **ETA n° 18/0343**.



### Respect for environmental and safety standards


Meeting environmental and health standards (declaration form : FDES) and observing safety standards (FDS).

Compliance with the A+ criteria concerning the respect of indoor air quality for GEOTEC® products.


# GEOTEC® S30 - S45



## GEOTEC®S30



## GEOTEC®S45

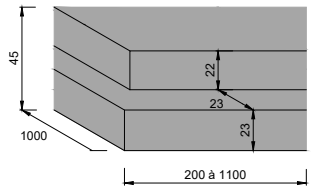

### Dimensions

Thickness (mm)	EI (S)	Board dimensions* (L x w) (mm)	Dry weight (kg/m²)	Rabbeted sides
30	30 - 60	200 to 1100 x 1000	22.5	2
45	90 - 120		34	4

E = Integrity / I = Thermal insulation  
\*In steps of 50 mm

### Characteristics

Nominal density (± 15%)	± 750 kg/m³
Bending strength	≥ 1.3 MPa
Compressive strength	≥ 3 MPa
pH value	approximately 8.5
Thermal conductivity coeff (λ at 20°C)	0.106 W/m.K
Resistance to water vapour diffusion (μ)	± 3
Roughness factor (ε)	0.05 mm
Cold sealing class	D
Acoustic attenuation Rw (C; Ctr)	29 (-2; -2) dB for thickness 30 mm
	31 (-1; -2) dB for thickness 45 mm
Dimensional tolerance	± 5 mm
Thickness tolerance	± 2 mm
Colour	White
Appearance	Smooth
Machinability	Excellent

\* The data in this table are average values, given for information only. If certain properties are essential for some particular application, we should preferably be consulted.

### APPLICATIONS



Ventilation



Fire protection services



Smoke extraction



Carbon protection reinforcement

### CERTIFICATIONS



ETA 18/0343



A1 - EN 13501-1



Indoor air emission

### INSTALLATIONS



Glue + Screw  
[≤ 2500 x 1500 mm ]



Glue + Staple  
[≤ 1250 x 1000 mm ]



Glue + Fiber reinforced gypsum  
[≤ 2500 x 2000 mm ]

### ADVANTAGES



Paint application  
Water-based acrylic paint



Duct palettizing



Easy cutting



Tailored dimensions



Easy cutting



Environmentally friendly products




Water-repellent treatment (option)


GEOTEC® SX30 - SX45



GEOTEC®SX30



GEOTEC®SX45



Dimensions

Thickness (mm)	EI (S)	Board dimensions (L x w) (mm)	Dry weight (kg/m <sup>2</sup> )	Rabbeted sides
30	30 - 60	1200 x 1000	22.5	2
45	90 - 120		34	

E = Integrity / I = Thermal insulation

Characteristics

Nominal density (± 15%)	± 750 kg/m <sup>3</sup>
Bending strength	≥ 1.3 MPa
Compressive strength	≥ 3 MPa
pH value	approximately 8.5
Thermal conductivity coeff (λ at 20°C)	0.106 W/m.K
Resistance to water vapour diffusion (μ)	± 3
Roughness factor (ε)	0.05 mm
Cold sealing class	D
Acoustic attenuation Rw (C; Ctr)	29 (-2; -2) dB for thickness 30 mm
	31 (-1; -2) dB for thickness 45 mm
Dimensional tolerance	± 5 mm
Thickness tolerance	± 2 mm
Colour	White
Appearance	Smooth
Machinability	Excellent

\* The data in this table are average values, given for information only. If certain properties are essential for some particular application, we should preferably be consulted.

APPLICATIONS



Ventilation



Fire protection services



Smoke extraction



Carbon protection reinforcement

CERTIFICATIONS



ETA 18/0343



A1 - EN 13501-1



Indoor air emission

INSTALLATIONS



Glue + Screw [≤ 2500 x 1500 mm]



Glue + Staple [≤ 1250 x 1000 mm]



Glue + Fiber reinforced gypsum [≤ 2500 x 2000 mm]

ADVANTAGES



Paint application Water-based acrylic paint



Duct palettizing



Easy cutting



Environmentally friendly product



Easy cutting




Water-repellent treatment (option)



# GEOFLAM® FX50



## GEOFLAM® FX50



### Dimensions

Thickness (mm)	EI (S)	Board dimensions (L x w) (mm)	Dry weight (kg/m <sup>2</sup> )	Rabbeted sides
50	180	1000 x 900	50	2

E = Integrity / I = Thermal insulation

### Characteristics

Nominal density (± 15%)	± 1100 kg/m <sup>3</sup>
Bending strength	≥ 1,8 MPa
Compressive strength	≥ 5 MPa
pH value	± 8,9
Thermal conductivity coeff (λ à 20°C)	0,60 W/m.K
Resistance to water vapour diffusion (μ)	± 3.8
Roughness factor (ε)	0,05 mm
Dimensional tolerance	± 5 mm
Thickness tolerance	± 2 mm
Colour	White
Appearance	Smooth
Machinability	Excellent

\* The data in this table are average values, given for information only. If certain properties are essential for some particular application, we should preferably be consulted.

### APPLICATIONS



Ventilation



Fire protection services



Smoke extraction

### CERTIFICATIONS



ETA 15/0654



A1 - EN 13501-1



Indoor air emission

### INSTALLATIONS



Glue + Fiber reinforced gypsum [≤ 2500 x 2000 mm]

### ADVANTAGES



Paint application  
Water-based acrylic paint



Duct palettizing



Easy cutting



Environmentally friendly product



Easy cutting



Water-repellent treatment (option)

## PREFAB C-light



Made primarily of plaster and glass fibre, these 35 mm thick elements are pre-moulded with longitudinal rabbeted sides and ends that allow them to be interlocked.

Dimensions				
Thickness (mm)	EI (S)	Length (m)	Internal dimensions (L x w) (mm)	Dry weight* (kg/ml)
35	120	1	50 x 50	16
			100 x 50	20
			100 x 100	24
			150 x 100	28
			150 x 150	32.50
			200 x 100	11
			200 x 200	40,50
			300 x 100	41
			350 x 200	53

E = Integrity / I = Thermal insulation  
\*Channel & Cover

Characteristics	
Nominal density (± 15%)	± 1100 kg/m <sup>3</sup>
Bending strength	≥ 1.8 MPa
Compressive strength	≥ 5 MPa
pH value	Approximately 8.9
Dimensional tolerance	± 5 mm
Thickness tolerance	± 2 mm
Colour	White
Appearance	Smooth
Machinability	Excellent

\* The data in this table are average values, given for information only. If certain properties are essential for some particular application, we should preferably be consulted.

### APPLICATIONS



Fire protection services

### CERTIFICATIONS



A1 - EN 13501-1



Indoor air emission

### INSTALLATIONS



Geocol® Glue

### ADVANTAGES



Paint application  
Water-based acrylic paint



Duct palettizing



Easy cutting



Environmentally friendly product




Easy cutting



Water-repellent treatment (option)

## GEOTEC® A U-plaster element

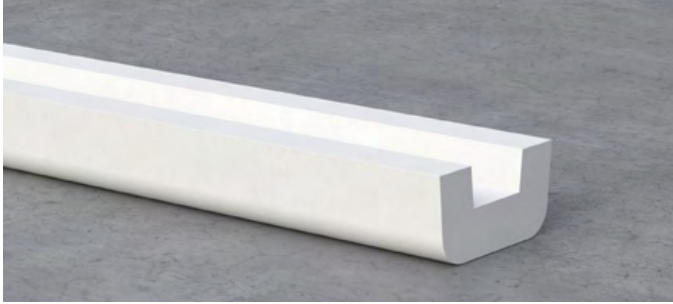

Consisting mainly of plaster and glass fibre, these pre-moulded elements are intended to protect the metal supports of horizontal GEOTEC® and GEOFLAM®A ducts, EI 30 to 180 (30 min to 3 hr fire-break).

### APPLICATIONS



Ventilation



Fire protection services



Smoke extraction

### CERTIFICATIONS



A1 - EN 13501-1



Indoor air emission

### ADVANTAGES



Paint application  
Water-based acrylic paint



Water-repellent treatment (option)



Easy cutting



Environmentally friendly product




Easy cutting

Dimensions		
EI (min)	Length (m)	Dimensions (h x L) (mm)
30 to 120	1	55 x 110*
30 to 120		60 x 100
180		70 x 100
30 to 180		85 x 120


E = Integrity / I = Thermal insulation  
\*Only for GEOTEC® ducts

#### For Steel U-section 41 x 21 30 to 120 minutes fire-resistant

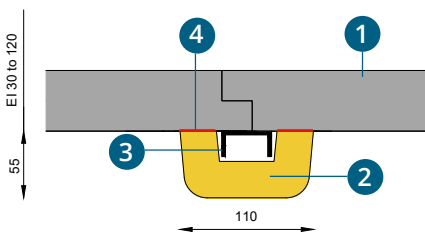


- 1 GEOTEC® board
- 2 GEOTEC® A U-plaster element
- 3 Steel U-profile 41 x 21
- 4 GEOL® Glue

#### For Steel U-section 41 x 41 30 to 180 minutes fire-resistant

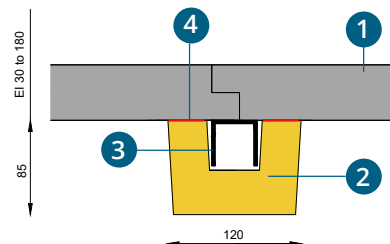


- 1 GEOTEC® or GEOFLAM® board
- 2 GEOTEC® A U-plaster element
- 3 Steel U-profile 41 x 41
- 4 GEOL® Glue

#### For Steel U-section 25 x 25 30 to 180 minutes fire-resistant

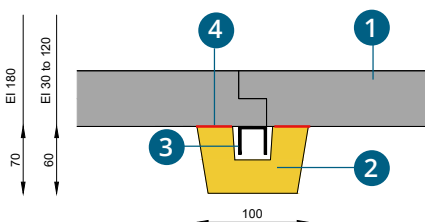

- 1 GEOFLAM® board
- 2 GEOTEC® A U-plaster element
- 3 Steel U-profile 25 x 25
- 4 GEOL® Glue

## GEOTEC® A Half shell

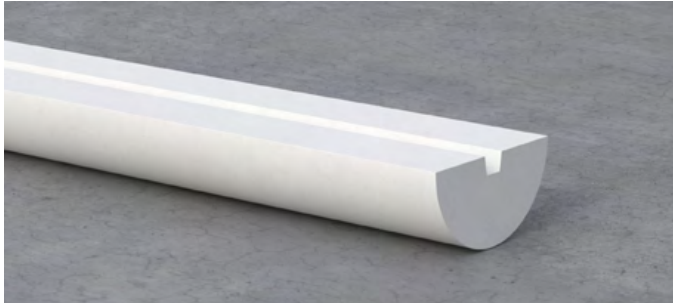

Pre-moulded elements made primarily of plaster and glass fibre, designed to protect the metal supports of horizontal GEOTEC® and GEOFLAM® ducts, EI 30 to 180 (30 min to 3 hr firestop).

Dimensions		
EI (min)	Length (m)	Dimensions (h x L) (mm)
30 to 120	1	90
180		110

E = Integrity / I = Thermal insulation

### APPLICATIONS



Ventilation



Fire protection services



Smoke extraction

### CERTIFICATIONS



A1 - EN 13501-1



Indoor air emission

### ADVANTAGES



Paint application  
Water-based acrylic paint



Water-repellent treatment (option)



Easy cutting




Environmentally friendly product




Easy cutting

### EI 30 - 60 (S) / EI 90 - 120 (S) 30 min to 2 hrs fire-resistant

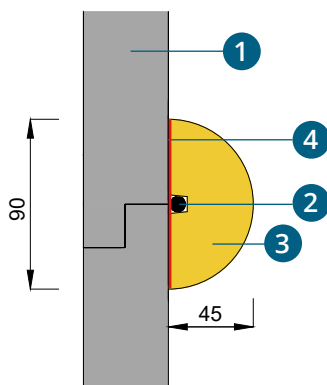

- 1 GEOTEC® or GEOFLAM® board
- 2 Threaded rod Ø 8 or Ø 10
- 3 GEOTEC® A 1/2 shell
- 4 GEOTEC® A 1/2 shell
- 4 GEOTEC® A 1/2 shell
- 4 GEOTEC® A 1/2 shell

### EI 180 (S): 3 hrs fire-resistant

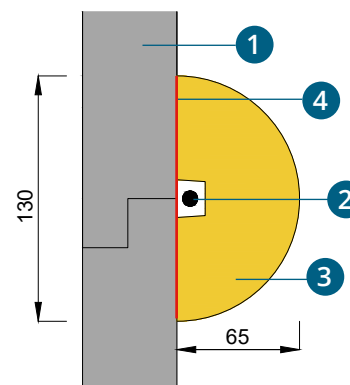

- 1 GEOFLAM® board
- 2 Threaded rod Ø 8 or Ø 10
- 3 GEOTEC® A 1/2 shell
- 4 GEOTEC® A 1/2 shell

## GEOTEC® A Reinforcement collar



Made primarily of plaster and glass fibre, GEOTEC®A / GEOFLAM®A reinforcement collars are used to support vertical ducts and service ducts. They can equally be applied as internal reinforcement for horizontal ducts if necessary.

### APPLICATIONS



Ventilation



Fire protection services



Smoke extraction

### CERTIFICATIONS



A1 - EN 13501-1



Indoor air emission

### ADVANTAGES



Paint application  
Water-based acrylic paint



Water-repellent treatment (option)



Easy cutting



Environmentally friendly product




Easy cutting

Dimensions				
Duct thickness (mm)	Thickness of reinforcement collars (mm)	EI (mm)	Length (m)	Height (mm)
	30	30 - 60	1	200
	45	90 - 120		

*E = Integrity / I = Thermal insulation*


### EI 30 - 60 (S) / EI 90 - 120 (S) 30 min to 2 hrs fire-resistant

Reinforcement collar used as internal reinforcement for horizontal ducts

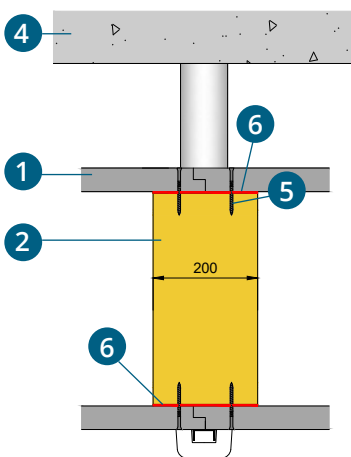


- 1 GEOTEC® duct
- 2 GEOTEC® A Reinforcement collar
- 3 Sealing using stone wool, polyurethane foam or a mixture of sisal fiber and plaster
- 4 Concrete slab
- 5 VBA screws Ø 5
- 6 GEOCOL® Glue


Reinforcement collar used as internal reinforcement for large vertical ducts

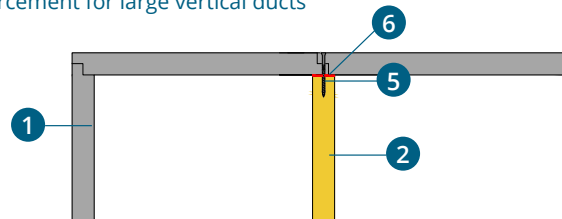

Reinforcement collar used to support vertical ducts

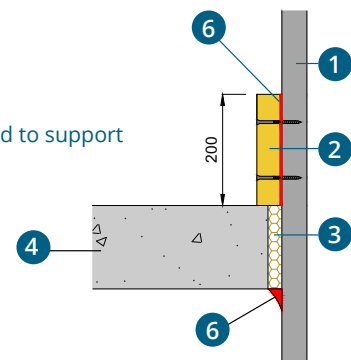

## GEOTEC® A Cover strip

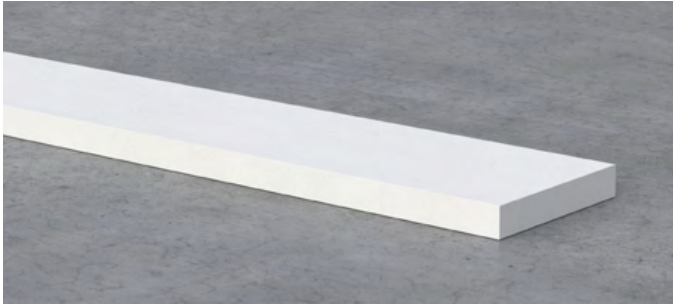

Made mainly of plaster and glass fibre, GEOTEC®A cover strips are designed to reinforce the upper boards of horizontal ducts and service ducts if necessary. They can equally be applied to reinforce large vertical duct.

### Dimensions

Thickness (mm)	EI (mm)	Length (m)	Width (mm)
20	30 to 120	1	120

*E = Integrity / I = Thermal insulation*

### APPLICATIONS



Ventilation



Fire protection services



Smoke extraction

### CERTIFICATIONS



A1 - EN 13501-1



Indoor air emission

### ADVANTAGES



Paint application  
Water-based acrylic paint



Water-repellent treatment (option)



Easy cutting




Environmentally friendly product



Easy cutting


### EI 30 - 60 (S) / EI 90 - 120 (S) 30 min to 2 hrs fire-resistant

Cover strip used to reinforce the upper board of horizontal ducts

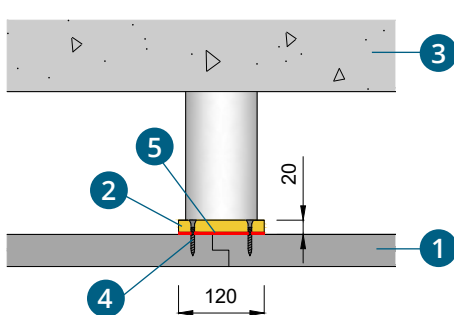

- 1 GEOTEC® duct
- 2 GEOTEC® A Cover strip
- 3 Concrete slab
- 4 VBA screws Ø 5
- 5 GEOCOL® Glue

Cover strip used to reinforce large vertical ducts

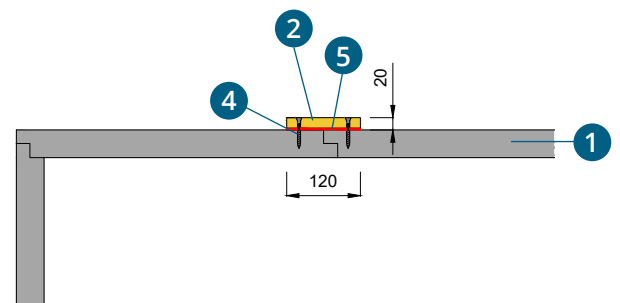

## GEOTEC® A Expansion joint element



Plaster and glass fibre pre-moulded element 1.5 m long, bonded around the perimeter of the ducts serving as a presser for inserting of foam and intumescent joints; this is intended to take up the various displacements of the structure as it moves.

### APPLICATIONS



Ventilation



Smoke extraction



Fire protection services

### CERTIFICATIONS



A1 - EN 13501-1



Indoor air emission

### ADVANTAGES



Paint application  
Water-based acrylic paint



Water-repellent treatment (option)



Easy cutting



Environmentally friendly product



Easy cutting


### Dimensions

Thickness (mm)	EI (mm)	Length (m)	Width (mm)
60	30 to 120	1,5	200

*E = Integrity / I = Thermal insulation*


### EI 30 - 60 (S) / EI 90 - 120 (S) 30 min to 2 hrs fire-resistant

Application in a horizontal duct

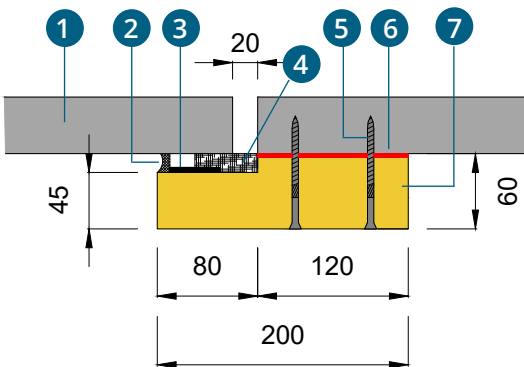


- 1 GEOTEC® board
- 2 Fire-resistant silicone
- 3 Intumescent joint
- 4 Foam joint
- 5 VBA Screw  
Ø 5
- 6 GEOCOL® Glue
- 7 GEOTEC® A Expansion joint element
- 8 Mineral fiber rope  
Ø 40 mm

Application in a vertical duct

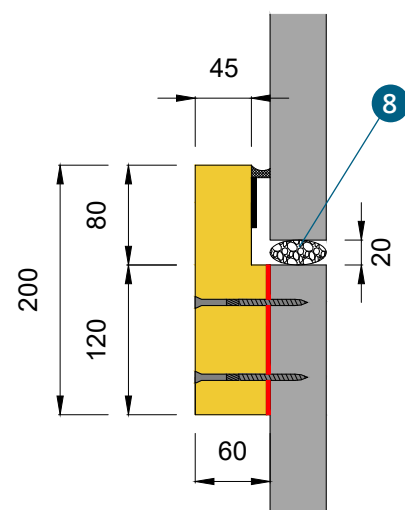

## GEOTEC® A Batten

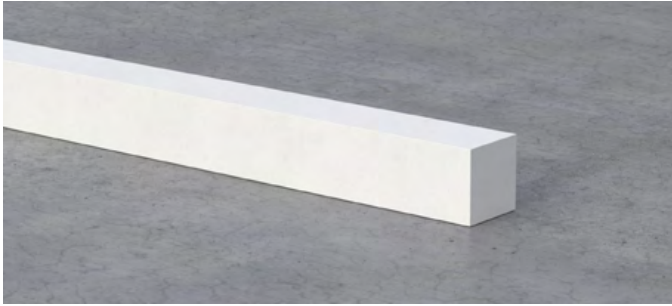

Made primarily of plaster and glass fibre, **GEOTEC®A** battens are used to make it easier to screw the boards together when the ducts or shrouds are juxtaposed with the wall or the slab.

Dimensions			
Thickness (mm)	EI (mm)	Length (m)	Width (mm)
45	30 to 120	1	45

*E = Integrity / I = Thermal insulation*

### APPLICATIONS



Ventilation



Fire protection services



Smoke extraction

### CERTIFICATIONS



A1 - EN 13501-1



Indoor air emission

### ADVANTAGES



Paint application  
Water-based acrylic paint



Water-repellent treatment (option)



Easy cutting




Environmentally friendly product



Easy cutting


### EI 30 - 60 (S) / EI 90 - 120 (S) 30 min to 2 hrs fire-resistant

Battens used in a horizontal duct when juxtaposed to the slab

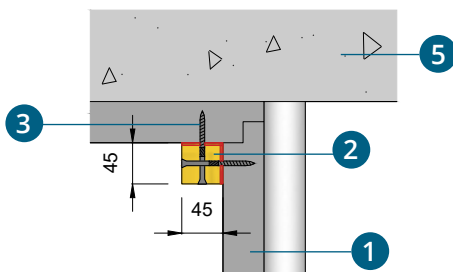

- 1 GEOTEC® duct
- 2 GEOTEC® A Batten
- 3 VBA screws Ø 5
- 5 Concrete slab
- 6 Concrete wall

Battens used in a vertical duct when juxtaposed to the wall

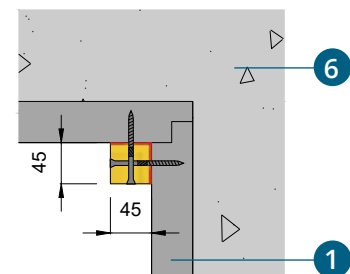



## GEOTEC® A Ventilation grille



### Dimensions

Thickness (mm)	EI (mm)	Length (m)	Width (mm)
50	120	95 x 95	0,3

*E = Fire sealing / I = Thermal insulation*

*\* In accordance with extension EFR-14-003037 of docs. 12-A-698 Rev.1 and EFR-14-A-001050 Rev.1*

### Characteristics

<b>Description</b>	Fire-protection ventilation grille
<b>Operation</b>	The slats begin to react over 100°C
<b>Operating pressure</b>	-5 to +10 Pa
<b>Safety position</b>	Horizontal slats
<b>Direction of air circulation</b>	Any
<b>Fire-side</b>	Any
<b>Temperature of usage</b>	Max. 60 °C
<b>Environment</b>	For internal use
<b>Maintenance</b>	Maintenance free
<b>Acidity</b>	pH 8.91

### PRODUCT DESCRIPTION

Square **GEOFLAM®G** fire-protection ventilation grilles can be installed in the **GEOFLAM®** protective systems for horizontal and vertical service conduits, to avoid heating of electrical cables for example when protecting a cable tray. These grilles are made of plastic profiles filled with bands of intumescent material. These provide fire resistance up to EI 120.

### ADVANTAGES

- Approved for installation on **GEOFLAM®** protective ducts
- Maintenance free
- Easy to install

### STORAGE AND HANDLING

For safety's sake, these grilles should be stored and handled with care.

### CAUTION:

- AVOID ANY DAMAGE
- AVOID CONTACT WITH WATER
- KEEP AWAY FROM HEAT

### MAINTENANCE AND CLEANING

Clean with a soft dry cloth.  
Do not use abrasive sponges, alkaline or acid detergents, or volatile solvents such as alcohol or other solvent-based products. Use of such products may damage the grille.

### INSTALLATION

- The grille can be installed with its slats horizontal
- Installation must comply with extension EFR-14-003037
- Fire-protection grilles cannot be used for forced-air ventilation.

## GEOL® Adhesive 25 kgs



### APPLICATIONS



Ventilation



Fire protection services



Smoke extraction



Carbon protection reinforcement

### PRODUCT DESCRIPTION

Powder-coated adhesive especially formulated for mounting GEOFLAM® and GEOTEC® boards. Also suitable for bonding various building materials: plasterboard, plasterboard tiles, aerated concrete block, etc. Can also be used for top coating on most substrates.

The plaster-based GEOL® glue is used on the joints both as glue and as a filler (maximally 1/3<sup>rd</sup> of the board thickness). It allows larger tolerances during installation hence minimizing material waste and maximizing installation speed.

### COMPOSITION AND APPEARANCE

Gypsum, calcium carbonate, resin and various additives. White plaster.

### TECHNICAL DATA

Reaction to fire A1 according to EN 13501-1  
Operating time: approx. 2 hours depending on ambient conditions.

### AVERAGE CONSUMPTION

1 bag of glue = 10 to 15 m<sup>2</sup>.

### DRYING TIME

5 to 6 hours depending on the ambient conditions.

### MIXING RATE

Approximately 12 to 14 L of water per 25 KG bag.

### PERMITTED SUPPORTS

Gypsum tiles, water-repellent or not / Gypsum / Cellular concrete.

### COATING

All types of products except cement-based products.

### PRECAUTIONS FOR USE

The temperature during application and drying must be between 5 and 30°C. Do not use paste that has begun to harden. Do not use for outdoor purposes.

### SUBSTRATE PREPARATION

The supports must be dry and free of dust.

### PACKAGING

25 kg bags.

### TRANSPORT AND STORAGE

Transport and store on a flat and protected surface (out of water), in a cool and dry place, protected from frost and heat.

### SHELF LIFE

6 months in original unopened packaging.

## Polyurethane foam



### APPLICATIONS



Ventilation



Fire protection services



Smoke extraction

### PRODUCT DESCRIPTION

Soudafoam FR is a single-part, self-expanding polyurethane foam that can be used upside down. Soudafoam FR serves to ensure the degree of fire resistance of ducts and conduits passing through walls.

### TECHNICAL CHARACTERISTICS

Base: Polyurethane  
 Consistency: Stable foam  
 Curing system: Polymerisation due to humidity in the air  
 Resistance to temperature: -40°C to + 90°C (cured)

### PACKAGING AND STORAGE

750 ml aerosol can  
 Always store Soudafoam FR in an upright position in a cool dry place.  
 The foam will last for 12 months in its closed packaging.

## Mineral Fiber Rope



### APPLICATIONS



Ventilation



Fire protection services



Smoke extraction

### PRODUCT DESCRIPTION

Ensuring the degree of fire resistance for expansion joints, mineral fiber ropes are available in diameters from 20 to 60 mm. Mineral fiber roll is mainly used for expansion joint element on vertical ducts.

### TECHNICAL CHARACTERISTICS

Material: Basalt "bio soluble" mineral fibers.  
 Density: 270 ± 25 kg /m<sup>3</sup>.  
 Melting temperature: 1200°C.  
 Complete immersion water absorption at 20°C: 11 to 12 %, saturation after 7 days, returns to initial weight in 48 hours.  
 Good acoustic and thermal insulation, 0.08 W/m<sup>2</sup>K.

### PACKAGING

20 m roll.



**INTERACTIVE  
CONTENT**  
Click to access



# SMOKE EXTRACTION & VENTILATION DUCTS

<b>1. SYSTEM GENERAL OVERVIEW</b>	<b>30</b>
<b>2. HORIZONTAL SYSTEM</b>	<b>31</b>
2.1 Assembly principle	31
2.2 Installation instructions	33
2.3 Alternative support principles	57
2.4 Alternative for the protection of the suspension system	62
2.5 Wall penetrations	63
2.6 Dilation joints	64
2.7 Protection of steel ducts	65
2.8 Various configurations	66
<b>3. VERTICAL SYSTEM</b>	<b>67</b>
3.1 Assembly principle	67
3.2 Installation instructions	68
3.3 Alternative support principles	75
3.4 Floor penetrations	79
3.5 Dilation joints	79
3.6 Various configurations	80

### 1. SYSTEM GENERAL OVERVIEW

Ducts are made by juxtaposing **GEOTEC®S** boards of length 1000 mm and of 30 or 45 mm thickness. These systems are available for fire classifications EI 30 S to EI 120 S (in accordance with standards EN 13501-3 and EN 13501-4). All boards are moulded to standard dimensions with rabbets to facilitate their assembly (30 mm : 2-sided; 45mm : 4-sided). Each 1000 mm long cuttable segment comprises four or more boards.


#### Certificates: fire resistance classification report



	Tests in accordance with EN 1366-1 and 1366-8	Thickness (mm)	EI S	Internal cross-sections (mm)	Service pressure (Pa)	EFECTIS classification documents
	Horizontal and vertical ventilation ducts	30	30/60	0x0 to 2500x1500	± 500	Cert EFR-16-002202 Rev. 1
		45	90/120			
	Horizontal and vertical Smoke extraction ducts	30	30/60	0x0 to 2500x1500	-1500/+500	Cert. EFR-16-002203 Rev. 1
		45	90/120			


E = Integrity / I = Thermal insulation / S = Smoke-tightness

#### Horizontal system

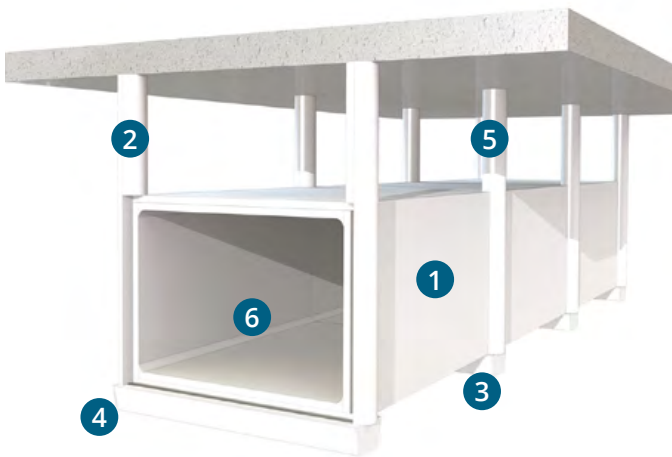

- 1 GEOTEC®S 30 or GEOTEC®S 45 fire-protective boards (EI 30/60 S and EI 90/120 S)
- 2 GEOTEC®A 1/2 shells
- 3 GEOTEC®A U-plaster element
- 4 21x41x21 steel U profile, Ø8 nut and washer
- 5 Ø8 anchor brass and threaded rod
- 6 GEOCOL® glue

#### Vertical system

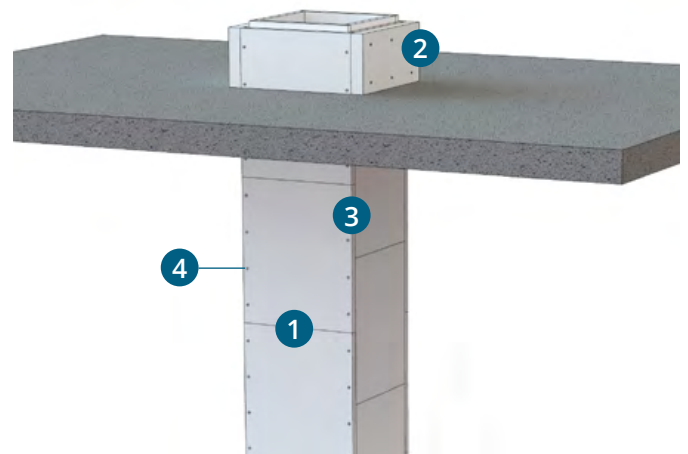

- 1 GEOTEC®S 30 or GEOTEC®S 45 fire-protective boards (EI 30/60 S and EI 90/120 S)
- 2 GEOTEC®A\* reinforcement collar
- 3 GEOCOL® glue
- 4 VBA screws  
Ø 5 x 80 (EI 30/60 S)  
Ø 5 x 90 (EI 90/120 S)

To make your assemblies easier, Geostaff privileges the use of the Ø8 threaded rod and 41x21 steel U-profile. All screw heads can be hidden by glue for easthetic reasons.

\* Other load-bearing methods in chapter : 3.3.Alternative support principles (from page 75).

## 2. HORIZONTAL SYSTEM

### 2.1. Assembly principle


The boards are assembled using VBA screws or staples. Screws are inserted without pilot holes. All joints are previously treated with **GEOCOL®** glue.

Horizontal ducts are formed from 1000 mm sections; the boards are mounted without offset on the horizontal and vertical joints. However, in order to facilitate the installation, the upper boards can be offset from the rest of the duct.

**+** Any spaces of less than 10 mm between board junctions must be filled in over the entire thickness with **GEOCOL®** glue.

**+** Eventual repairs can be treated by bonding and screwing an extra thickness of the board with an overlap equivalent to the thickness of the board.


#### Cross-sectional view

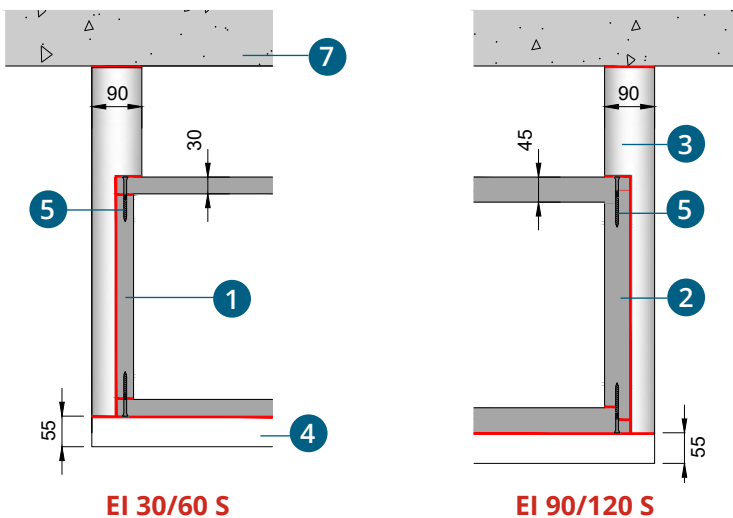

- 1 GEOTEC® S 30 board
- 2 GEOTEC® S 45 board
- 3 GEOTEC® A 1/2 shell
- 4 GEOTEC® A U plaster element
- 5 VBA Screw  
Ø 5 x 80 (EI 30/60 S)  
Ø 5 x 90 (EI 90/120 S)  
or galvanized steel staples  
\* 75 x 10 x 2 mm
- 6 Steel U-profile  
21 x 41 x 21
- 7 Concrete slab

\*staples :  
≤ 1250 x 1000 mm (w x h) EI 30/60/90 S.


#### Longitudinal section view

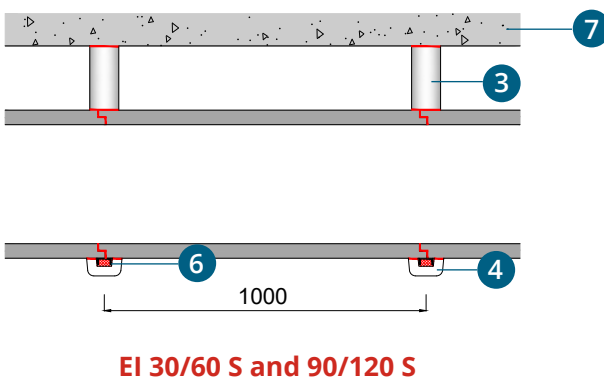

### When the duct is against the slab :

In the case of a horizontal duct adjoining the slab, a batten can be used to screw the boards together.

### Cross-sectional view

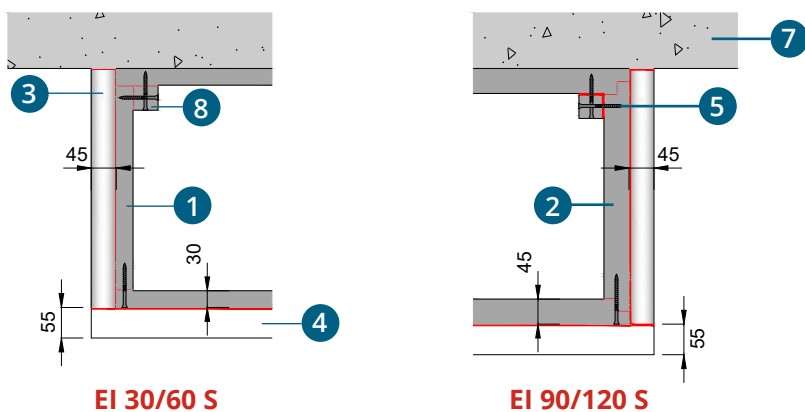


EI 30/60 S

EI 90/120 S

- 1 GEOTEC® S 30 board
- 2 GEOTEC® S 45 board
- 3 GEOTEC® A 1/2 shell
- 4 GEOTEC® A U plaster element
- 5 VBA Screw  
Ø 5 x 80 (EI 30/60 S)  
Ø 5 x 90 (EI 90/120 S)  
or galvanized steel staples  
\* 75 x 10 x 2 mm
- 6 Steel U-profile  
21 x 41 x 21
- 7 Concrete slab
- 8 GEOTEC® A Batten

\*staples :  
≤ 1250 x 1000 mm (w x h) EI 30/60/90 S.

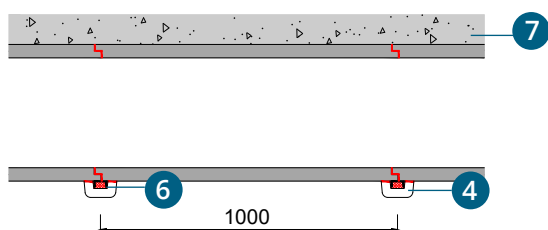

### Longitudinal section view



EI 30/60 S and 90/120 S






## 2.2. Installation instructions

Internal Duct Width (W int)	 Ventilation duct EN 1366-1	 Smoke extraction duct EN 1366-8	Page
<b>≤ 600 mm</b>	Standard Installation.		<b>35</b>
<b>600 &lt; w ≤ 1000 mm</b>	<b>Solution 1:</b> Using GEOTEC® A cover strip.		<b>36</b>
	<b>Solution 2:</b> Using GEOTEC® A Reinforcement collar.		<b>38</b>
<b>1000 &lt; w ≤ 1250 mm</b>	<b>Solution 1</b>		<b>40</b>
	Using internal steel U-profile.	Using internal steel U-profile protected by GEOTEC® A U-plaster element.	<b>40/42</b>
	<b>Solution 2:</b> Using internal protected Ø8 threaded rods.		<b>44</b>
<b>1250 &lt; w ≤ 2000 mm</b>	Using a second 21x41x21 steel U-profile + an additional Ø8 threaded rod.	Using a second 21x41x21 steel U-profile protected by <b>GEOTEC® A U-plaster</b> element and using an additional Ø8 threaded rod protected by <b>GEOTEC® A Half shell</b>	<b>46</b>
<b>2000 &lt; w ≤ 2500 mm</b>	Using a second 24x41x21 steel U-profile + an additional Ø8 threaded rod. + Replace the steel U-profile placed under the lower board for a 41x41 Steel U-profile.	Using a second 21x41x21 steel U-profile protected by <b>GEOTEC® A U-plaster</b> element and using an additional Ø8 threaded rod protected by <b>GEOTEC® A Half shell</b> . + Replace the steel U-profile placed under the lower board for a 41x41 Steel U-profile.	<b>49</b>
<b>Inner Perimeter &gt; 4500 mm</b>			
<b>600 &lt; w ≤ 1000 mm</b>	Use solution 1 or 2 above and replace Ø8 threaded rods for Ø10 threaded rods.		-
	<b>Special configuration:</b> Use a third Ø8 threaded rod protected by GEOTEC® A Half shell.		<b>52</b>
<b>1000 &lt; w ≤ 1250 mm</b>	Use solution 1 or 2 above and replace Ø8 threaded rods for Ø10 threaded rods.		-
	<b>Special configuration:</b> Use a second 21x41x21 steel U-profile + an additional Ø8 threaded rod.	<b>Special configuration:</b> Use a second 21x41x21 steel U-profile protected by <b>GEOTEC® A U-plaster</b> element and use an additional Ø8 threaded rod protected by <b>GEOTEC® A Half shell</b> .	<b>54</b>

### Standard installation principle

**CLICK and watch**  
**THE HORIZONTAL DUCT ASSEMBLY on video.**

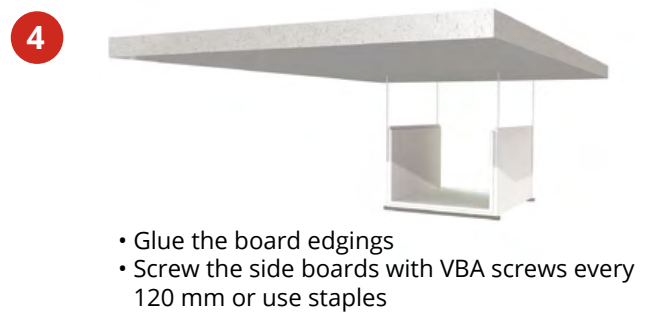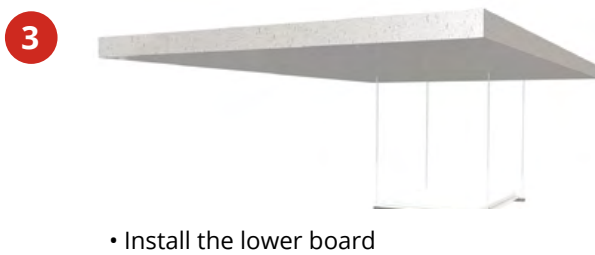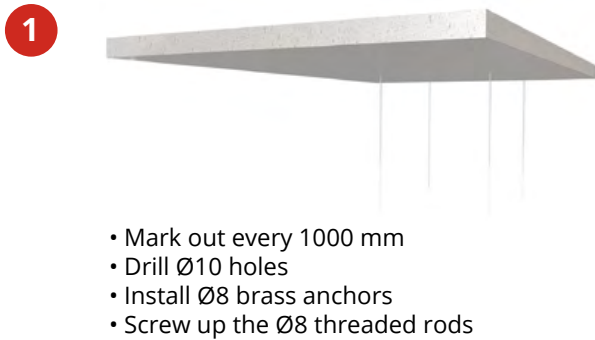


## W int ≤ 600 mm

Standard installation principle : see page 34.


## W int ≤ 600 mm EI 30 / 60 (S) and EI 90 / 120 (S)



### Front view

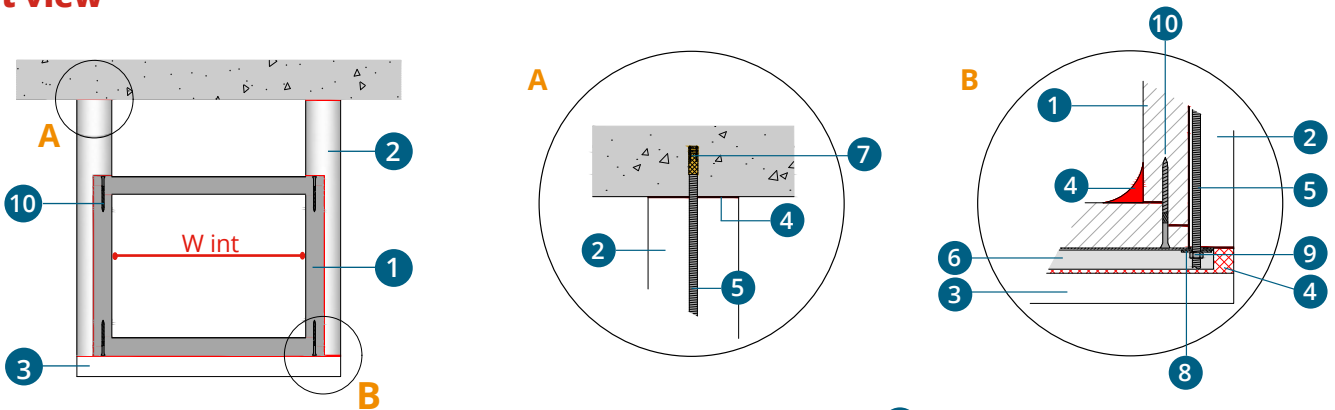

### Side view

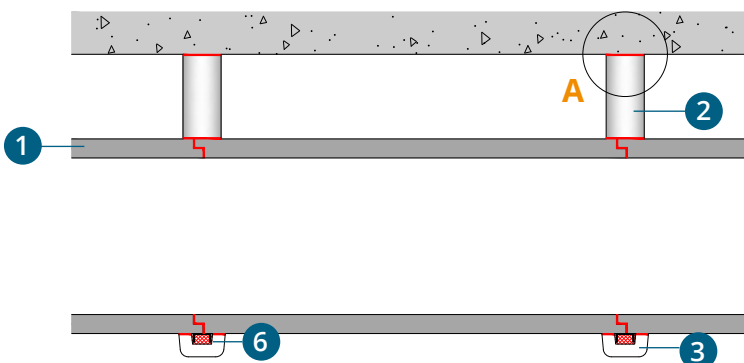

- 1 GEOTEC® S board
- 2 GEOTEC® A 1/2 shell
- 3 GEOTEC® A U-plaster element
- 4 Geocol® Glue
- 5 Threaded rod Ø8
- 6 Steel U profile 41 x 21
- 7 Brass anchor Ø8
- 8 Galvanized washers Ø8
- 9 Galvanized nuts Ø8
- 10 VBA Screws  
Ø 5 x 80 (EI 30/60)  
Ø 5 x 90 (EI 90/120)  
or galvanized steel staples\*  
75 x 10 x 2 mm

\*staples :  
≤ 1250 x 1000 mm (w x h) EI 30/60/90 S.

### **600 < W int ≤ 1000 mm**

In this configuration, install a reinforcement every meter where the sections meet to support the upper board of the duct. Two solutions may be used: using **cover strips** or using **internal reinforcement collars**.


#### **Solution 1 : using GEOTEC®A Cover strip**

GEOTEC® A Cover strip are placed inside or outside the duct to cover the joints. This installation principle is accepted for internal ducts dimensions 600 < W int ≤ 1000 mm for EI 60 S (1 hour fire-resistant) and for internal dimensions 600 < W int ≤ 800 mm for EI 120 S (2 hours fire-resistant).




**600 < W int ≤ 1000 mm - EI 30 / 60 (S)**  
**600 < W int ≤ 800 mm - EI 90 / 120 (S)**


## Front view

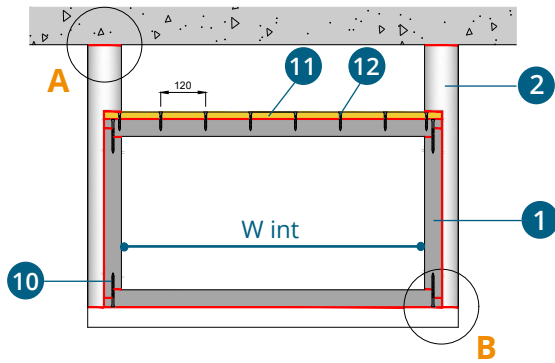

## Side view

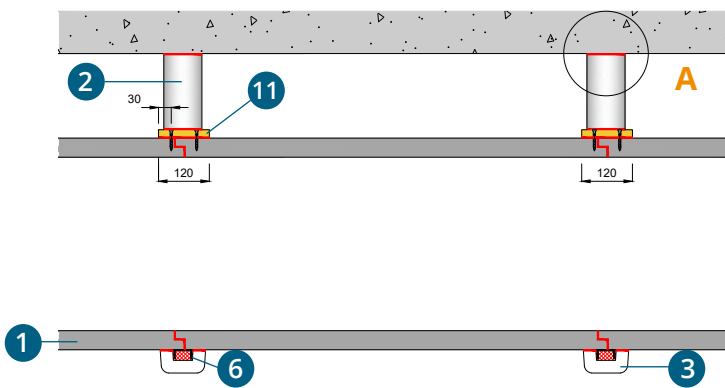


## Top view

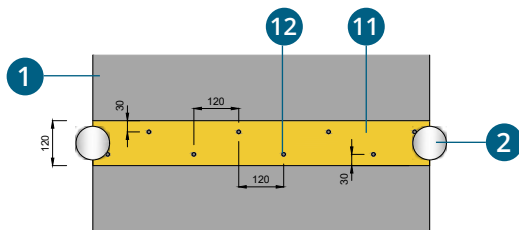

### If duct inner perimeter > 4500 mm

replace Threaded rod Ø8, Brass anchor Ø8, Galvanized washers Ø8, Galvanized nuts Ø8 for Ø10.

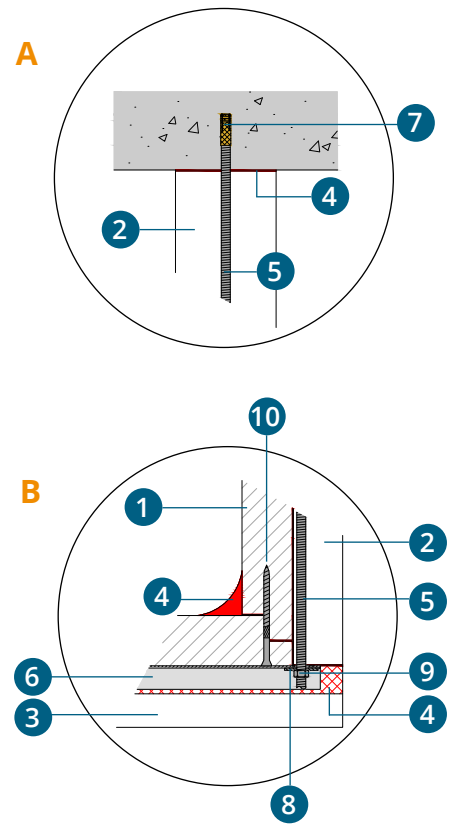

- 1 GEOTEC® S board
- 2 GEOTEC® A 1/2 shell
- 3 GEOTEC® A U-plaster element
- 4 Geocol® Glue
- 5 Threaded rod Ø8
- 6 Steel U profile 41 x 21
- 7 Brass anchor Ø8
- 8 Galvanized washers Ø8
- 9 Galvanized nuts Ø8
- 10 VBA Screws  
Ø 5 x 80 (EI 30/60)  
Ø 5 x 90 (EI 90/120)  
or galvanized steel staples\*  
75 x 10 x 2 mm
- 11 GEOTEC® A Cover strips
- 12 VBA Screws Ø 5 x 50

\*staples :  
≤ 1250 x 1000 mm (w x h) EI 30/60/90 S.

**600 < W int ≤ 1000 mm**


### **Solution 2 : using internal reinforcement collars (thickness identical to that of the board)**

GEOTEC® A Reinforcement collars are placed inside the duct to support the upper board of the duct.






**600 < W int ≤ 1000 mm  
EI 30 / 60 (S) - EI 90 / 120 (S)**

## Front view

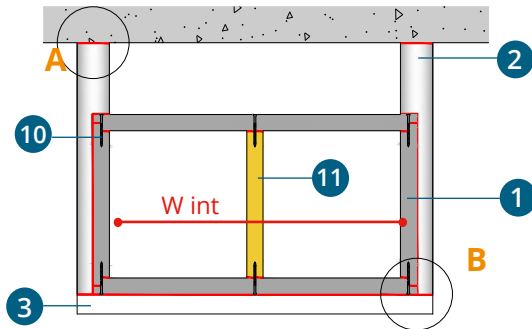

## Side view

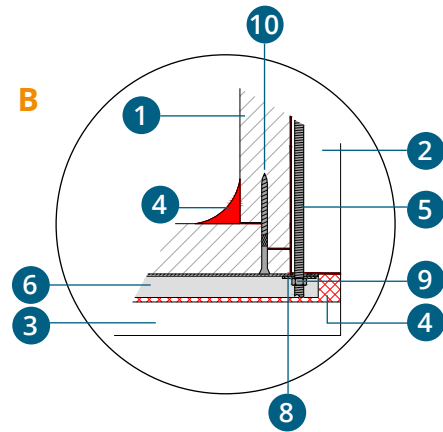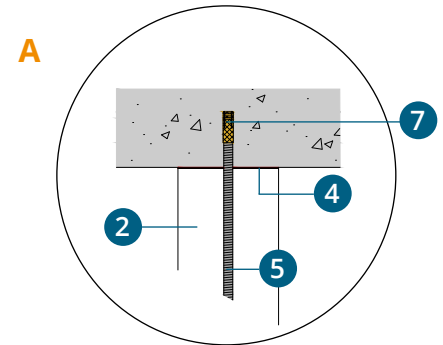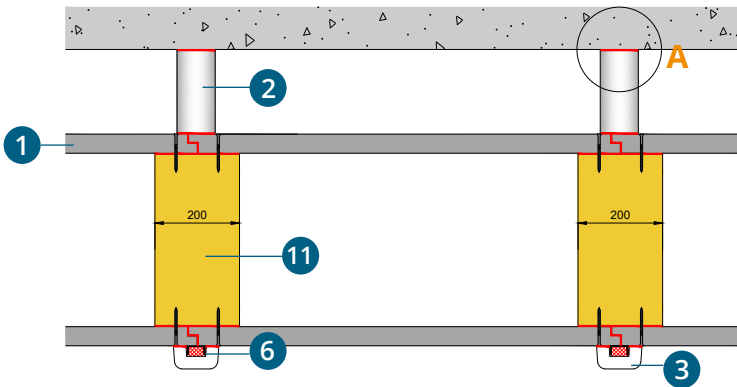

- 1 GEOTEC® S board
- 2 GEOTEC® A 1/2 shell
- 3 GEOTEC® A U-plaster element
- 4 Geocol® Glue
- 5 Threaded rod Ø8
- 6 Steel U profile 41 x 21
- 7 Brass anchor Ø8
- 8 Galvanized washers Ø8
- 9 Galvanized nuts Ø8
- 10 VBA Screws  
Ø 5 x 80 (EI 30/60)  
Ø 5 x 90 (EI 90/120)  
or galvanized steel staples\*  
75 x 10 x 2 mm
- 11 GEOTEC® A Reinforcement collar

\*staples :  
≤ 1250 x 1000 mm (w x h) EI 30/60/90 S.

### If duct inner perimeter > 4500 mm

replace Threaded rod Ø8, Brass anchor Ø8, Galvanized washers Ø8,  
Galvanized nuts Ø8 for Ø10.

**1000 < W int ≤ 1250 mm**

### **Solution 1 : Using internal steel U-profile**


**1. For a ventilation duct:** In this configuration, a **second 21x41x21 steel U-profile** must be installed inside the duct to support the upper boards.




**1000 < W int ≤ 1250 mm**  
**EI 30 / 60 (S) and EI 90 / 120 (S)**



## Front view



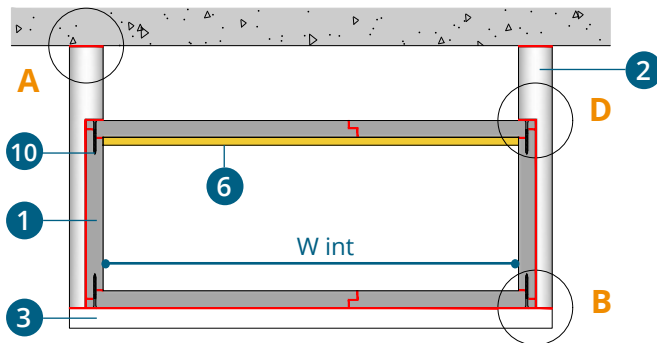


## Side view

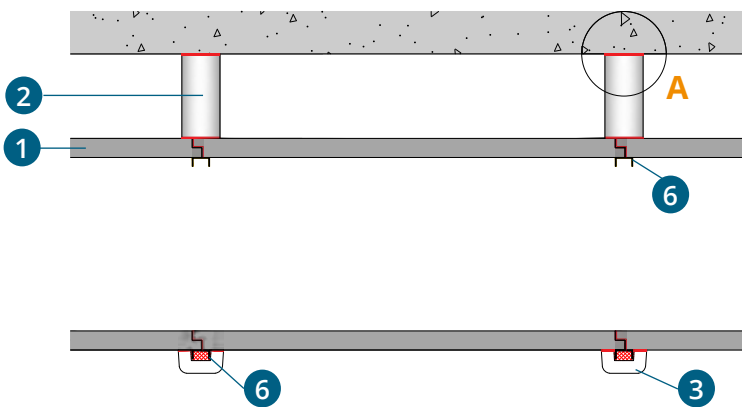

### If duct inner perimeter > 4500 mm

replace Threaded rod Ø8, Brass anchor Ø8, Galvanized washers Ø8, Galvanized nuts Ø8 for Ø10.

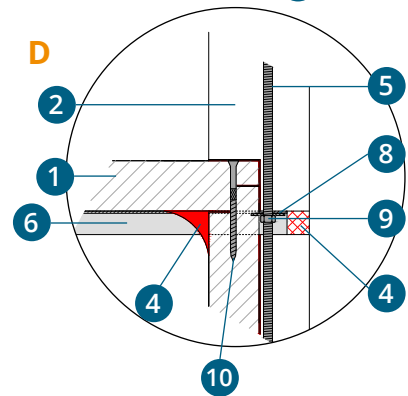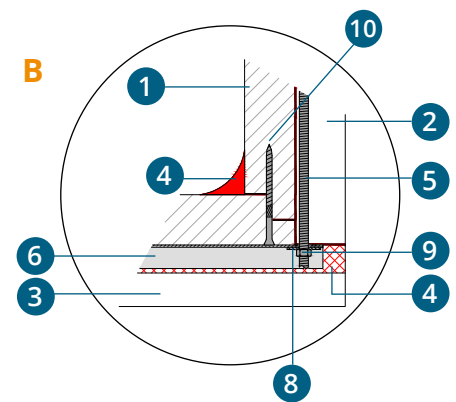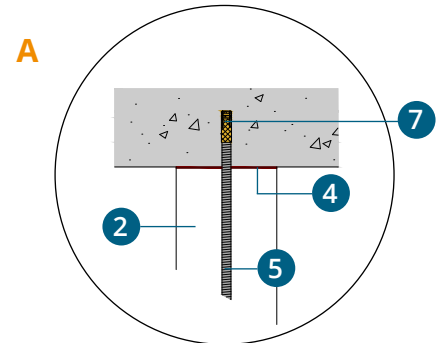

- 1 GEOTEC® S board
- 2 GEOTEC® A 1/2 shell
- 3 GEOTEC® A U-plaster element
- 4 Geocol® Glue
- 5 Threaded rod Ø8
- 6 Steel U profile 41 x 21
- 7 Brass anchor Ø8
- 8 Galvanized washers Ø8
- 9 Galvanized nuts Ø8
- 10 VBA Screws  
Ø 5 x 80 (EI 30/60)  
Ø 5 x 90 (EI 90/120)  
or galvanized steel staples\*  
75 x 10 x 2 mm

\*staples :  
≤ 1250 x 1000 mm (w x h) EI 30/60/90 S.

**1000 < W int ≤ 1250 mm**


**2. For a smoke extraction duct:**

In this configuration, a **second 21x41x21 steel U-profile** must be installed inside the duct to support the upper boards and **protected by GEOTEC® A U plaster element**.




**1000 < W int ≤ 1250 mm**  
**EI 30 / 60 (S) and EI 90 / 120 (S)**

## Front view

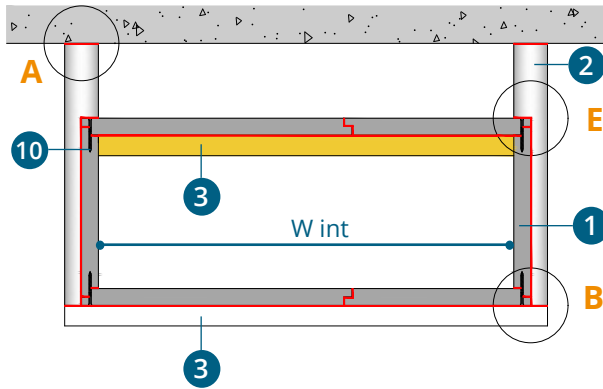


## Side view

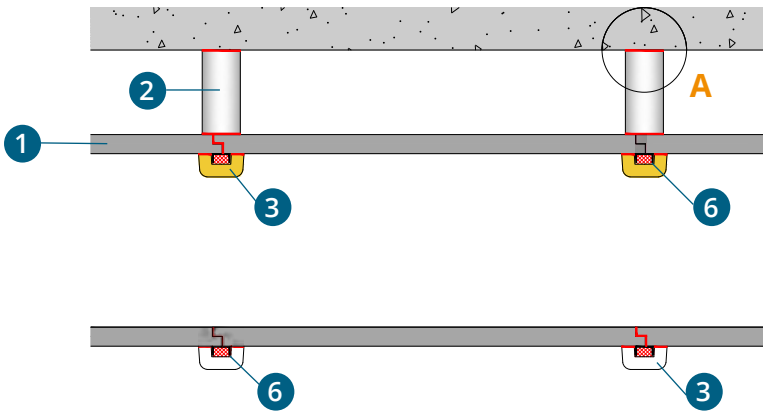

### If duct inner perimeter > 4500 mm

replace Threaded rod Ø8, Brass anchor Ø8, Galvanized washers Ø8, Galvanized nuts Ø8 for Ø10.

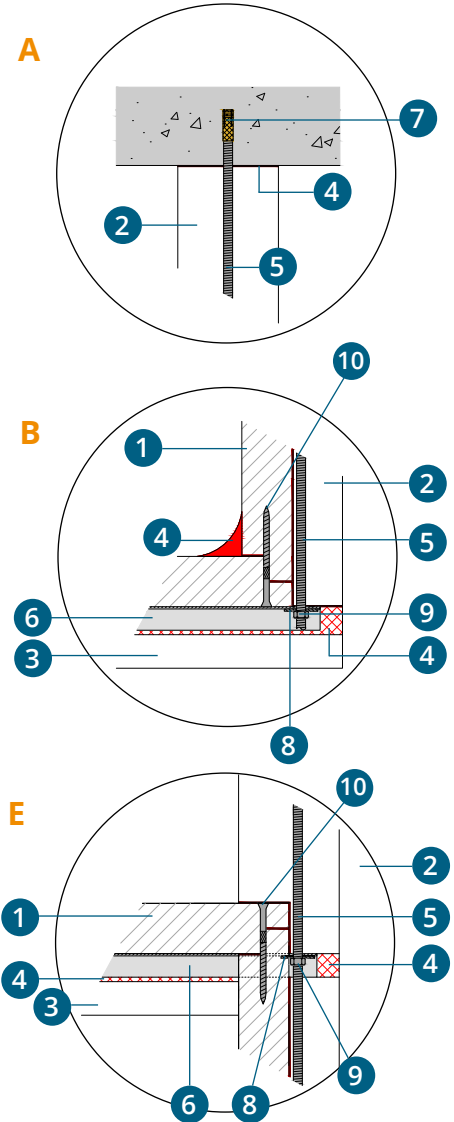

- 1 GEOTEC® S board
- 2 GEOTEC® A 1/2 shell
- 3 GEOTEC® A U-plaster element
- 4 Geocol® Glue
- 5 Threaded rod Ø8
- 6 Steel U profile 41 x 21
- 7 Brass anchor Ø8
- 8 Galvanized washers Ø8
- 9 Galvanized nuts Ø8
- 10 VBA Screws  
Ø 5 x 80 (EI 30/60)  
Ø 5 x 90 (EI 90/120)  
or galvanized steel staples\*  
75 x 10 x 2 mm

\*staples :  
≤ 1250 x 1000 mm (w x h) EI 30/60/90 S.

**1000 < W int ≤ 1250 mm**

### **Solution 2 : Using internal protected threaded rods.**


This solution can be used for both ventilation and smoke extraction ducts.

In this configuration, **a third Ø8 threaded rod** must be installed at mid-width of the duct to support the upper board of the duct. This threaded rod will be protected using **GEOTEC® A Half shells** whether it is a ventilation or a smoke extraction duct.




**1000 < W int ≤ 1250 mm**  
**EI 30 / 60 (S) and EI 90 / 120 (S)**

## Front view

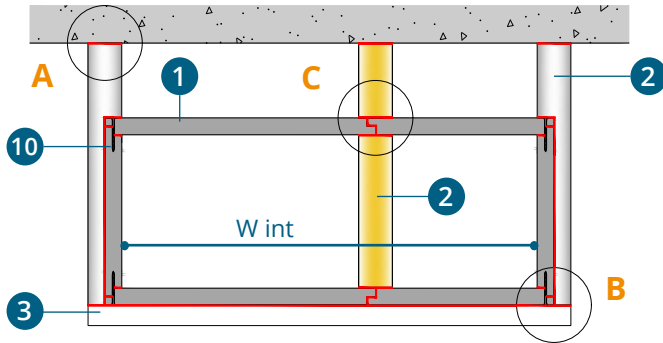


## Side view

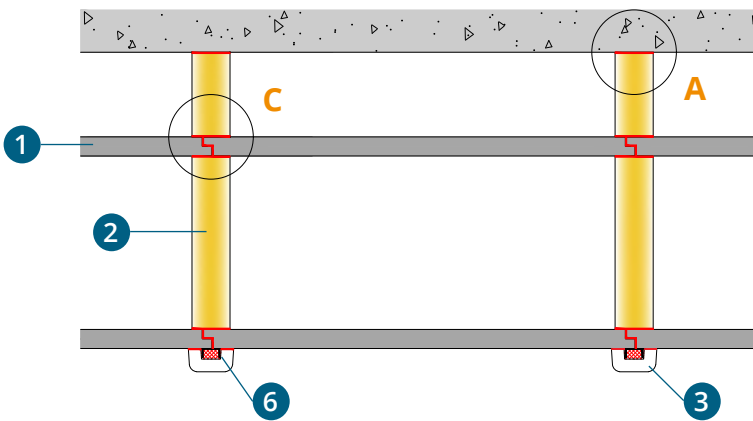

### If duct inner perimeter > 4500 mm

replace Threaded rod Ø8, Brass anchor Ø8, Galvanized washers Ø8, Galvanized nuts Ø8 for Ø10.

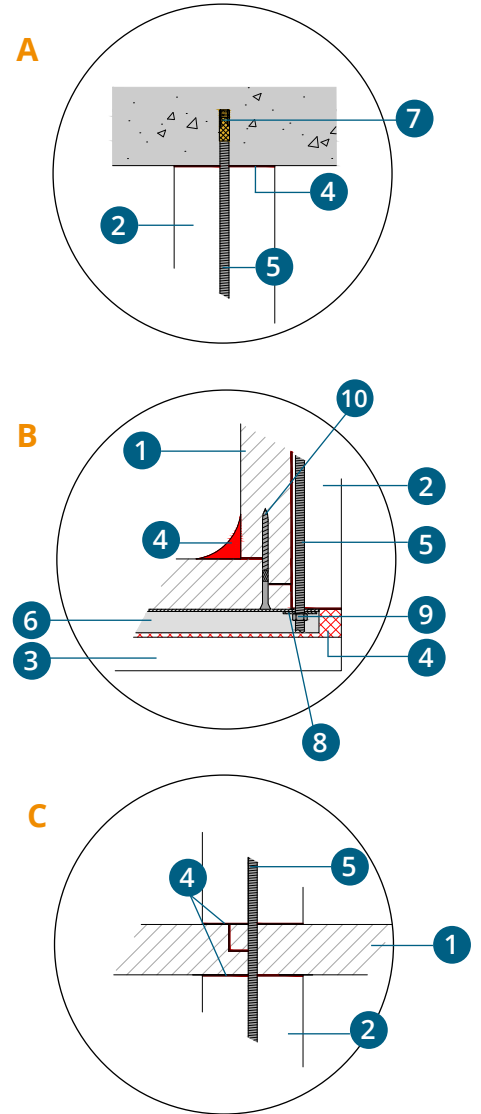

- 1 GEOTEC® S board
- 2 GEOTEC® A 1/2 shell
- 3 GEOTEC® A U-plaster element
- 4 Geocol® Glue
- 5 Threaded rod Ø8
- 6 Steel U profile 41 x 21
- 7 Brass anchor Ø8
- 8 Galvanized washers Ø8
- 9 Galvanized nuts Ø8
- 10 VBA Screws  
 Ø 5 x 80 (EI 30/60)  
 Ø 5 x 90 (EI 90/120)  
 or galvanized steel staples\*  
 75 x 10 x 2 mm

\*staples :  
 ≤ 1250 x 1000 mm (w x h) EI 30/60/90 S.

### 1250 < W int ≤ 2000 mm

In the case of horizontal ducts with an internal width of 1250 < W int ≤ 2000 mm, **the installation principle varies according to the type of duct:**

**1. For a ventilation duct:** In this configuration, **a second 21x41x21 steel U-profile as well as an additional Ø 8 threaded rod** must be installed inside to support the upper boards of the duct.

**2. For a smoke extraction duct:** In this configuration, **a second 21x41x21 steel U-profile as well as an additional Ø 8 threaded rod** must be installed inside to support the upper boards of the duct. Also, Threaded rods and steel U-profiles must be **protected using GEOTEC® A half shells and U-plaster elements.**

### Ventilation duct



**1250 < W int ≤ 2000 mm  
EI 30 / 60 (S) and EI 90 / 120 (S)**


### Smoke extraction duct




**1250 < W int ≤ 2000 mm  
EI 30 / 60 (S) and EI 90 / 120 (S)**

# 1. FOR A VENTILATION DUCT






## Front view

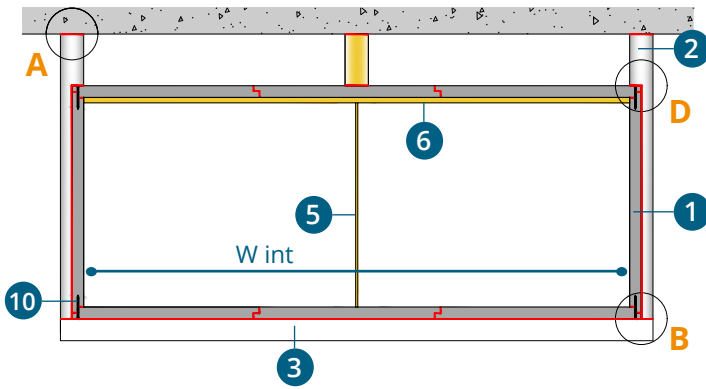

## Side view

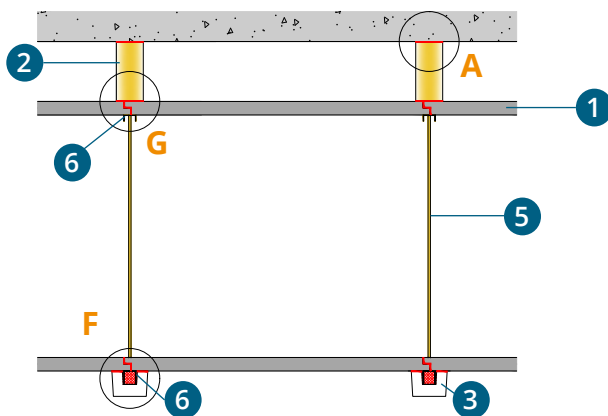


- 1 GEOTEC® S board
- 2 GEOTEC® A 1/2 shell
- 3 GEOTEC® A U-plaster element
- 4 Geocol® Glue
- 5 Threaded rod Ø8
- 6 Steel U profile 41x21
- 7 Brass anchor Ø8
- 8 Galvanized washers Ø8
- 9 Galvanized nuts Ø8
- 10 VBA Screws  
Ø 5 x 80 (EI 30/60)  
Ø 5 x 90 (EI 90/120)

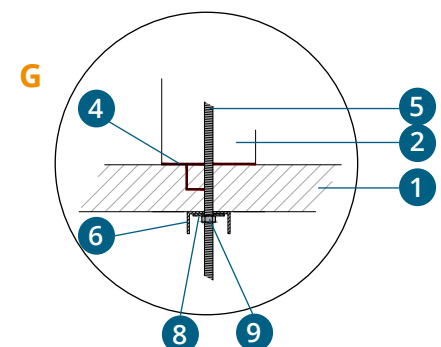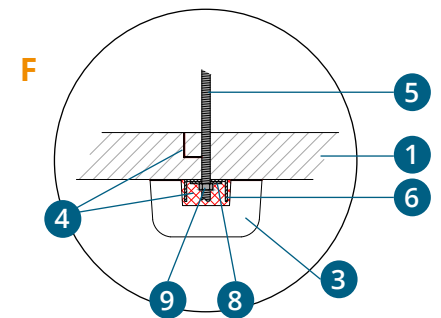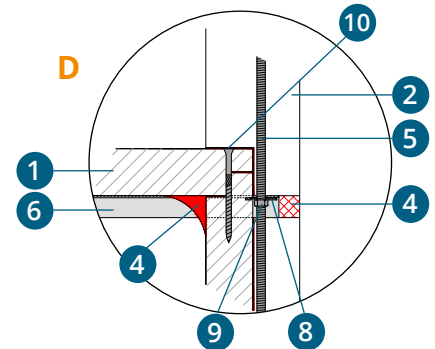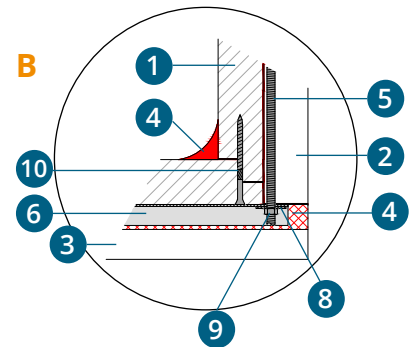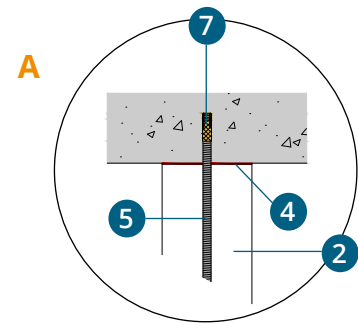


1250 < W int ≤ 2000 mm

### 2. FOR A SMOKE EXTRACTION DUCT


#### Front view

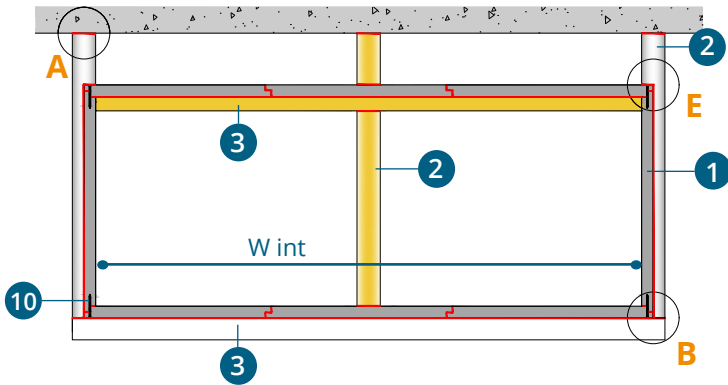

#### Side view

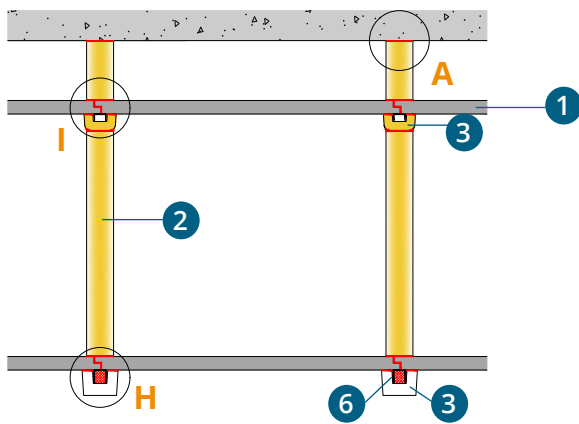

- 1 GEOTEC® S board
- 2 GEOTEC® A 1/2 shell
- 3 GEOTEC® A U-plaster element
- 4 Geocol® Glue
- 5 Threaded rod Ø8
- 6 Steel U profile 41x21
- 7 Brass anchor Ø8
- 8 Galvanized washers Ø8
- 9 Galvanized nuts Ø8
- 10 VBA Screws  
Ø 5 x 80 (EI 30/60)  
Ø 5 x 90 (EI 90/120)

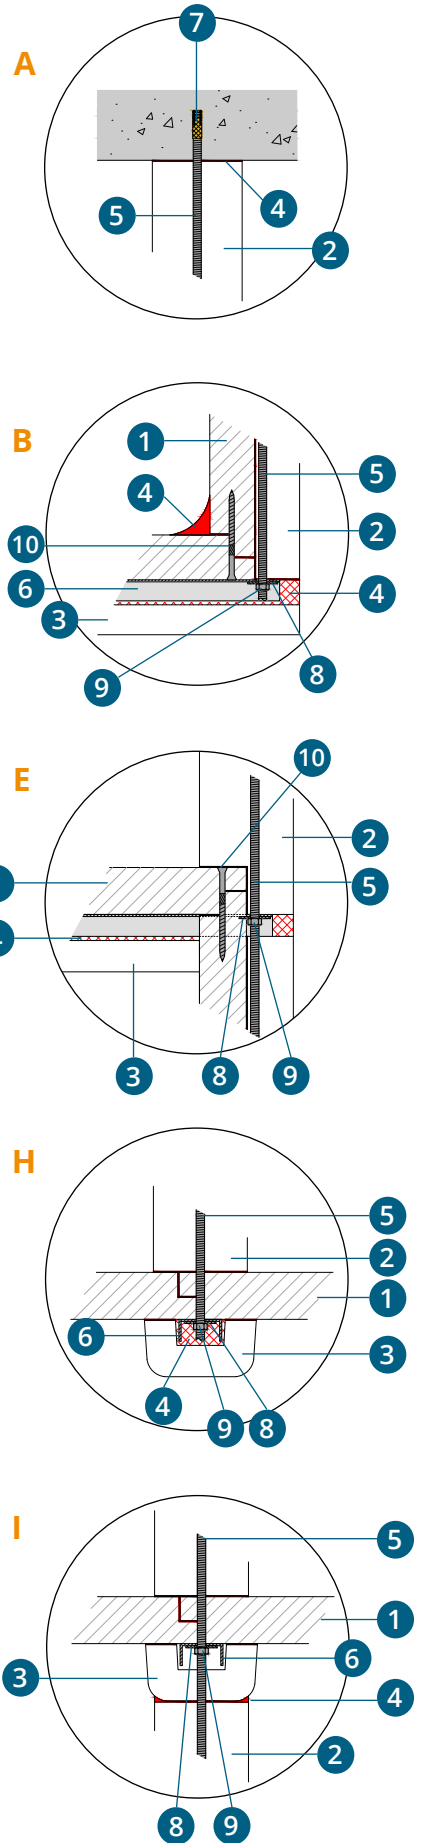



## 2000 < W int ≤ 2500 mm

In the case of horizontal ducts with an internal width of  $2000 < w \leq 2500$  mm, **the installation principle varies according to the type of duct :**

**1. For a ventilation duct:** In this configuration, **a second 21x41x21 steel U-profile as well as an additional Ø 8 threaded rod** must be installed inside to support the upper boards of the duct. Also, the steel U-profile placed under the lower board of the duct will be here a **41x41 steel U-profile** instead of a 21x41 (usually used for internal width  $\leq 2000$  mm).

**2. For a smoke extraction duct:** In this configuration, **a second 21x41x21 steel U-profile as well as an additional Ø 8 threaded rod** must be installed inside to support the upper boards of the duct and be protected by the **GEOTEC® A Half shells and U-plaster elements**. Also, the steel U-profile placed under the lower board of the duct will be here a **41x41 steel U-profile** instead of a 21x41 (usually used for internal width  $\leq 2000$  mm).

### Ventilation duct



**2000 < W int ≤ 2500 mm**  
**EI 30 / 60 (S) and EI 90 / 120 (S)**

### Smoke extraction duct




**2000 < W int ≤ 2500 mm**  
**EI 30 / 60 (S) and EI 90 / 120 (S)**


2000 < W int ≤ 2500 mm

### 1. FOR A VENTILATION DUCT






#### Front view

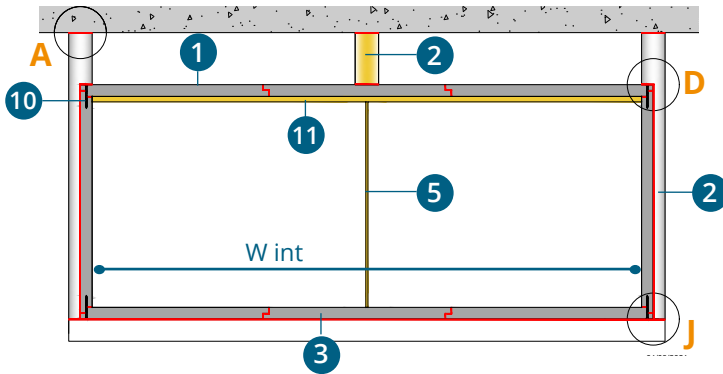

#### Side view

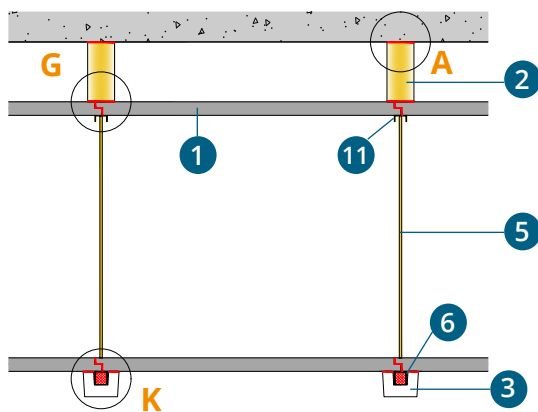


- 1 GEOTEC®S board
- 2 GEOTEC®A 1/2 shell
- 3 GEOTEC®A U-plaster element for steel U profile 41x41
- 4 Geocol® Glue
- 5 Threaded rod Ø8
- 6 Steel U profile 41 x 41
- 7 Brass anchor Ø8
- 8 Galvanized washers Ø8
- 9 Galvanized nuts Ø8
- 10 VBA Screws  
Ø 5 x 80 (EI 30/60)  
Ø 5 x 90 (EI 90/120)
- 11 Steel U profile 41x21

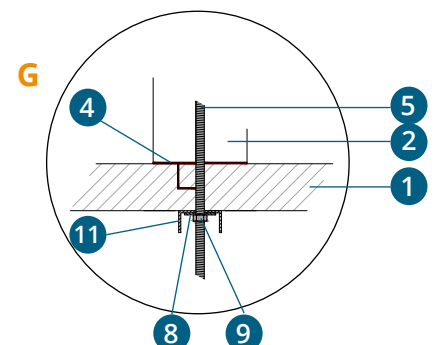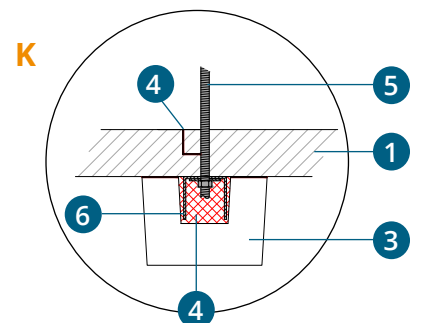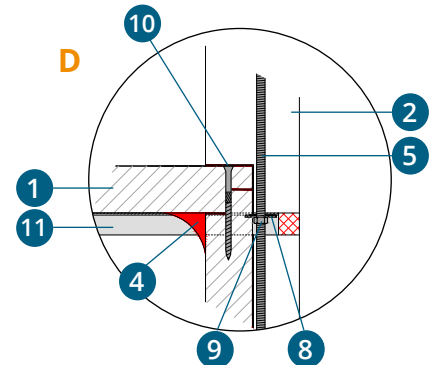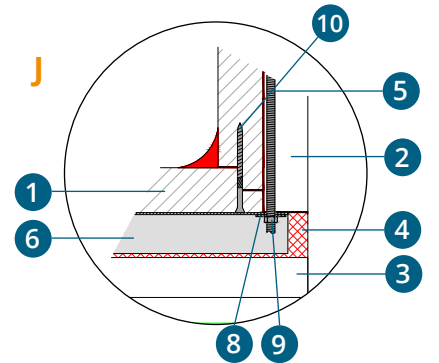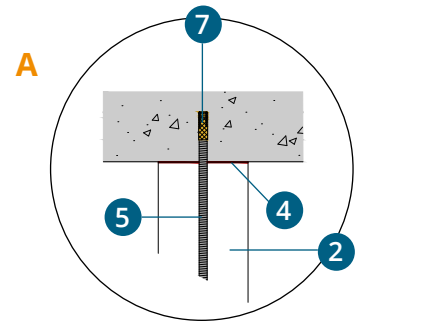


## 2. FOR A SMOKE EXTRACTION DUCT






### Front view

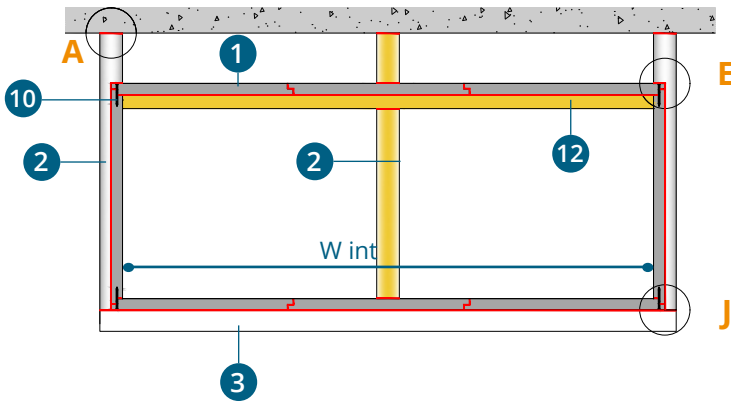

### Side view

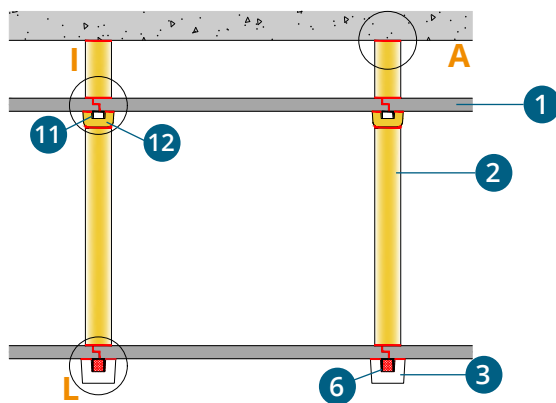

- 1 GEOTEC® S board
- 2 GEOTEC® A 1/2 shell
- 3 GEOTEC® A U-plaster element for steel U profile 41x41
- 4 Geocol® Glue
- 5 Threaded rod Ø8
- 6 Steel U profile 41 x 41
- 7 Brass anchor Ø8
- 8 Galvanized washers Ø8
- 9 Galvanized nuts Ø8
- 10 VBA Screws  
Ø 5 x 80 (EI 30/60)  
Ø 5 x 90 (EI 90/120)
- 11 Steel U profile 41x21
- 12 GEOTEC® A U-plaster element for steel U profile 41x21

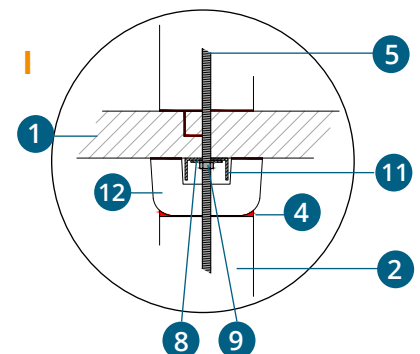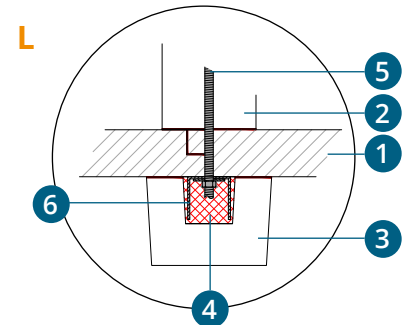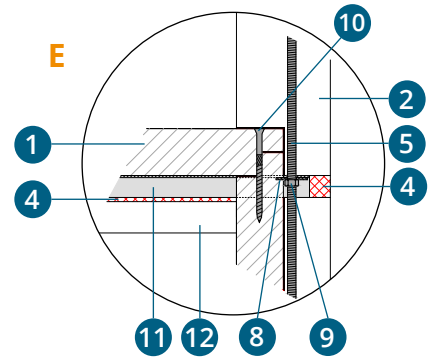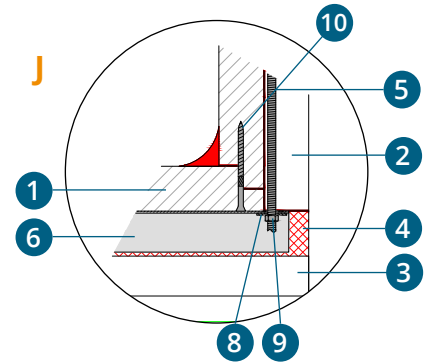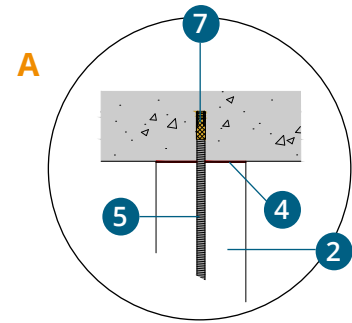

### Inner perimeter > 4500 mm

#### 600 < W int ≤ 1000 mm

In the case of an horizontal duct with an internal width of  $600 < W_{int} \leq 1000$  mm and inner perimeter > 4500 mm, for instance 950 x 1500 mm, two possibilities can be considered:

1. To realize the ventilation or smoke extraction duct using the **solution 1 or solution 2 described previously** for inner perimeter  $\leq 4500$  mm (page 34 to 37) but replacing threaded rod **Ø8 for Ø10**.
2. To realize the ventilation or smoke extraction duct using the **special configuration such as bellow**:

#### Special configuration


**For a ventilation duct or a smoke extraction duct:** In this configuration, **place and protect with a GEOTEC® A half shell a third Ø8 threaded rod** inside the duct to support the installation.





**600 < W int ≤ 1000 mm**  
**EI 30 / 60 (S) and EI 90 / 120 (S)**

## FOR A VENTILATION OR SMOKE EXTRACTION DUCT

### Front view

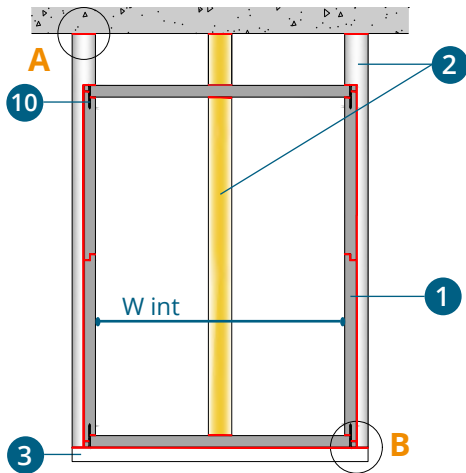

### Side view

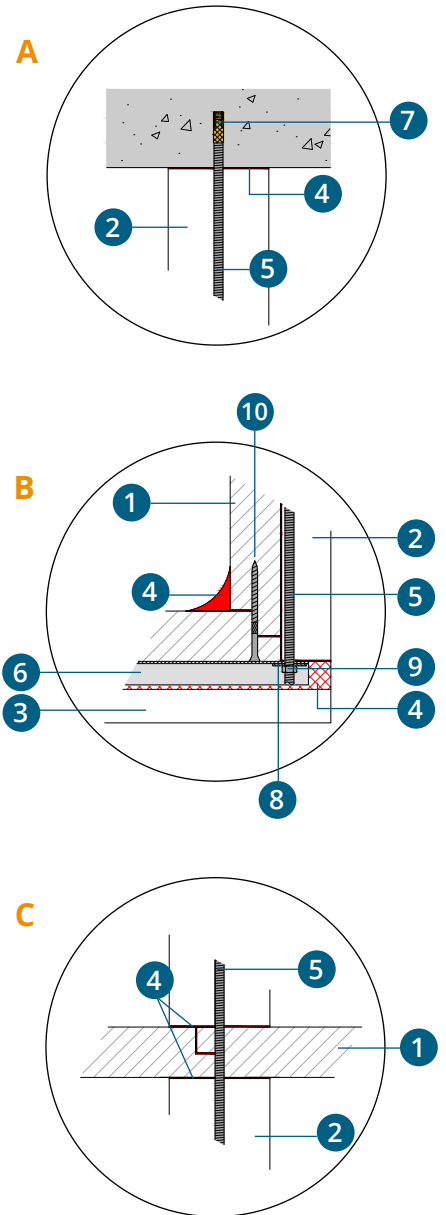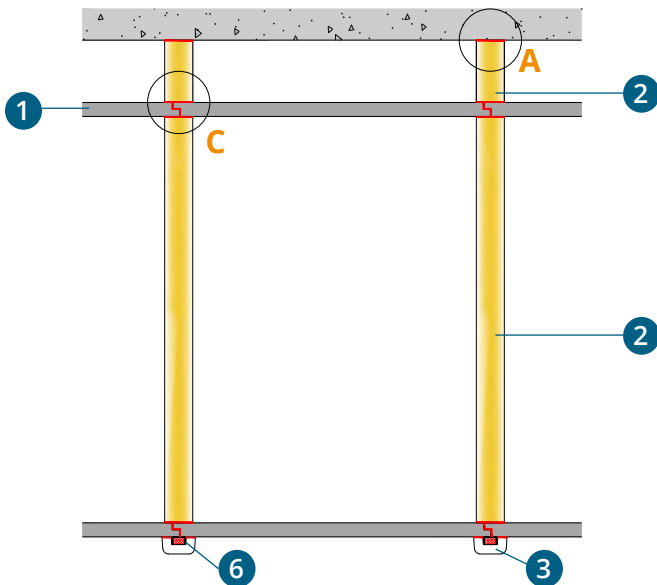

- 1 GEOTEC® S board
- 2 GEOTEC® A 1/2 shell
- 3 GEOTEC® A U-plaster element
- 4 Geocol® Glue
- 5 Threaded rod Ø8
- 6 Steel U profile 41x21
- 7 Brass anchor Ø8
- 8 Galvanized washers Ø8
- 9 Galvanized nuts Ø8
- 10 VBA Screws  
 Ø 5 x 80 (EI 30/60)  
 Ø 5 x 90 (EI 90/120)

### Inner perimeter > 4500 mm

#### 1000 < W int ≤ 1250 mm

In the case of horizontal ducts with an internal width of  $1000 < W_{int} \leq 1250$  mm and inner perimeter > 4500 mm, for instance a duct of internal width 1200 x 1100 mm, **two possibilities can be considered** :

1. To realize the ventilation or smoke extraction duct using the solutions described previously for inner perimeter  $\leq 4500$  mm (solution 1 page 38 to 41 and solution 2 page 42 and 43) **with  $\varnothing 10$  threaded rod instead of  $\varnothing 8$  threaded rod.**
2. To realize the ventilation or smoke extraction duct using the **special configuration such as bellow** :

#### Special configuration

1. **For a ventilation duct:** In this configuration, a **second 21x41x21 steel U-profile as well as an additional  $\varnothing 8$  threaded rod** must be installed inside to support the upper boards of the duct.
2. **For a smoke extraction duct:** In this configuration, a **second 21x41x21 steel U-profile as well as an additional  $\varnothing 8$  threaded rod** must be installed inside to support the upper boards of the duct. Also, Threaded rods and steel U-profiles must be **protected using GEOTEC® A half shells and U-plaster elements.**

#### Ventilation duct EN1366-1



**1000 < W int ≤ 1250 mm + Inner perimeter > 4500 mm  
EI 30 / 60 (S) and EI 90 / 120 (S)**


#### Smoke extraction duct EN1366-8




**1000 < W int ≤ 1250 mm + Inner perimeter > 4500 mm  
EI 30 / 60 (S) and EI 90 / 120 (S)**

# 1. FOR A VENTILATION DUCT


## Front view

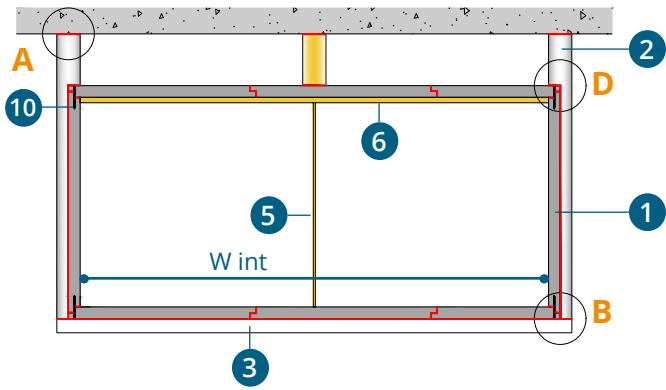

## Side view

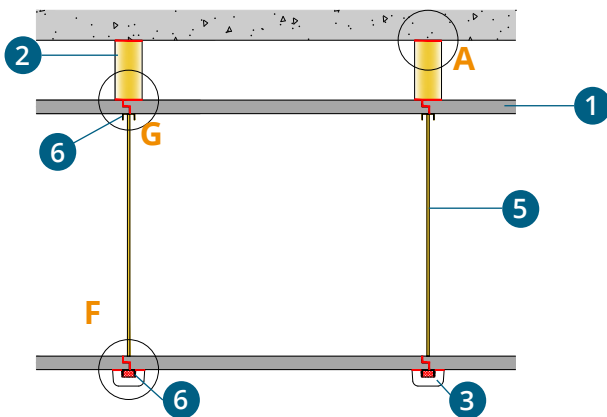


- 1 GEOTEC® S board
- 2 GEOTEC® A 1/2 shell
- 3 GEOTEC® A U-plaster element
- 4 Geocol® Glue
- 5 Threaded rod  $\varnothing 8$
- 6 Steel U profile 41x21
- 7 Brass anchor  $\varnothing 8$
- 8 Galvanized washers  $\varnothing 8$
- 9 Galvanized nuts  $\varnothing 8$
- 10 VBA Screws  
 $\varnothing 5 \times 80$  (EI 30/60)  
 $\varnothing 5 \times 90$  (EI 90/120)

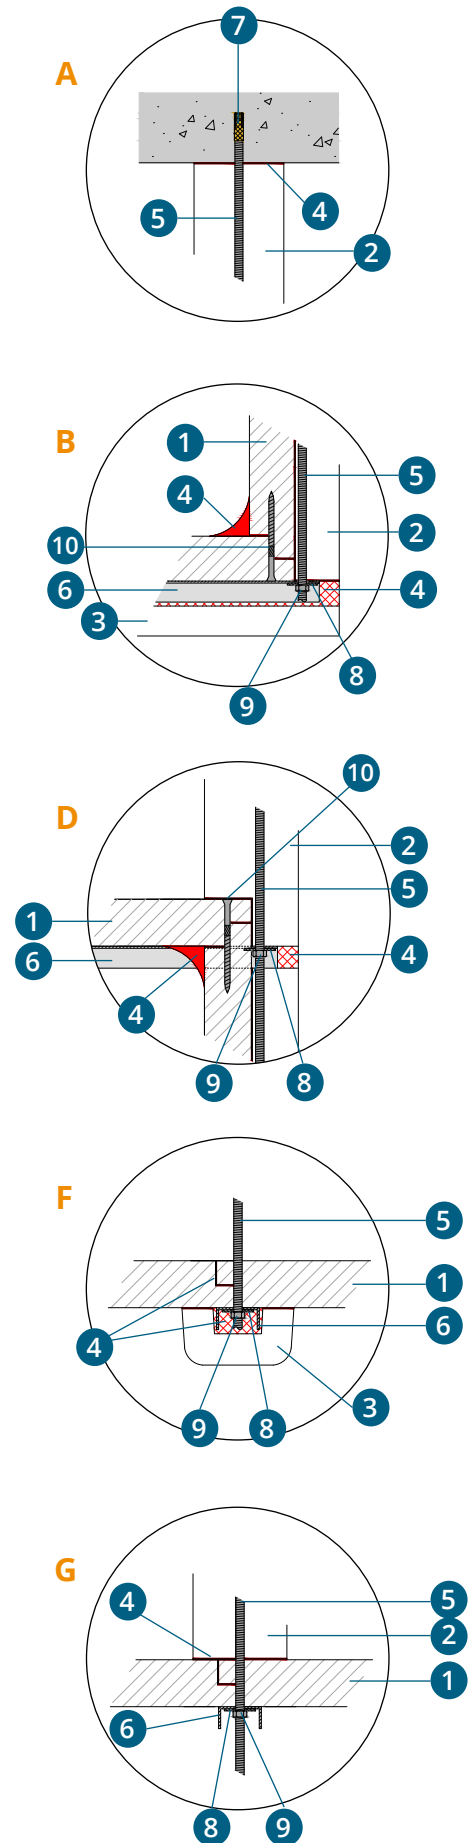


1000 < W int ≤ 1250 mm

### 2. FOR A SMOKE EXTRACTION DUCT


#### Front view

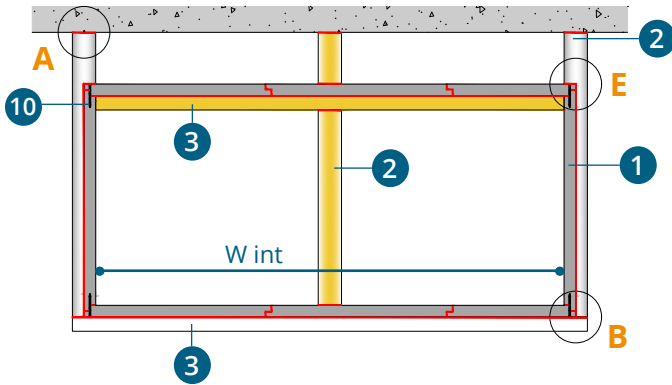

#### Side view

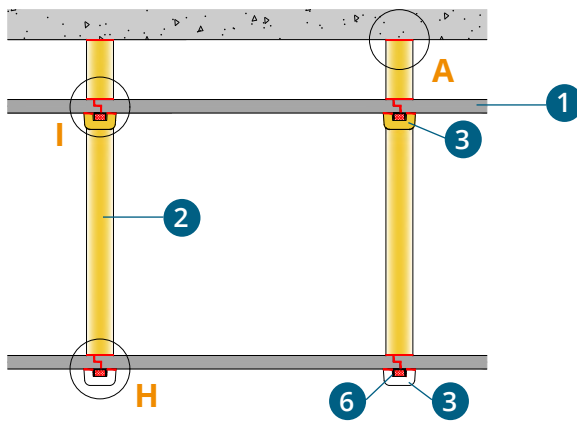

- 1 GEOTEC® S board
- 2 GEOTEC® A 1/2 shell
- 3 GEOTEC® A U-plaster element
- 4 Geocol® Glue
- 5 Threaded rod Ø8
- 6 Steel U profile 41x21
- 7 Brass anchor Ø8
- 8 Galvanized washers Ø8
- 9 Galvanized nuts Ø8
- 10 VBA Screws  
Ø 5 x 80 (EI 30/60)  
Ø 5 x 90 (EI 90/120)

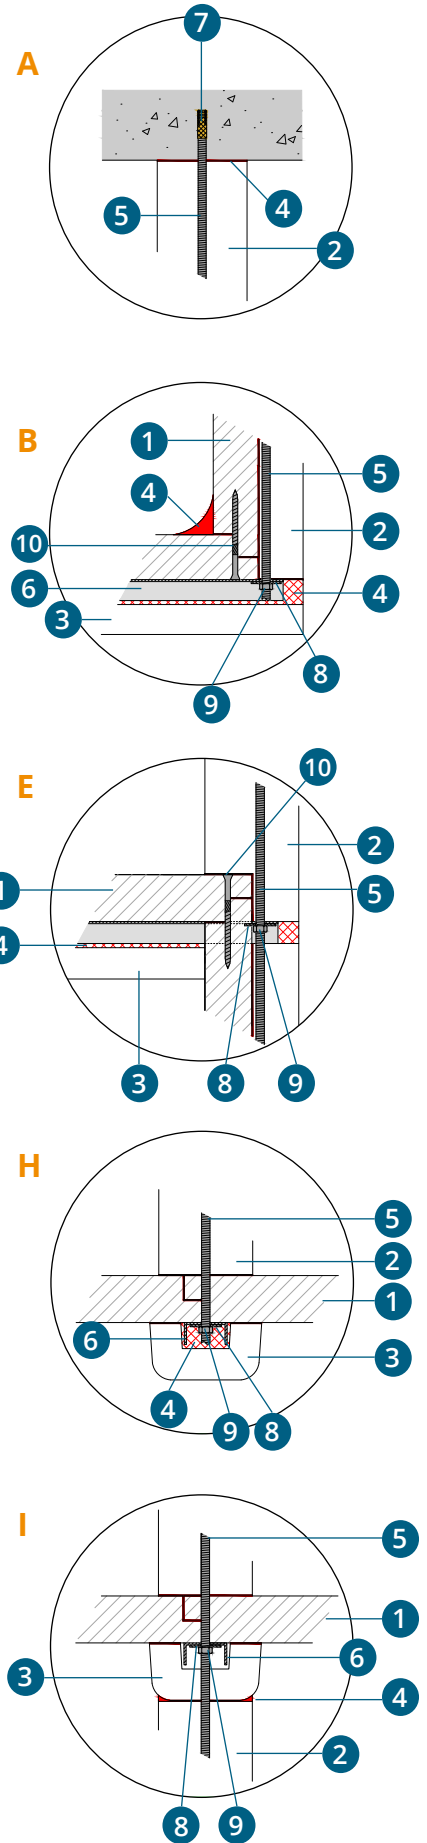




## 2.3. Alternative support principles

In response to the difficulties experienced on construction sites, Geostaff offers alternative solutions to support the ducts.


### A) Suppression of the inner rod Ø8 for large ducts

In the case of ducts with an internal width of  $1250 < w \leq 2500$  mm, it is possible to remove the 3<sup>rd</sup> internal rod by replacing the external rods with rods of Ø10 and by using appropriate **steel U-profiles** (upper and lower) according to the supplier's certification.

#### Front view

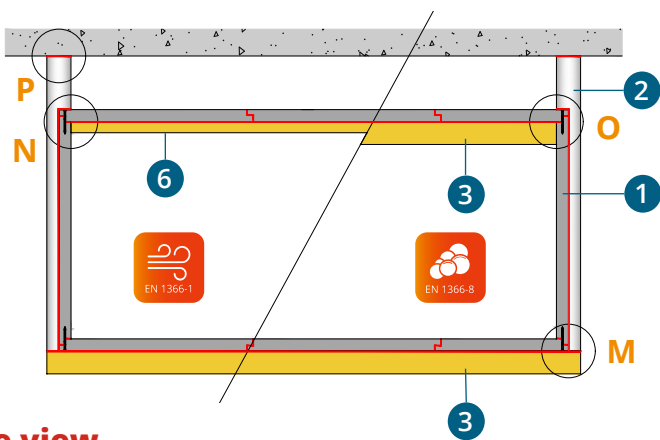





#### Side view

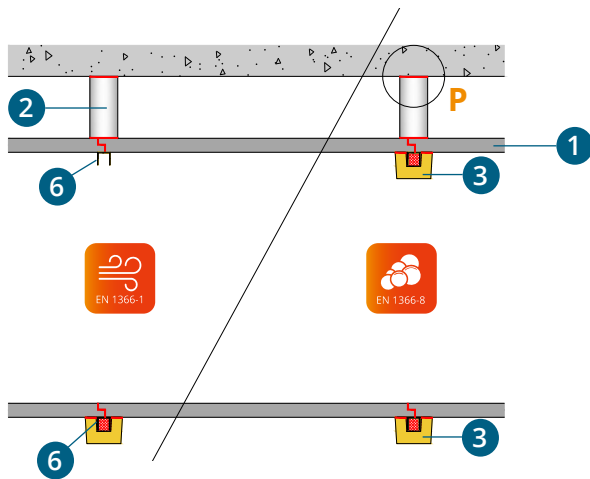

- 1 GEOTEC® S board
- 2 GEOTEC® A 1/2 shell
- 3 GEOTEC® A U-plaster element (appropriated according to supplier's certification)
- 4 Geocol® Glue
- 5 Threaded rod Ø10
- 6 Steel U profile (appropriated according to supplier's certification)
- 7 Brass anchor Ø10
- 8 Galvanized washers Ø10
- 9 Galvanized nuts Ø10
- 10 VBA Screws Ø 5 x 80 (EI 30/60) / Ø 5 x 90 (EI 90/120)

**1250 < w ≤ 2500 mm**  
**EI 30 / 60 (S) and EI 90 / 120 (S)**


Extension 17/7 on EFR-16-002202  
 Extension 17/6 on EFR-16-002203

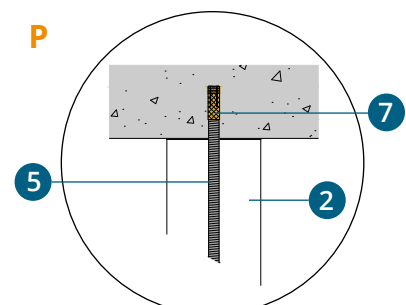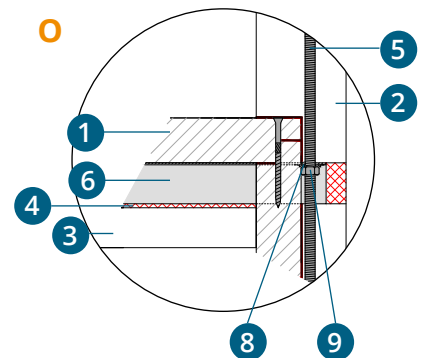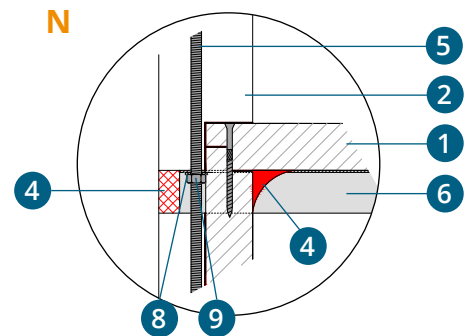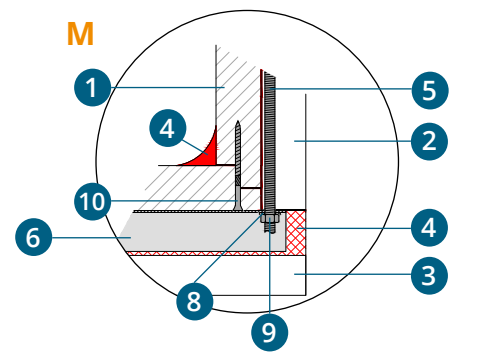


### B) Decrease of the duct overall dimension

If it is necessary to reduce the overall dimensions, it is possible, by positioning the threaded rods inside the ducts, to reduce the external width of the ducts (10 cm).

#### Front view: small section

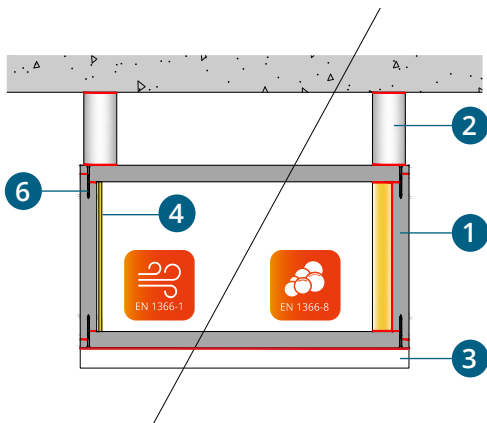

#### Side view: large section

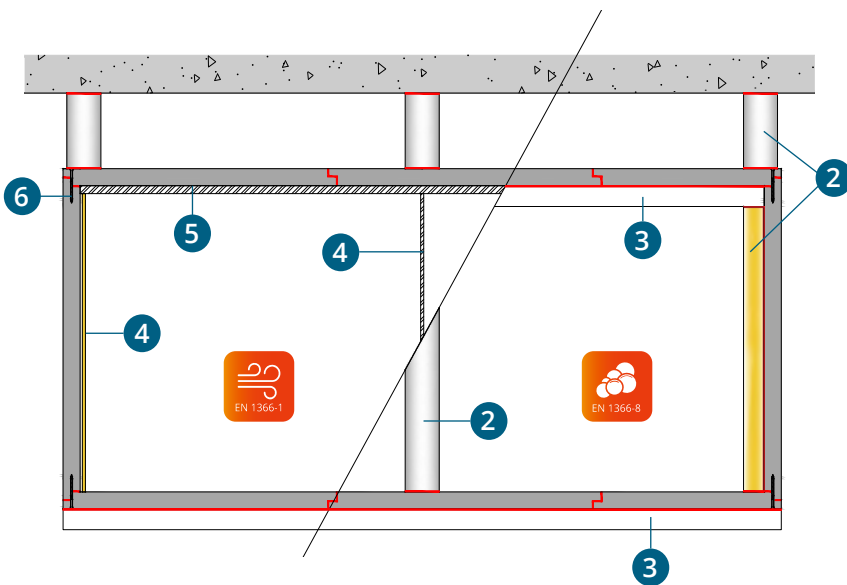

**0x0 mm to 2500x1500 mm**  
**EI 30 / 60 (S) and EI 90 / 120 (S)**

Extension 17/7 on EFR-16-002202  
 Extension 17/6 on EFR-16-002203


- 1 GEOTEC® S board
- 2 GEOTEC® A 1/2 shell
- 3 GEOTEC® A U-plaster element
- 4 Threaded rod
- 5 Steel U profile
- 6 VBA Screws  
 $\varnothing 5 \times 80$  (EI 30/60 S)  
 $\varnothing 5 \times 90$  (EI 90/120 S)

\*staples :  
 $\leq 1250 \times 1000$  mm (w x h) EI 30/60/90 S.

## C) Duct adjoining a vertical wall

In this case, on the vertical wall side, **the lower and upper steel U-profiles** of the duct must be fixed to the wall by using **Ø 8 brass anchors**. On the free side, the support will be made in a standard way.

### Front view


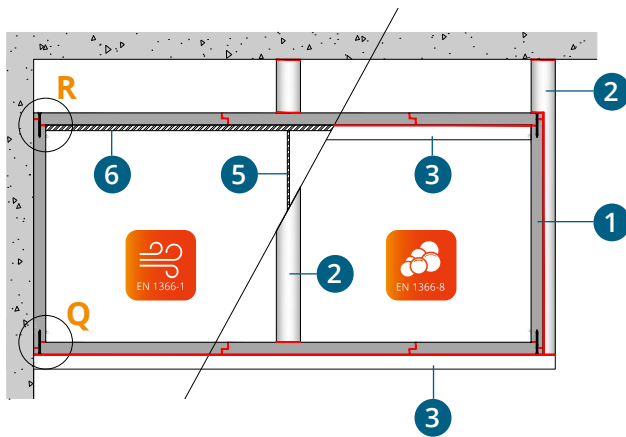


- 1 GEOTEC®S board
- 2 GEOTEC®A 1/2 shell
- 3 GEOTEC®A U-plaster element
- 4 Geocol® Glue
- 5 Threaded rod
- 6 Steel U profile
- 7 Brass anchor
- 8 Galvanized washers
- 9 Galvanized nuts
- 10 VBA Screws  
 $\text{Ø } 5 \times 80$  (EI 30/60)  
 $\text{Ø } 5 \times 90$  (EI 90/120)  
 or galvanized steel staples\*  
 $75 \times 10 \times 2 \text{ mm}$

\*staples :  
 $\leq 1250 \times 1000 \text{ mm}$  (w x h) EI 30/60/90 S.

**0x0 mm to 2500x1500 mm**  
**EI 30 / 60 (S) and EI 90 / 120 (S)**

Extension 17/7 on EFR-16-002202  
 Extension 17/6 on EFR-16-002203

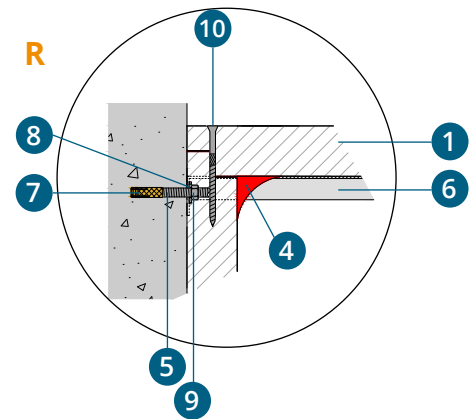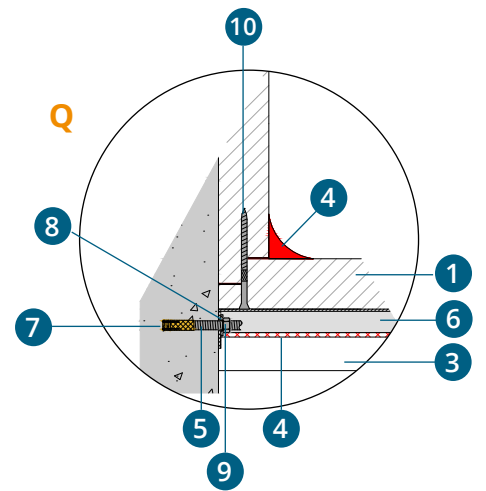


### D) Installation of the duct on a bracket


When the duct is installed on a vertical wall, the support can be made by using **metal brackets**, with or without struts (appropriate according to the supplier's certification).  
Metal brackets and strut must be thermally protected against fire using **GEOTEC® A U-plaster element**.

#### 1- INSTALL THE BRACKETS AND THE SUPPORT STRUT.

##### Longitudinal view

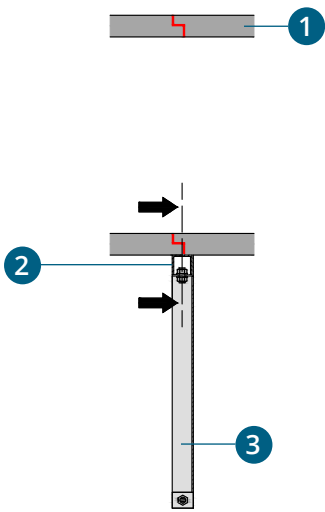

##### Cross-sectional view

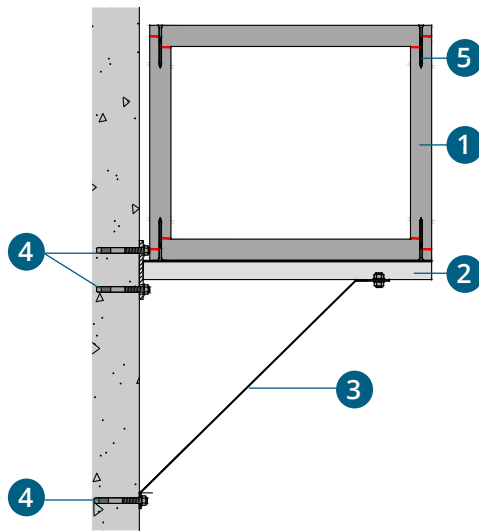

**0x0 mm to 2500x1500 mm**  
**EI 30 / 60 (S) and EI 90 / 120 (S)**


Extension 17/7 on EFR-16-002202  
Extension 17/6 on EFR-16-002203

- 1 GEOTEC® S board
- 2 Metal bracket
- 3 Load strut
- 4 Expansion anchors
- 5 VBA Screws  
Ø 5 x 80 (EI 30/60)  
Ø 5 x 90 (EI 90/120)  
or galvanized steel staples\*  
75 x 10 x 2 mm
- 6 Geocol® Glue
- 7 GEOTEC® A Uplaster element


\*staples :  
≤ 1250 x 1000 mm (w x h) EI 30/60/90 S.

#### 2- PROTECT THE BRACKETS AND THE STRUT WITH GEOTEC® A U-PLASTERS ELEMENT.

##### Longitudinal view

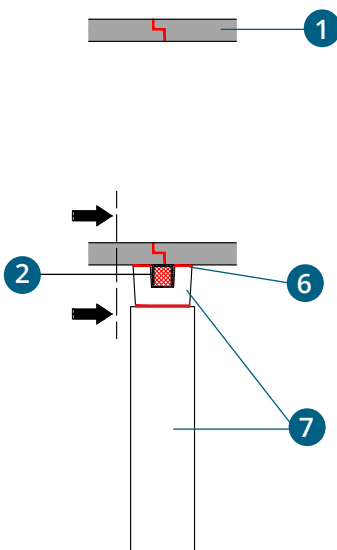

##### Cross-sectional view

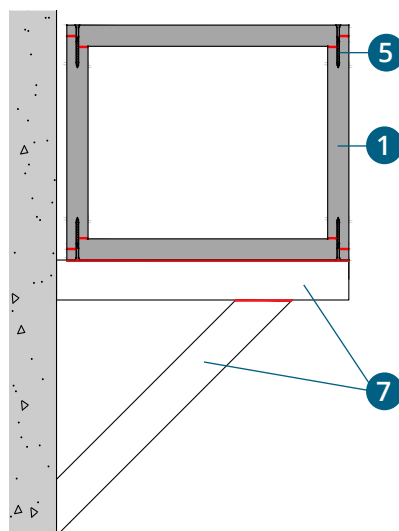


## E) Non protection of the supports


In the case of ventilation ducts with a **inner width ( $W_{int}$ ) of  $\leq 600$  mm** and a **inner perimeter ( $P_{int}$ ) of  $\leq 1900$  mm**, it is allowed to remove GEOTEC® A half-shells and GEOTEC® A U-plaster element.

For this purpose, the **steel U-profiles 41x21 must be replaced by 41x41** and the  **$\varnothing 8$  threaded rods must be replaced by  $\varnothing 12$  or  $\varnothing 14$  rods** (depending on the cross-section and the desired fire resistance). Attention, in this case, the anchors used are steel anchors.

### Front view

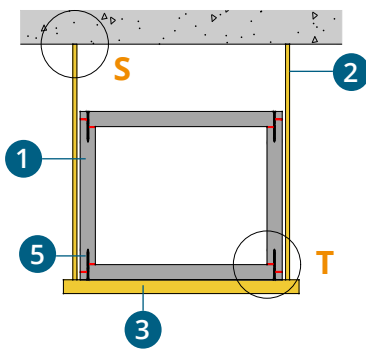


### Side view

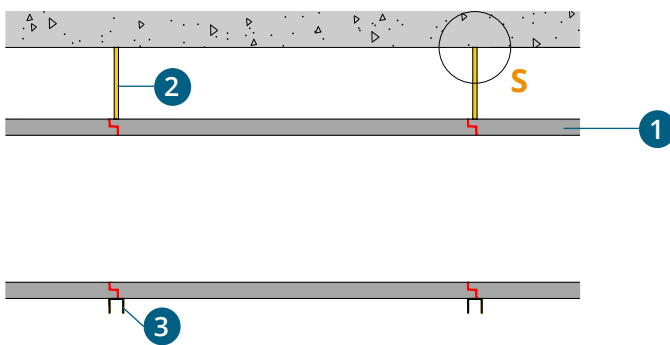


## $W_{int} \leq 600$ mm & $P_{int} \leq 1900$ mm EI 30 / 60 (S) and EI 90 / 120 (S)

Extension 19/13 on EFR-16-002202

S

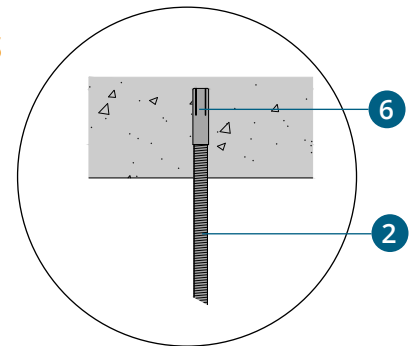

T

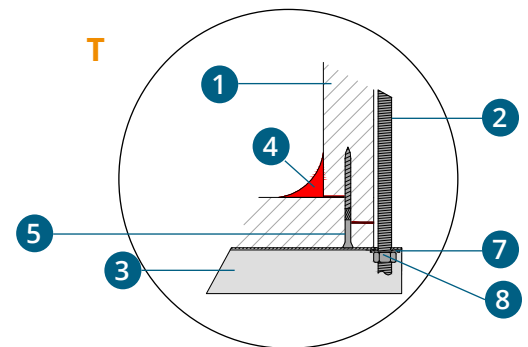


- 1 GEOTEC® S board
- 2 Threaded rod  $\varnothing 12$  or  $\varnothing 14$
- 3 Steel U profile 41x41
- 4 Geocol® Glue
- 5 VBA Screws  
 $\varnothing 5 \times 80$  (EI 30/60)  
 $\varnothing 5 \times 90$  (EI 90/120)  
or galvanized steel staples\* 75 x 10 x 2 mm
- 6 Steel anchor  $\varnothing 12$  or  $\varnothing 14$
- 7 Galvanized washers  $\varnothing 12$  or  $\varnothing 14$
- 8 Galvanized nuts  $\varnothing 12$  or  $\varnothing 14$


### 2.4. Alternatives for the protection of the suspension system

With the constant aim of making it easier to install GEOTEC® S ducts, extensions 18/8 and 18/9 of assessments EFR-16-002202 and EFR-16-002203 have been validated to offer an alternative to the protection of threaded rods and steel U-sections.

The **GEOTEC®A** 1/2 shells used to protect the threaded rods may therefore be replaced by a protection in the form of GEOTEC®S boards or GEOTEC®A U-plaster element normally used to protect the steel U-sections.

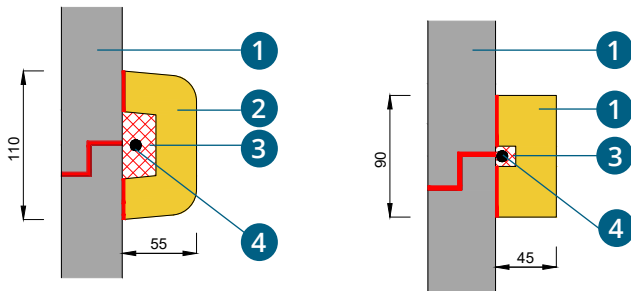

The **GEOTEC®A** U-plaster element used for protecting the steel U-sections may thus be replaced by a protection in the form of GEOTEC®S boards.

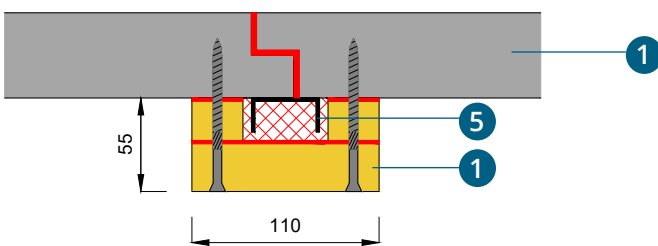

**0x0 mm to 2500x1500 mm**  
**EI 30 / 60 (S) and EI 90 / 120 (S)**

Extension 18/8 on EFR-16-002202  
 Extension 18/9 on EFR-16-002203

- 1 GEOTEC®S board
- 2 GEOTEC®A U-plaster element
- 3 Geocol® Glue
- 4 Threaded rod  $\varnothing 8$
- 5 Steel U profile


## 2.5. Wall penetrations

### A) Solid wall

#### 1. CONTINUOUS DUCT


Method of caulking horizontal ducts through vertical walls :

##### Top view

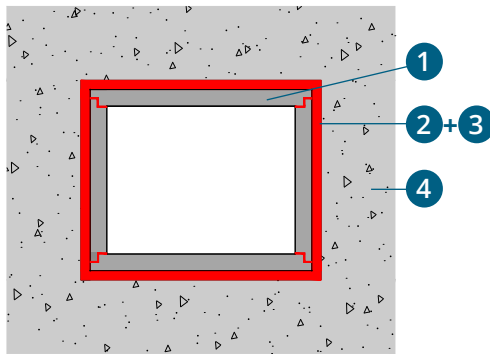

+ \* Caulking may be carried out using fire-stop polyurethane foam or stone wool (26 kg/m<sup>3</sup> minimum).

##### Side view

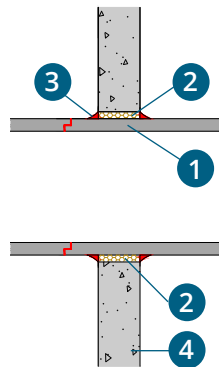


- 1 GEOTEC® S board
- 2 Caulking\* (max 25 mm)
- 3 Geocol® Glue
- 4 Concrete wall
- 5 GEOTEC® A Batten
- 6 VBA Screws  
 $\varnothing 5 \times 80$  (EI 30/60)  
 $\varnothing 5 \times 90$  (EI 90/120)  
 or galvanized steel staples\*  
 $75 \times 10 \times 2$  mm

\*staples :  
 $\leq 1250 \times 1000$  mm (w x h) EI 30/60/90 S.


#### 2. NON-TRAVERSING HORIZONTAL DUCT

Method of caulking a non-traversing horizontal duct :

##### Top view

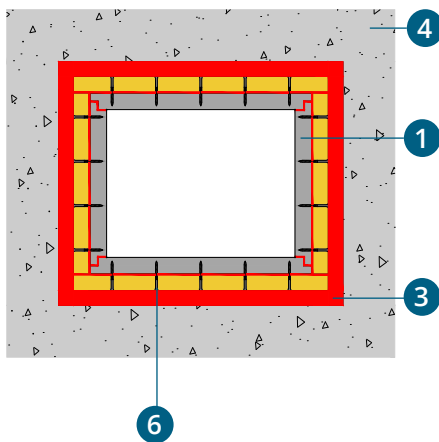

##### Side view

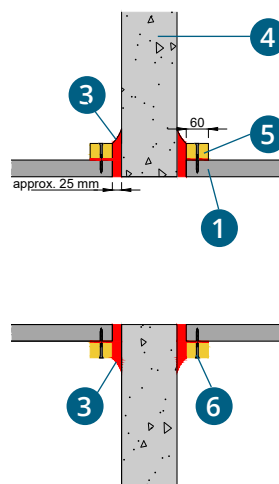


### 2.5. Wall penetrations



#### B) Flexible wall

##### THROUGHOUT OF LIGHTWEIGHT PLASTERBOARD PARTITION

##### Top view

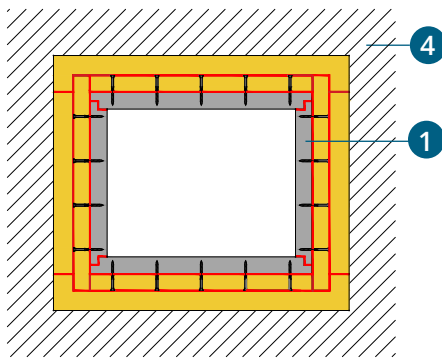

##### Side view

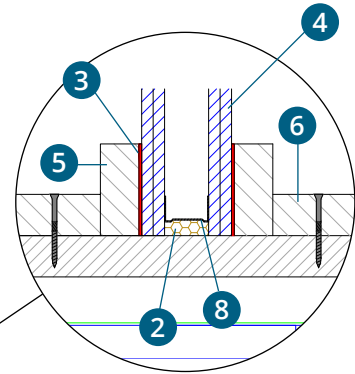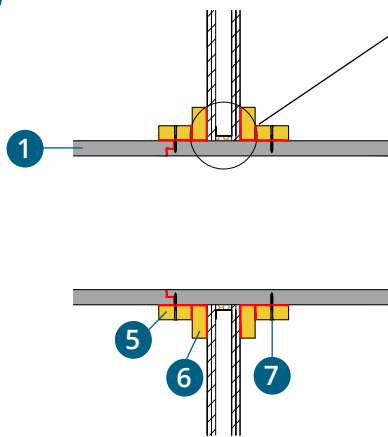

+ \* Caulking may be carried out using fire-stop polyurethane foam or stone wool (26 kg/m<sup>3</sup> minimum).


- 1 GEOTEC® S board
- 2 Caulking\* (max. 25 mm)
- 3 Geocol® Glue
- 4 Fire resistant lightweight partition
- 5 GEOTEC® A Batten
- 6 GEOTEC® A Batten (against the lightweight partition)
- 7 VBA Screws  
Ø 5 x 80 (EI 30/60)  
Ø 5 x 90 (EI 90/120)  
or galvanized steel staples\*  
75 x 10 x 2 mm
- 8 Rail

\*staples :  
≤ 1250 x 1000 mm (w x h) EI 30/60/90 S.

### 2.6. Dilation joints

#### Treatment of the crossing of an expansion joint

In the construction of a building, expansion joints must be envisaged in accordance with pre-established rules. It is therefore common for horizontal ducts to pass through expansion joints. It is then necessary to carry out a specific treatment.

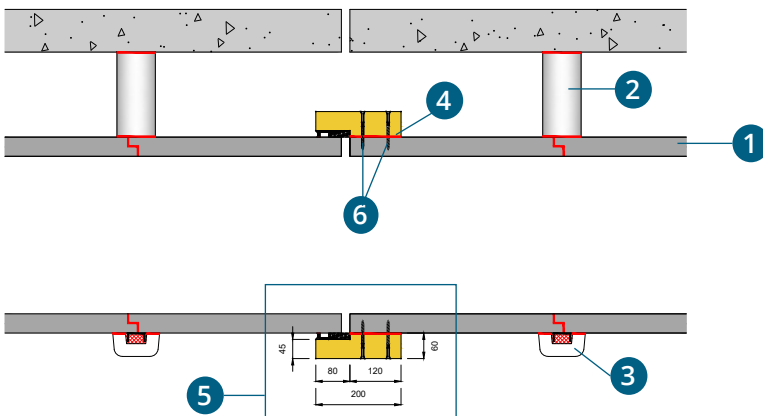

- 1 GEOTEC® S board
- 2 GEOTEC® A 1/2 shell
- 3 GEOTEC® A U-plaster element
- 4 Geocol® Glue
- 5 GEOTEC® A Expansion joint element\*
- 6 VBA Screws  
Ø 5 x 80 (EI 30/60 S)  
Ø 5 x 90 (EI 90/120 S)  
or galvanized steel staples\*  
75 x 10 x 2 mm

\*staples :  
≤ 1250 x 1000 mm (w x h) EI 30/60/90 S.


\* Technical datasheet of  
Expansion joint element page 23




## 2.7. Protection of steel ducts

The GEOTEC® product range also allows the protection of existing steel ventilation ducts by directly applying GEOTEC®S boards around the duct. These existing ventilation ducts may be made of galvanised or stainless sheet steel and must have their own support system.

### Front view

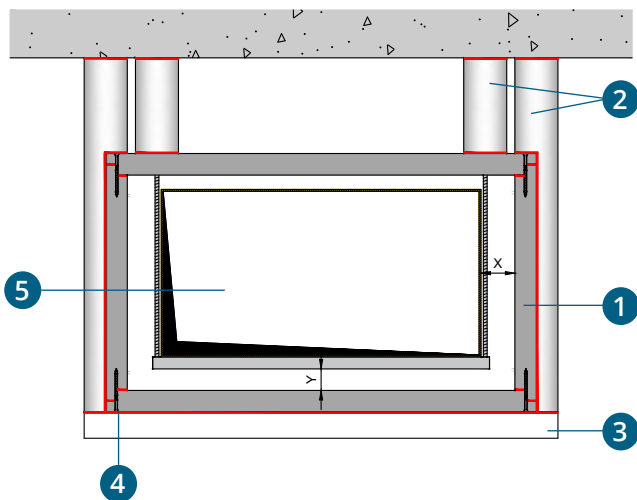

### Side view

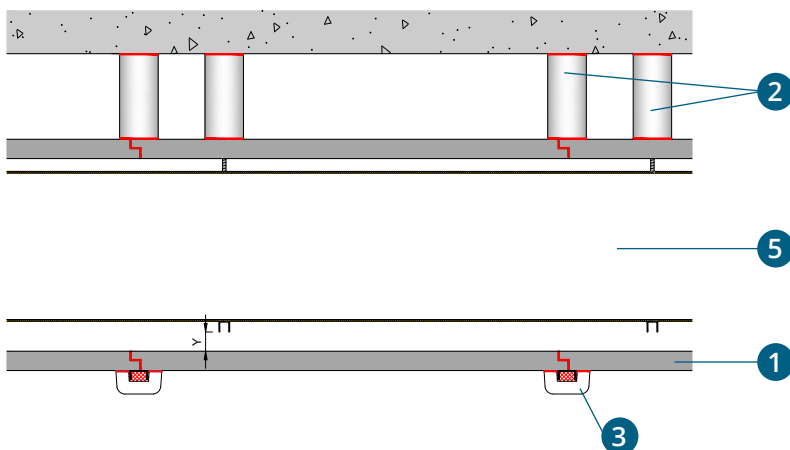

**Dimensions max**  
**2500x1500 mm**  
**EI 30 / 60 (S) and EI 90 / 120 (S)**

Extension 16/3 on EFR-16-002202  
 and EFR-16-002204

- 1 GEOTEC®S board
- 2 GEOTEC®A 1/2 shell + threaded rod
- 3 GEOTEC®A U-plaster element + Steel U-profile
- 4 VBA Screws  
 $\varnothing 5 \times 80$  (EI 30/60 S)  
 $\varnothing 5 \times 90$  (EI 90/120 S)  
 or galvanized steel staples\*  
 $75 \times 10 \times 2$  mm
- 5 Steel ventilation duct (must have its own supporting system)

\*staples :  
 $\leq 1250 \times 1000$  mm (w x h) EI 30/60/90 S.

Transverse expansions:  
**x : in width**  
**y : in height**  
 A minimum gap (see x and y) of 19 mm/m must be maintained between the inner metal duct and the GEOTEC® ventilation duct.

### 2.8. Various configurations



**Change of cross-section**



**Corner connection**



**Take-off point on horizontal duct**



**Sloping**



**Floor installation  $\leq 600$  mm**



**Floor installation Large section**



### 3. VERTICAL SYSTEM

#### 3.1. Assembly principle

The boards are assembled using VBA screws or staples. Screws are inserted without pilot holes. All joints are previously treated with GEOCOL® glue.

When constructing vertical ducts, the board joints are offset between 2 contiguous faces (between 200 and 800 mm) so as to achieve optimal mechanical strength for the duct.

#### Cross-sectional view

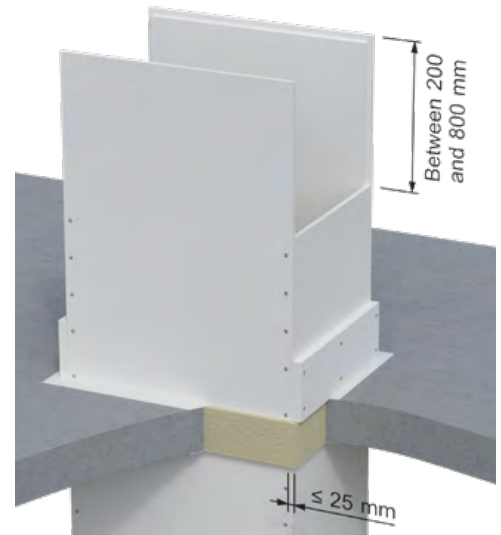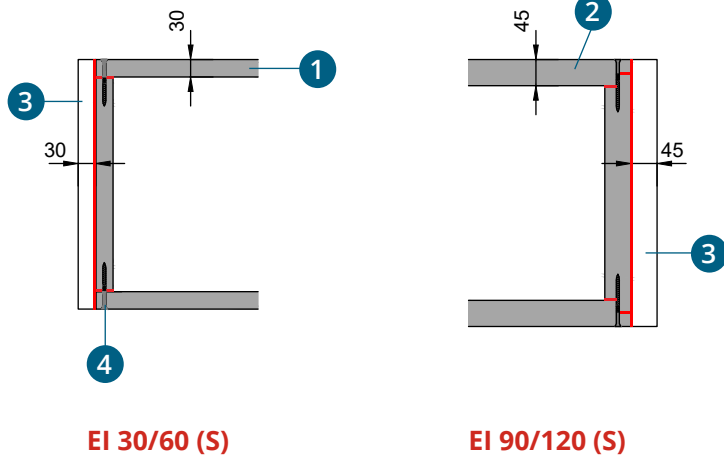



- 1 GEOTEC® S30 board
- 2 GEOTEC® S45 board
- 3 GEOTEC® A Reinforcement collar
- 4 VBA Screws  
 Ø 5 x 80 (EI 30/60 S)  
 Ø 5 x 90 (EI 90/120 S)  
 or galvanized steel staples\*  
 75 x 10 x 2 mm

\*staples :  
 ≤ 1250 x 1000 mm (w x h) EI 30/60/90 S.

#### 1. Concerning the load-bearing systems

For ducts consisting of 4-board casings ( $W_{int} \leq 1050$  mm and  $D_{int} \leq 1100$  mm for EI 30/60 S and  $W_{int} \leq 1000$  mm and  $D_{int} \leq 1050$  mm for EI 90/120 S), the load bearing system can be carried out on 2 sides only.


In the case of large cross-sections ducts, the number of boards per duct face increases to up to 4. In this case, load bearing system must be carried out on faces consisting of more than 2 boards.

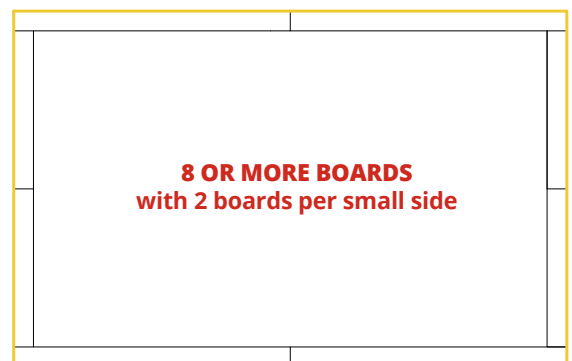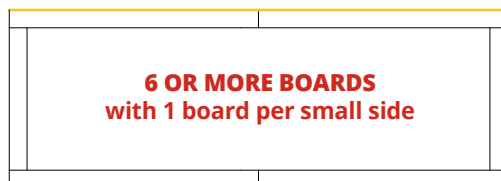

\*W int : inner Width / \*D int : inner Depth

### 2. Duct adjoining the slab

#### Cross-sectional view

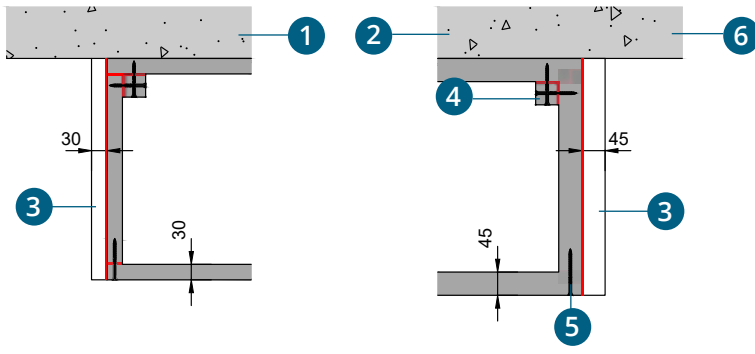

EI 30/60 (S)

EI 90/120 (S)

- 1 GEOTEC® S30 board
- 2 GEOTEC® S45 board
- 3 GEOTEC®A Reinforcement collar
- 4 GEOTEC®A Batten
- 5 VBA Screws  
 $\varnothing 5 \times 80$  (EI 30/60 S)  
 $\varnothing 5 \times 90$  (EI 90/120 S)  
 or galvanized steel staples\*  
 $75 \times 10 \times 2$  mm
- 6 Concrete wall


\*staples :  
 $\leq 1250 \times 1000$  mm (w x h) EI 30/60/90 S.

### 3.2. Installation instructions


Internal Duct Width & Depth	Ventilation duct EN 1366-1	Smoke extraction duct EN 1366-8	Page
<p><b>EI 60:</b> Width <math>\leq 1050</math> mm &amp; internal depth <math>\leq 1100</math> mm and</p> <p><b>EI 120:</b> Width <math>\leq 1000</math> mm &amp; internal depth <math>\leq 1050</math> mm</p>	Standard Installation.		<b>70</b>
<p><b>EI 60:</b> Width <math>&gt; 1050</math> mm &amp; internal depth <math>\leq 1100</math> mm and</p> <p><b>EI 120:</b> Width <math>&gt; 1000</math> mm &amp; internal depth <math>\leq 1050</math> mm</p>	<b>Solution 1:</b> Using GEOTEC® A Cover strip.		<b>71</b>
	<b>Solution 2:</b> Using GEOTEC® A internal reinforcement collar.		<b>72</b>
<p><b>EI 60:</b> Width <math>&gt; 1050</math> mm &amp; internal depth <math>&gt; 1100</math> mm and</p> <p><b>EI 120:</b> Width <math>&gt; 1000</math> mm &amp; internal depth <math>&gt; 1050</math> mm</p>	<b>Solution 1:</b> Using GEOTEC® A Cover strip.		<b>73</b>
	<b>Solution 2:</b> Using GEOTEC® A internal reinforcement collar.		<b>74</b>

## Standard installation principle


**CLICK and watch**  
**THE VERTICAL DUCT ASSEMBLY on video.**

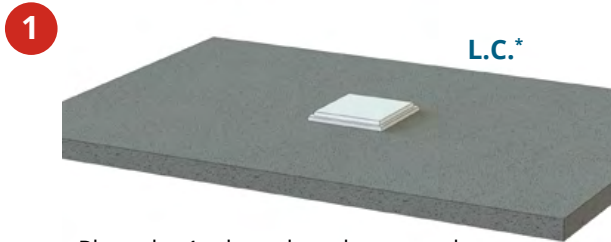


- Place the 1st board on the ground

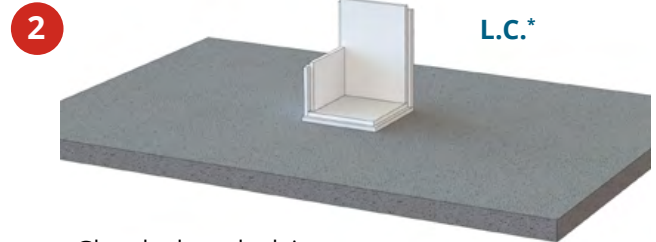



- Glue the board edgings
- Screw the 2 contiguous boards with woodscrews every 120 mm
- Observe an offset of 200 to 800 mm between the horizontal joints

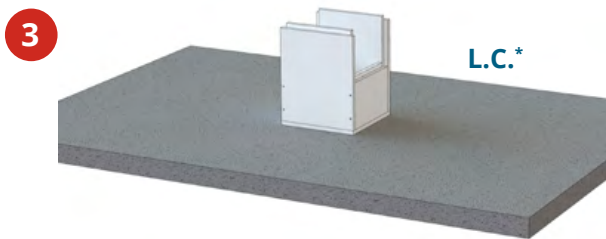

- Glue the board edgings
- Place the other 2 vertical boards forming the 1st chamber
- Screw the boards together with woodscrews every 120 mm

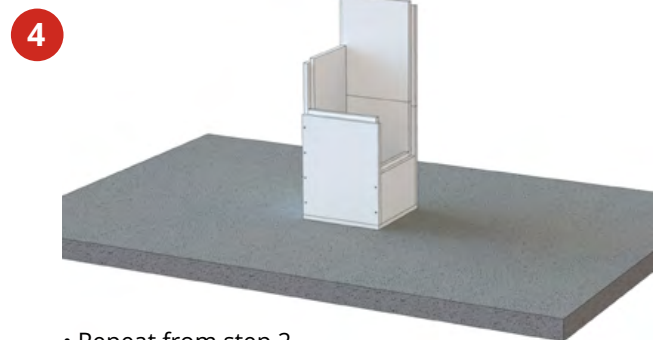

- Repeat from step 2
- Glue and fit together with the previous sections

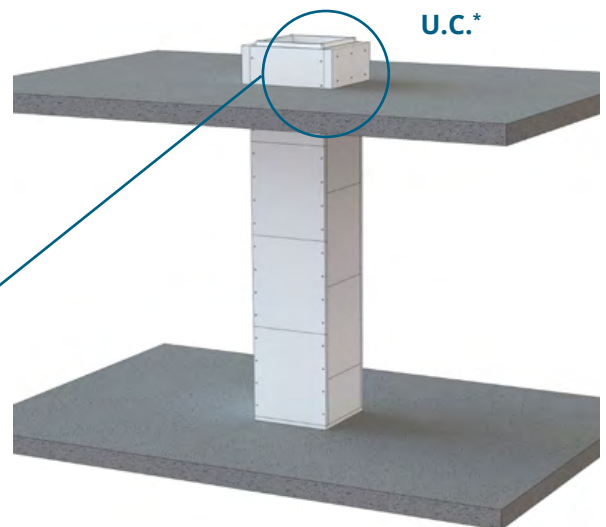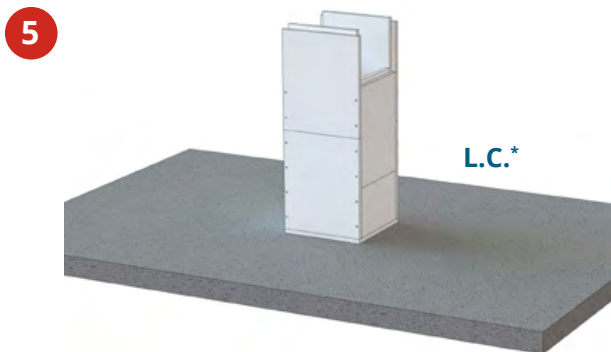


- Use glue and screws to place the reinforcement collars on 2 sides of the duct (bearing on the floor). (Height limited to 7 m with 2 supports, and to 10 m with 3)\*

\*L.C.: Lower ceiling - U.C.: Upper ceiling


**EI 60:  $W_{int}^* \leq 1050 \text{ mm}$  &  $D_{int}^* \leq 1100 \text{ mm}$**   
**(or  $W_{int} \leq 1140 \text{ mm}$  &  $D_{int} \leq 1200 \text{ mm}$  if using GEOTEC® SX 30 Boards)**  
**& EI 120:  $W_{int} \leq 1000 \text{ mm}$  &  $D_{int} \leq 1050 \text{ mm}$**   
**(or  $W_{int} \leq 1100 \text{ mm}$  &  $D_{int} \leq 1200 \text{ mm}$  if using GEOTEC® SX 45 Boards)**

\* $W_{int}$ : internal width / \* $D_{int}$ : internal depth

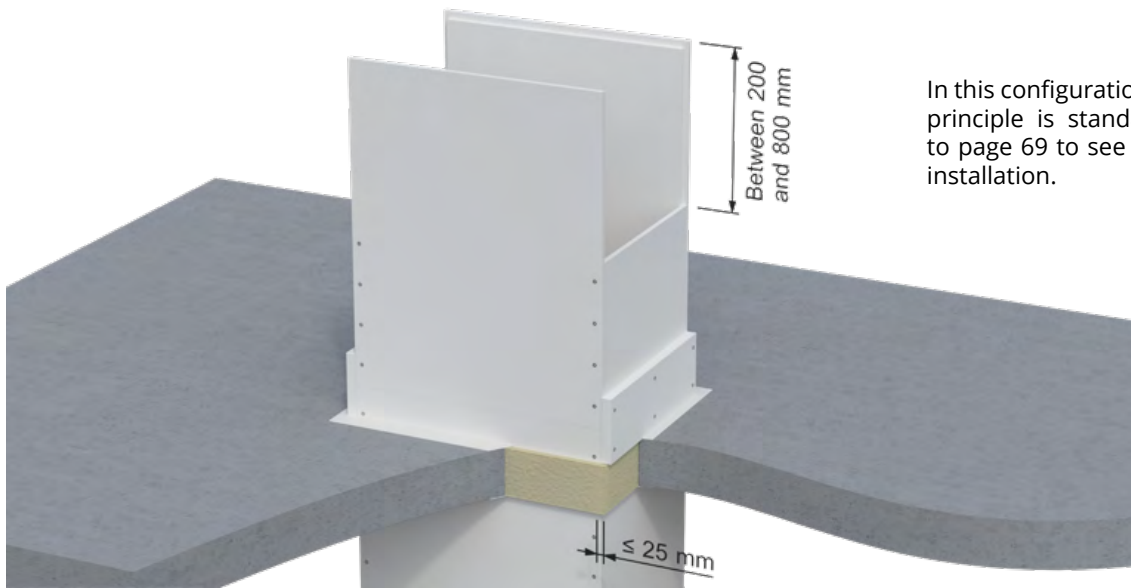

In this configuration, the installation principle is standard, please refer to page 69 to see the details of the installation.

### Cross-sectional view

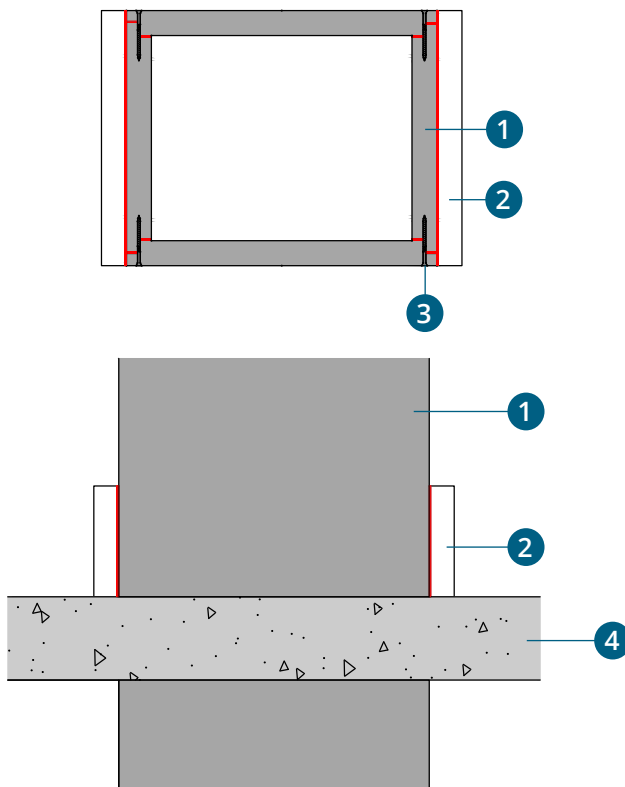


- 1 GEOTEC® S board
- 2 GEOTEC® A Reinforcement collar
- 3 VBA Screws  
 $\varnothing 5 \times 80$  (EI 30/60 S)  
 $\varnothing 5 \times 90$  (EI 90/120 S)  
 or galvanized steel staples\*  
 $75 \times 10 \times 2 \text{ mm}$
- 4 Concrete slab

\*staples:  
 $\leq 1250 \times 1000 \text{ mm}$  (w x h) EI 30/60/90 S.


**EI 60:  $W_{int}^* > 1050 \text{ mm}$  &  $D_{int}^* \leq 1100 \text{ mm}$**   
**& EI 120:  $W_{int} > 1000 \text{ mm}$  &  $D_{int} \leq 1050 \text{ mm}$**

\* $W_{int}$ : internal width / \* $D_{int}$ : internal depth

**Solution 1: using the GEOTEC® A Cover strip**

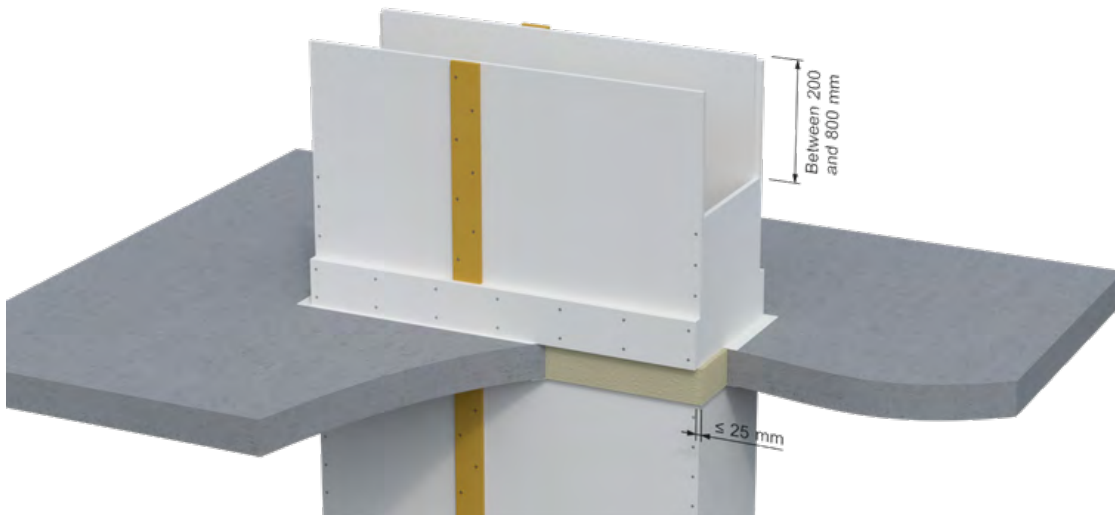

**Cross-sectional view**

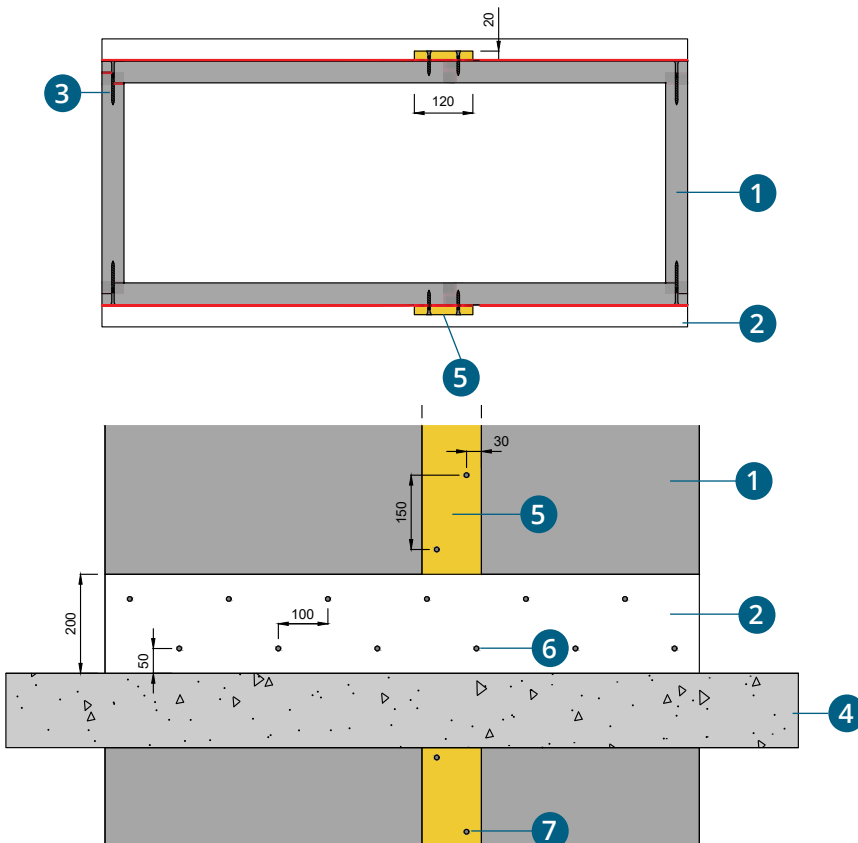


- 1 GEOTEC® S board
- 2 GEOTEC® A Reinforcement collar
- 3 VBA Screws  
 $\varnothing 5 \times 80$  (EI 30/60 S)  
 $\varnothing 5 \times 90$  (EI 90/120 S)  
 or galvanized steel staples\*  
 $75 \times 10 \times 2 \text{ mm}$
- 4 Concrete slab
- 5 GEOTEC® A Cover strip (exterior or interior)
- 6 VBA Screws  
 $\varnothing 5 \times 50$  (EI 30/60 S)  
 $\varnothing 5 \times 80$  (EI 90/120 S)
- 7 VBA Screws  
 $\varnothing 5 \times 50$  (EI 30/60/90/120 S)

\*staples :  
 $\leq 1250 \times 1000 \text{ mm}$  (w x h) EI 30/60/90 S.


**EI 60:  $W_{int}^* > 1050 \text{ mm}$  &  $D_{int}^* \leq 1100 \text{ mm}$**   
**& EI 120:  $W_{int} > 1000 \text{ mm}$  &  $D_{int} \leq 1050 \text{ mm}$**

\* $W_{int}$ : internal width / \* $D_{int}$ : internal depth

### Solution 2: using the GEOTEC® A internal reinforcement collar

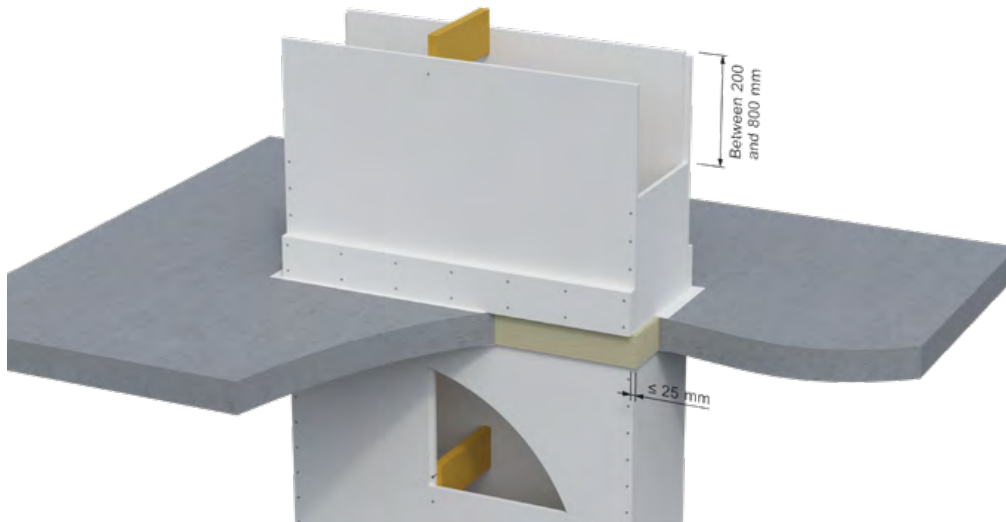


### Cross-sectional view

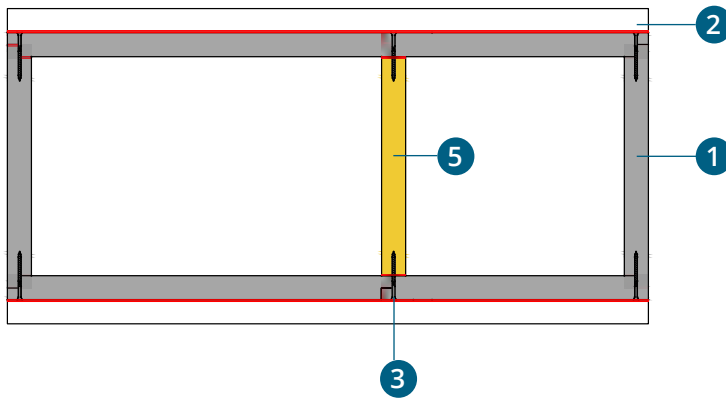

- 1 GEOTEC® S board
- 2 GEOTEC® A Reinforcement collar (load-bearing system)
- 3 VBA Screws  
 $\varnothing 5 \times 80$  (EI 30/60 S)  
 $\varnothing 5 \times 90$  (EI 90/120 S)  
 or galvanized steel staples\*  
 $75 \times 10 \times 2 \text{ mm}$
- 4 Concrete slab
- 5 GEOTEC® A Reinforcement collar  
 200 x duct thickness (every 1000 mm)
- 6 VBA Screws  
 $\varnothing 5 \times 50$  (EI 30/60 S)  
 $\varnothing 5 \times 80$  (EI 90/120 S)

\*staples :  
 $\leq 1250 \times 1000 \text{ mm}$  (w x h) EI 30/60/90 S.

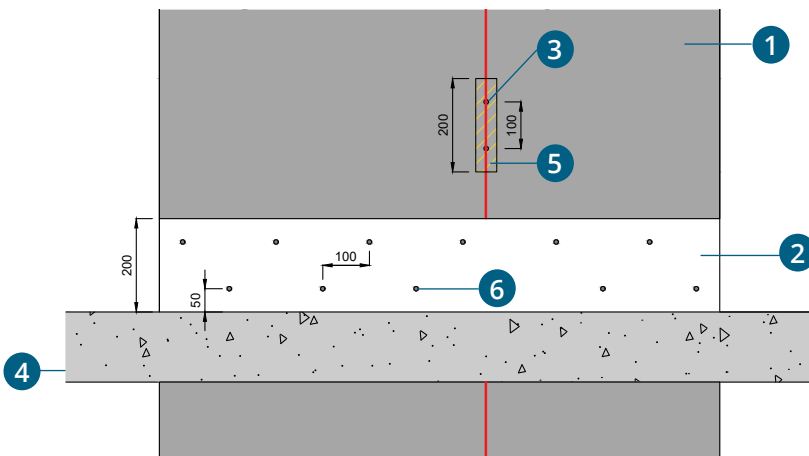




**EI 60:  $W_{int}^* > 1050 \text{ mm}$  &  $D_{int} > 1100 \text{ mm}$**   
**& EI 120:  $W_{int} > 1000 \text{ mm}$  &  $D_{int} > 1050 \text{ mm}$**

\* $W_{int}$  : internal width / \* $D_{int}$  : internal depth

**Solution 1: using the GEOTEC® A Cover strip**

**Cross-sectional view**

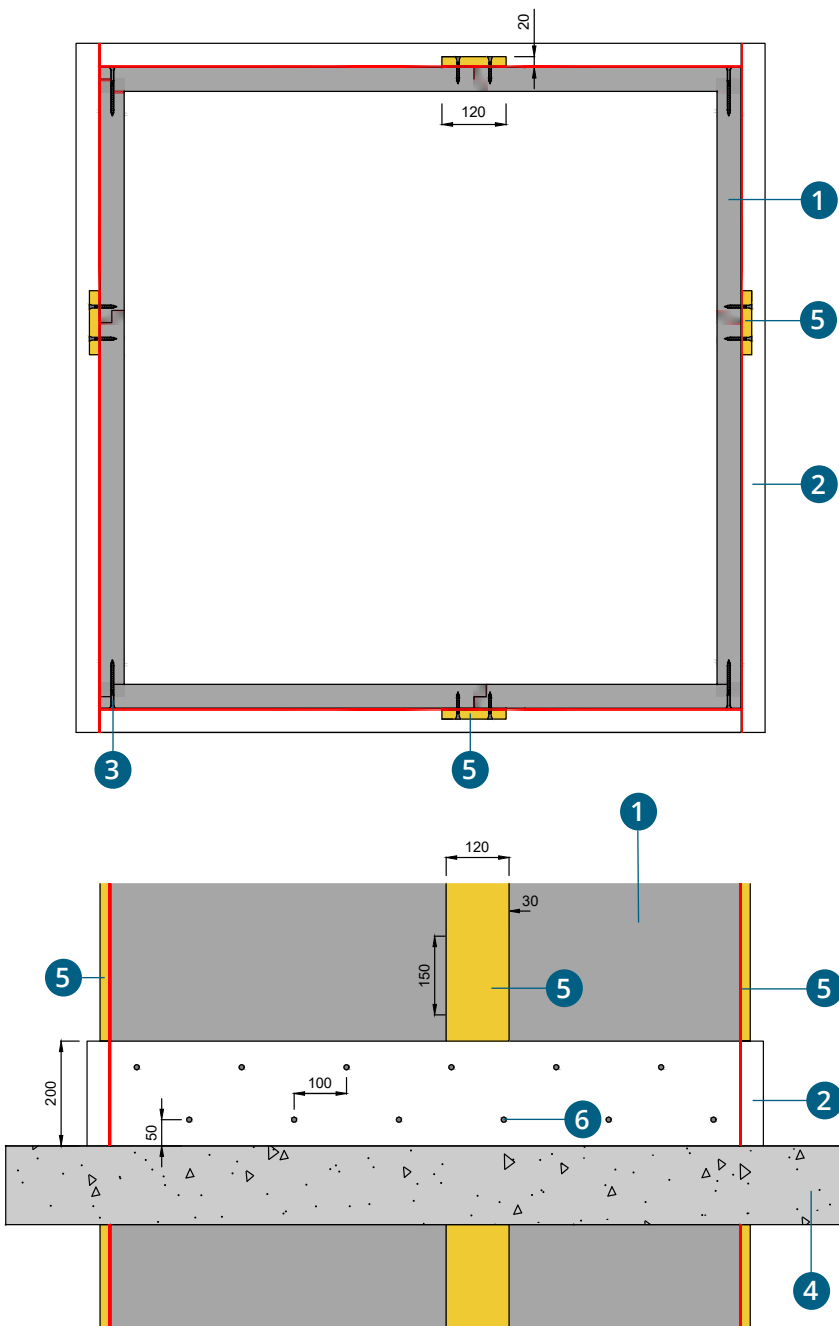


- 1 GEOTEC® S board
- 2 GEOTEC® A Reinforcement collar
- 3 VBA Screws  
 $\varnothing 5 \times 80$  (EI 30/60 S)  
 $\varnothing 5 \times 90$  (EI 90/120 S)
- 4 Concrete slab
- 5 GEOTEC® A Cover strip (exterior or interior)
- 6 VBA Screws  
 $\varnothing 5 \times 50$  (EI 30/60 S)  
 $\varnothing 5 \times 80$  (EI 90/120 S)
- 7 VBA Screws  
 $\varnothing 5 \times 50$  (EI 30/60/90/120 S)

**EI 60:  $W_{int}^* > 1050 \text{ mm}$  &  $D_{int} > 1100 \text{ mm}$**   
**& EI 120:  $W_{int} > 1000 \text{ mm}$  &  $D_{int} > 1050 \text{ mm}$**

\* $W_{int}$  : internal width / \* $D_{int}$  : internal depth

### Solution 2: using the GEOTEC® A internal Reinforcement collar

#### Cross-sectional view

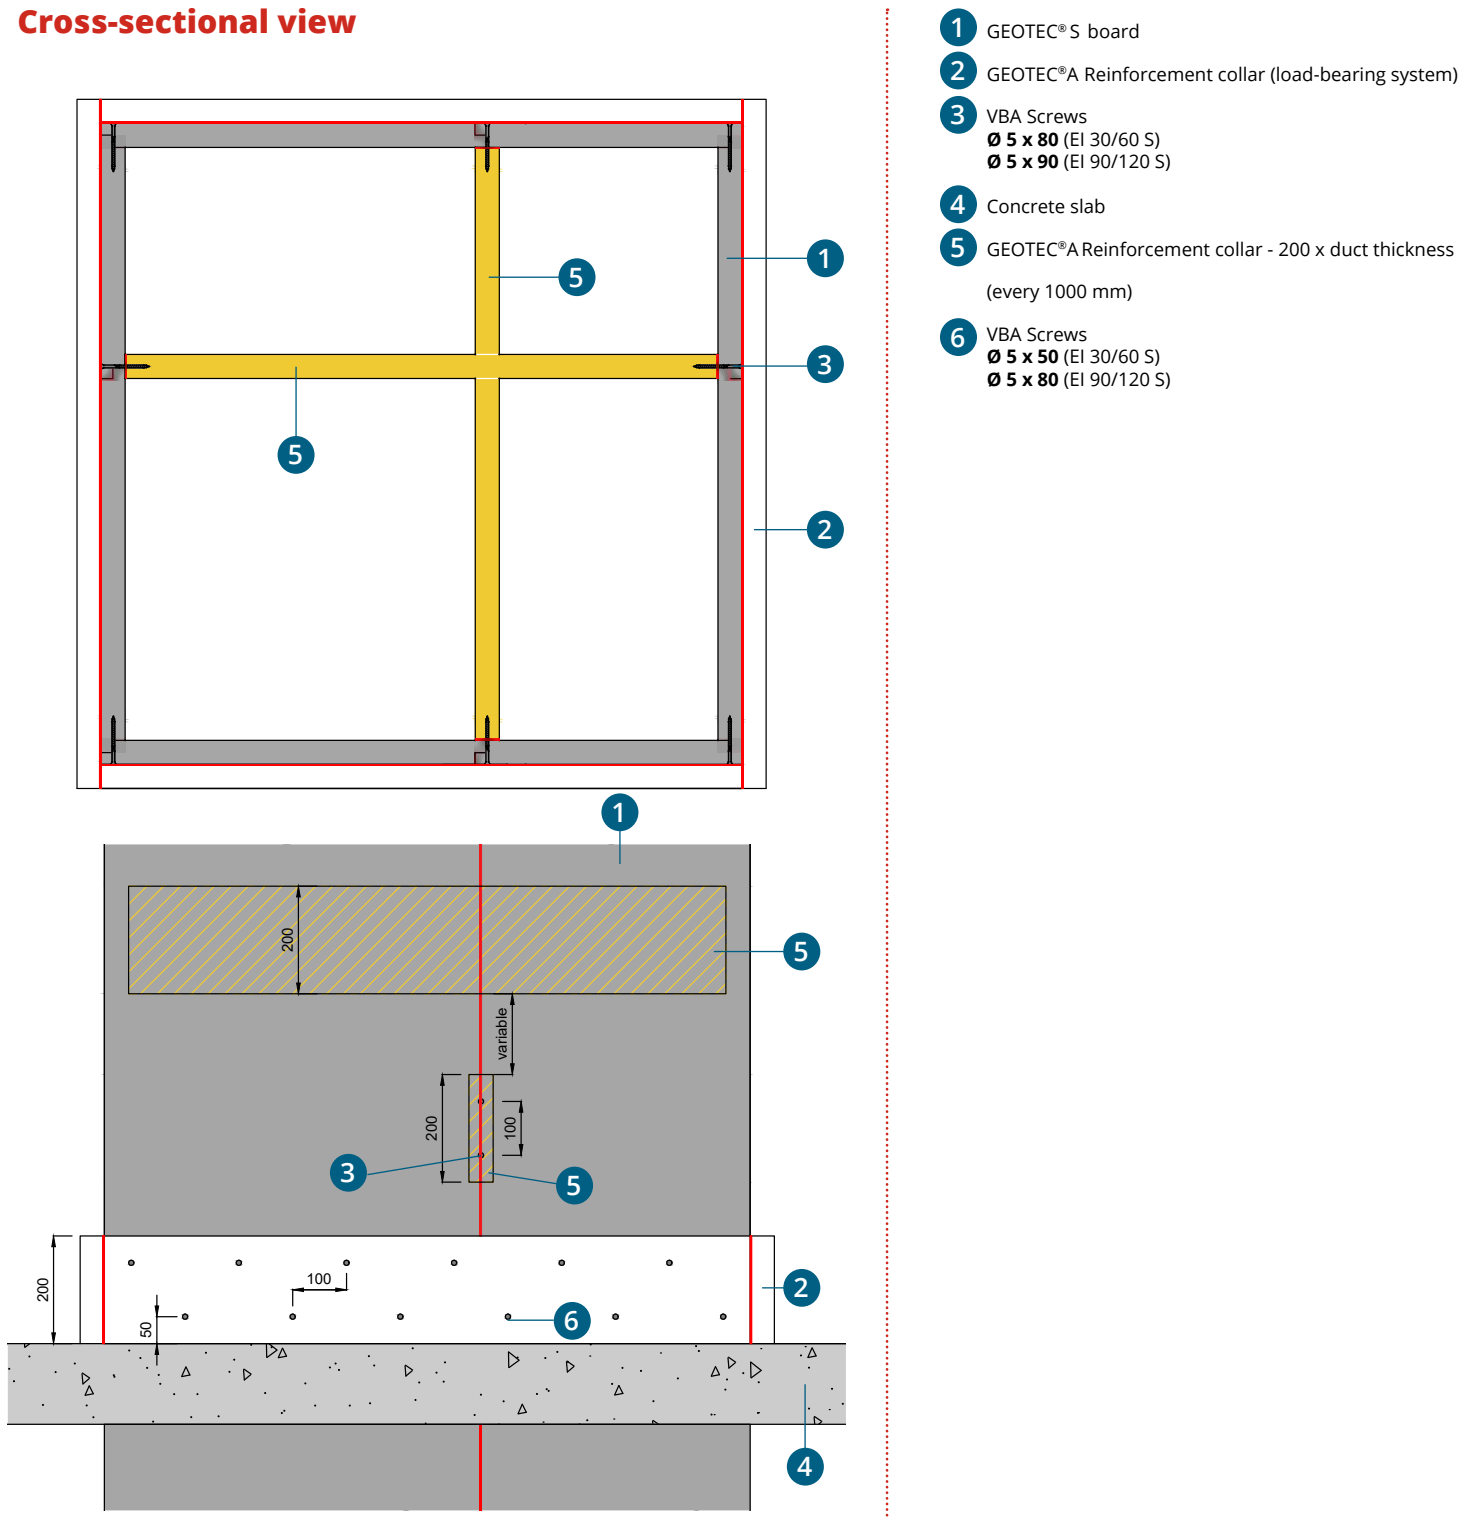

### 3.3. Alternative support principles


The various load bearing principles shown below are suitable for ducts consisting of 4-board casings (one board per side). In the case of large section ducts (more than 4 boards per casing), these alternative systems will have to be adapted (**see page 67**).

#### 1. Ducts not attached to walls



**A) Support by 2 parallel GEOTEC®A reinforcement collars on the floor.**

**B) Support by 2 parallel corner-pieces on the slab.**

**Top view**




**Side view**

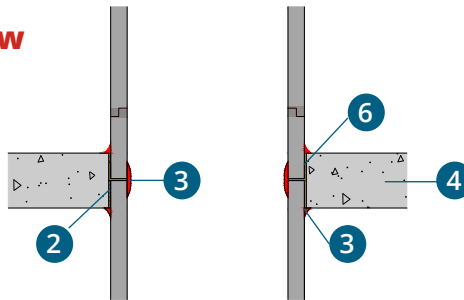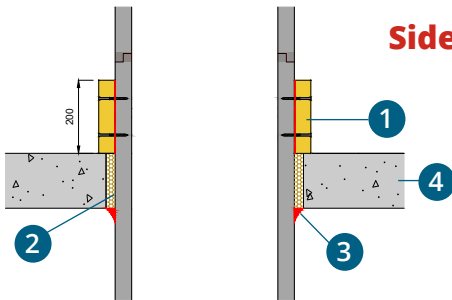



**C) Support by 1 GEOTEC®A reinforcement collar on floor + 1 parallel corner-piece on the slab.**

**D) Support by 2 double parallel GEOTEC®A reinforcement collars on the floor.**

**Top view**



**Side view**

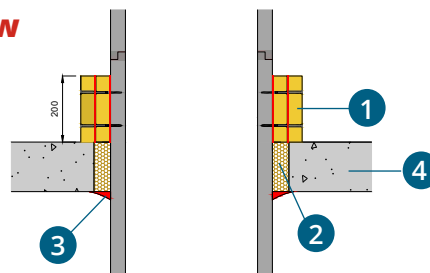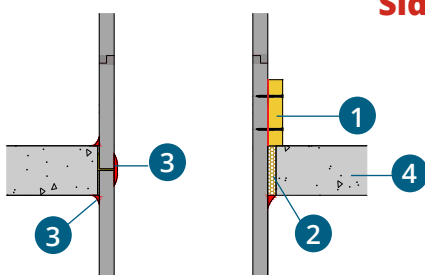

- 1 GEOTEC®A reinforcement collar (glued & screwed)
- 2 Caulking
- 3 GEOCOL® Glue
- 4 Floor
- 5 Screws
- 6 Corner-pieces:  
EI 30/60 (S): 35x35x4 mm.  
EI 90/120 (S): 50x50x5 mm.

- 1 GEOTEC®A reinforcement collar (glued & screwed)
- 2 Caulking
- 3 GEOCOL® Glue
- 4 Floor
- 5 Screws
- 6 Corner-pieces:  
EI 30/60 (S): 35x35x4 mm.  
EI 90/120 (S): 50x50x5 mm.



+ Height limited to 7 m with 2 supports, and to 10 m with 3 or 4 supports.

### 2. Ducts adjacent to a wall corner



**E) Support by 2 perpendicular GEOTEC®A reinforcement collars on the floor.**

**F) Support by 2 parallel corner-pieces on the slab and wall.**

**Top view**

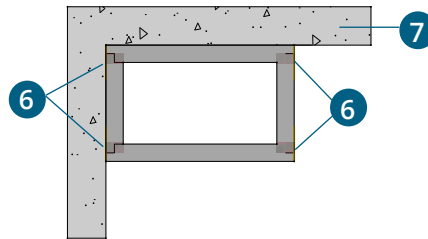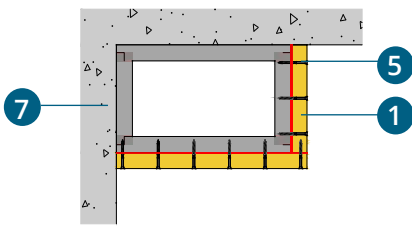



**Side view**

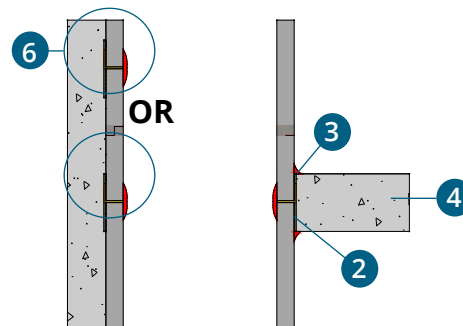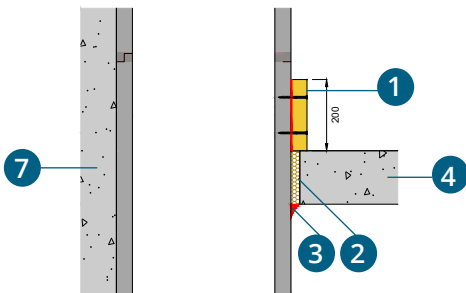



**G) Support by 2 perpendicular corner-pieces on the slab.**

**H) Support by 1 GEOTEC®A reinforcement collar on the floor + 1 corner-piece in parallel on the wall.**

**Top view**

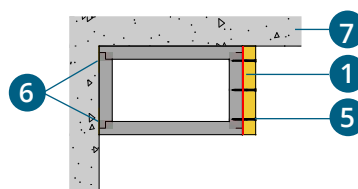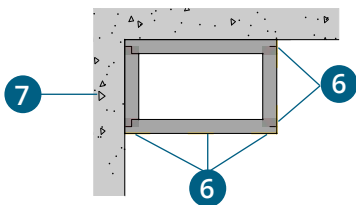

**Side view**

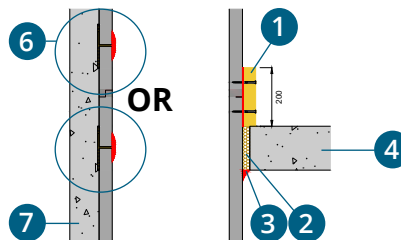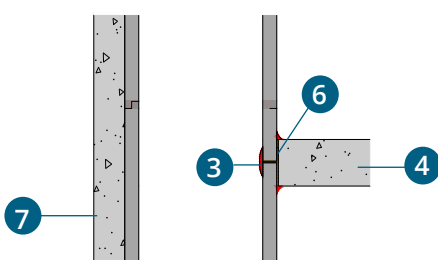


- 1 GEOTEC®A reinforcement collar (glued & screwed)
- 2 Caulking
- 3 GEOTEC® Glue
- 4 Floor
- 5 Screws
- 6 Corner-pieces:  
EI 30/60 (S): 35x35x4 mm.  
EI 90/120 (S): 50x50x5 mm.
- 7 Concrete wall

- 1 GEOTEC®A reinforcement collar (glued & screwed)
- 2 Caulking
- 3 GEOTEC® Glue
- 4 Floor
- 5 Screws
- 6 Corner-pieces:  
EI 30/60 (S): 35x35x4 mm.  
EI 90/120 (S): 50x50x5 mm.
- 7 Concrete wall


### 3. Ducts adjacent to the wall

I) Support by threaded rods anchored to the vertical wall and other parallel supports.

Top view

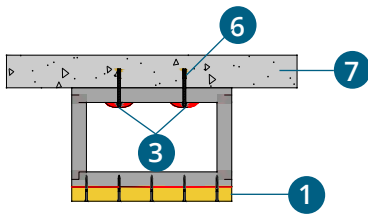

Side view

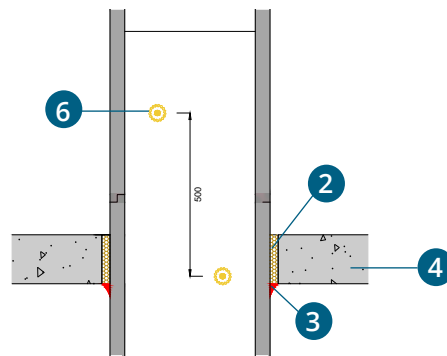


- 1 GEOTEC®A reinforcement collar (glued & screwed) or corner piece
- 2 Caulking
- 3 GEOCOL® Glue
- 4 Floor
- 5 Screws
- 6 Mechanical fixation
- 7 Concrete wall


### 4. Sub-floor level support

J) Support by 2 parallel GEOTEC®A reinforcement collars under the floor.

Top view

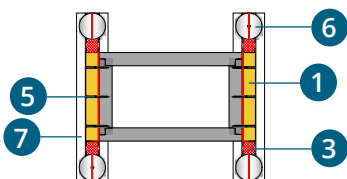

Side view

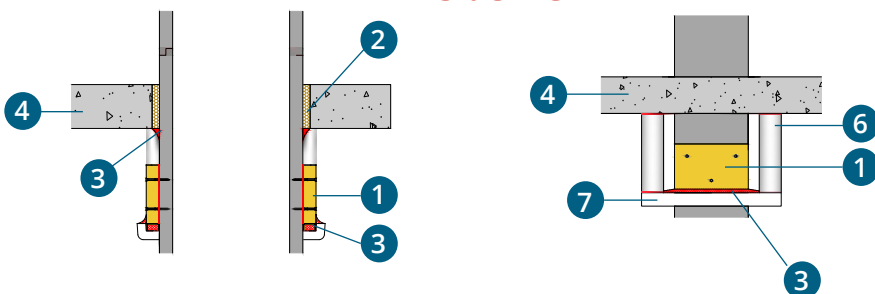

- 1 GEOTEC®A reinforcement collar (glued & screwed)
- 2 Caulking
- 3 GEOCOL® Glue
- 4 Floor
- 5 Screws
- 6 GEOTEC®A Half shells + Ø8 threaded rods
- 7 GEOTEC®A U-plaster element + Steel U-profile 41x21



### 5. Console supported ducts

**K) Support by 2 parallel GEOTEC®A reinforcement collars on brackets fixed in the vertical wall.**



**L) Support by 2 perpendicular GEOTEC®A reinforcement collars on brackets fixed in the vertical wall.**

- 1 GEOTEC®A reinforcement collar (glued & screwed) placed on brackets
- 2 GEOCOL® Glue
- 3 Screws
- 4 Protected appropriate brackets
- 5 Concrete wall

**Top view**

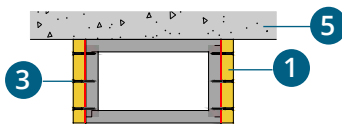


**Side view**

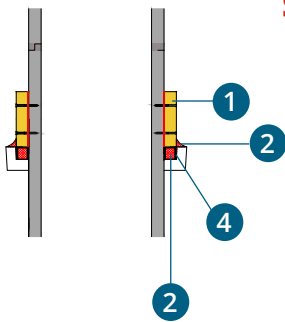


## 3.4. Floor penetrations

### 1. Method of caulking a continuous vertical duct

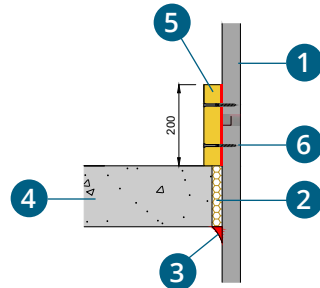

### 2. Method of caulking a non-traversing vertical duct

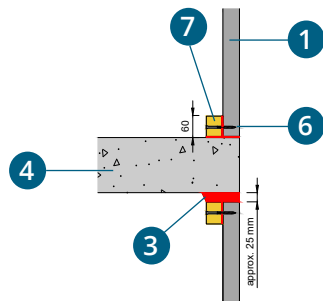

- 1 GEOTEC® S board
- 2 Caulking\* (max 25mm)
- 3 GEOCOL® Glue
- 4 Concrete floor
- 5 GEOTEC® A internal reinforcement collar
- 6 VBA Screws  
Ø 5 x 80 (EI 30/60 S)  
Ø 5 x 90 (EI 90/120 S)  
or galvanized steel staples\*
- 7 GEOTEC® A Batten

\*staples :  
≤ 1250 x 1000 mm (w x h) EI 30/60/90 S.


+ \* Caulking may be carried out using fire-stop polyurethane foam or stone wool (26 kg/m<sup>3</sup> minimum).

## 3.5. Dilatation joints

### Treatment of the crossing of an expansion joint

In the construction of a building, expansion joints must be envisaged in accordance with pre-established rules.

It is therefore common for vertical ducts to pass through expansion joints. It is then necessary to carry out a specific treatment.

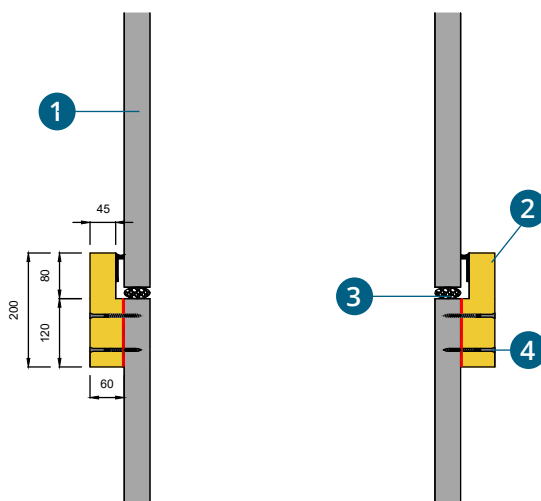


- 1 GEOTEC® S board
- 2 GEOTEC® A Expansion joint element\*
- 3 Mineral fiber rope Ø40
- 4 VBA Screws  
Ø 5 x 80 (EI 30/60 S)  
Ø 5 x 90 (EI 90/120 S)  
or galvanized steel staples\*  
75 x 10 x 2 mm

\*staples :  
≤ 1250 x 1000 mm (w x h) EI 30/60/90 S.

\* Technical datasheet of  
Expansion joint element page 23

### 3.6. Various configurations

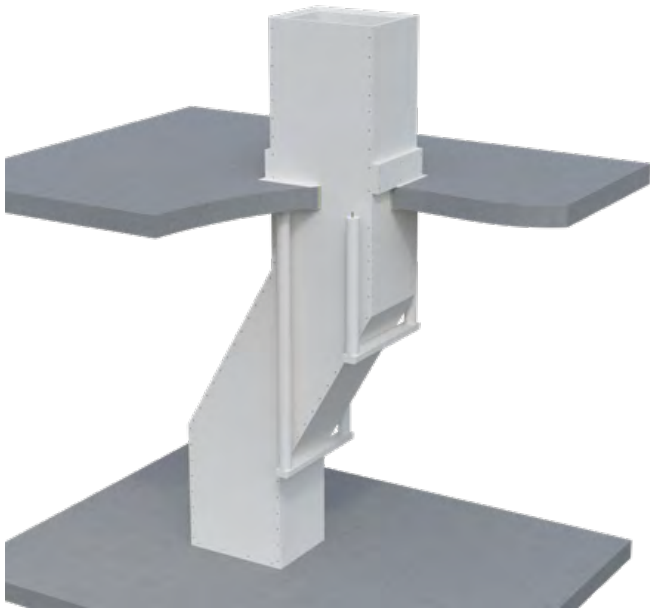

**Vertical deviation**



**Take-off point on a vertical duct**



**installation of a fire damper**



**installation of a smoke shutter**





# FIRE PROTECTION FOR CARBON FIBER REINFORCEMENTS

1. SYSTEM GENERAL OVERVIEW	82
2. PROTECTION UNDER CONCRETE FLOOR SLAB	83
3. PROTECTION UNDER THE BEAM	84

### 1. SYSTEM GENERAL OVERVIEW

The fire stability of reinforced concrete structures and substrates is obtained by restricting the temperature rise in the steel-work within the concrete.

If the existing load-bearing structures need to be strengthened (in the case of a change of use, anti-seismic confinement, refurbishment, etc.), one solution involves bonding carbon fibre reinforced boards with an epoxy resin adhesive.

With the aim of guaranteeing the strength and performance of these carbon reinforcements in the event of fire, the solution has to guarantee a temperature of the adhesive used.

This maximum temperature, varying between 45 and 80° C, appears in the technical notes of the manufacturers to whom the reader should refer.

Following the fire resistance tests carried out at the Efectis laboratory, and via the intermediary of Laboratory Assessment EFR-18-001644, GEOSTAFF® proposes validated solutions using GEOTEC®S to protect the carbon fibre reinforcements installed under the floor slab and concrete beam, depending on the desired levels of fire performance and the critical temperatures provided by the manufacturer.



## 2. PROTECTION UNDER CONCRETE FLOOR SLAB



In this configuration, GEOCOL® adhesive is applied around the periphery of the carbon fibre reinforcement.


A first protective thickness using GEOTECS®S is attached to the concrete using masonry screws 400 mm apart in both directions.

The second thickness is attached to the first via offset joints, using woodscrews 200 mm apart in both directions.

**If a third layer is to be used, it should be fixed to the second layer by means of wood screws every 200 mm.**

Desired interface temperature (°C)	GEOTECS®S PROTECTIVE THICKNESS				
	Desired fire performance				
	30 min	60 min	90 min	120 min	180 min
45	2x30 mm (Overlap 100 mm)	2x45 mm (Overlap 100 mm)	2x45 mm (Overlap 350 mm)	3x45 mm* (Overlap 250 mm)	-
60	2x30 mm (Overlap 100 mm)	2x30 mm (Overlap 100 mm)	2x45 mm (Overlap 100 mm)	2x45 mm (Overlap 200 mm)	-
80	2x30 mm (Overlap 100 mm)	2x30 mm (Overlap 100 mm)	2x30 mm (Overlap 100 mm)	2x45 mm (Overlap 100 mm)	2x45 mm (Overlap 100 mm)

\* Glue must be applied between each layer

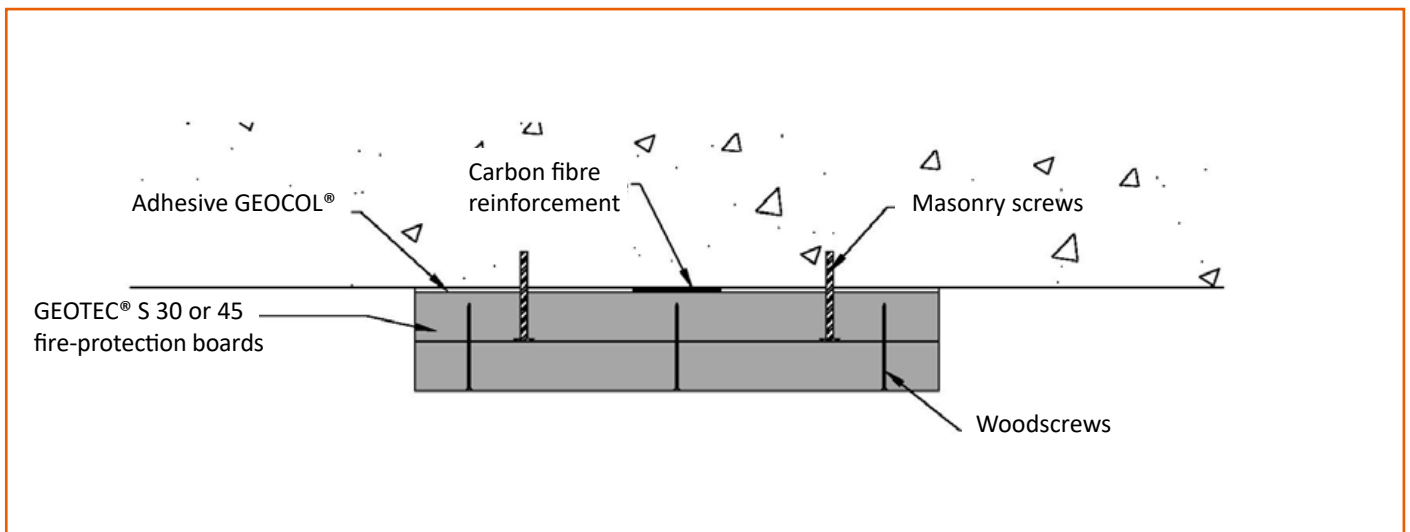

## 3. PROTECTION UNDER THE BEAM




In this configuration, the beam is clas on three sides. GEOCOL® adhesive is applied around the periphery of the carbon fibre reinforcement.

The first protective thickness of GEOTEK® is attached between the vertical surfaces using masonry screws 400 mm apart. The third surface, corresponding to the bottom of the beam, is attached to the boards previously held in place with woodscrews 200 mm apart.

The second thickness is attached to the first via offset joints, using woodscrews 200 mm apart in both directions.

**If a third layer is to be used, it should be fixed to the second layer by means of wood screws every 200 mm.**

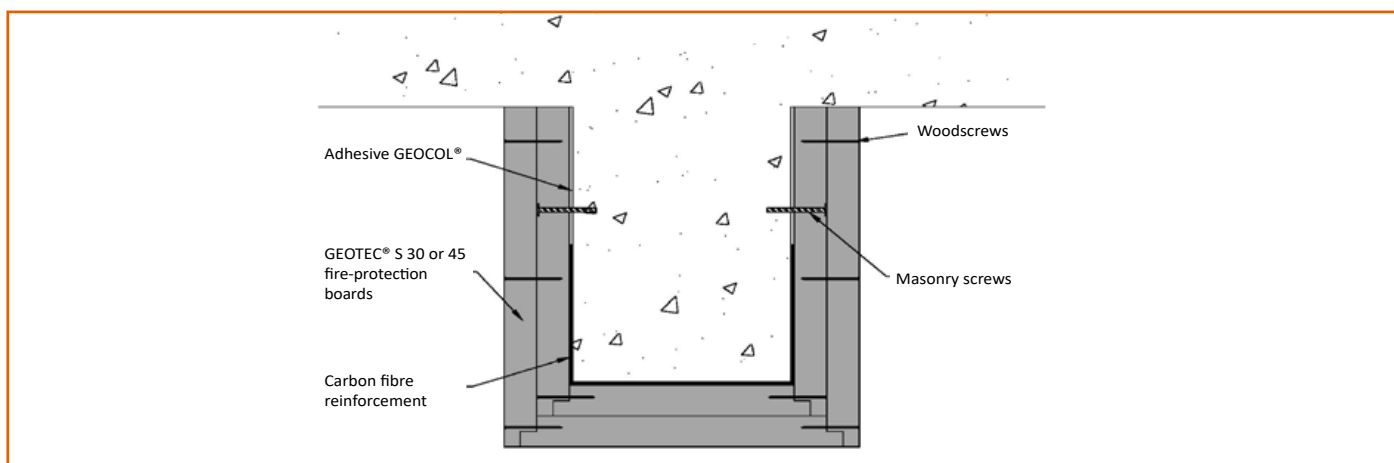

### Reinforcement installed on the bottom of the beam

Desired interface temperature (°C)	GEOTEK®S PROTECTIVE THICKNESS			
	Desired fire performance			
	30 min	60 min	90 min	120 min
45	2x45 mm	2x45 mm	3x45 mm	-
60	2x45 mm	2x45 mm	2x45 mm + 30 mm	3x45 mm
80	2x30 mm	2x45 mm	2x45 mm	2x45 mm

### Reinforcement installed on the side of the beam

Desired interface temperature (°C)	GEOTEK®S PROTECTIVE THICKNESS			
	Desired fire performance			
	30 min	60 min	90 min	120 min
45	2x45 mm	2x45 mm	2x45 mm + 30 mm	3x45 mm*
60	2x30 mm	2x45 mm	2x45 mm	2x45 mm + 30 mm
80	2x30 mm	2x30 mm	2x45 mm	2x45 mm

\* Glue must be applied between each layer

**INTERACTIVE  
CONTENT**  
Click to access 



# FIRE RATED INSPECTION HATCHES

<b>1. VERTICAL INSPECTION HATCHES</b>	<b>86</b>
1.1 GEOSYSTEM® V60-V120	86
1.2 TCF V60-V120	90
<b>2. HORIZONTAL INSPECTION HATCHES</b>	<b>92</b>

## 1. VERTICAL INSPECTION HATCHES

### 1.1. GEOSYSTEM® V60-V120

#### 1. Technical datasheet



#### Dimensions

EI i↔o	Dimensions of the door (opening)	Free way	Overall dimensions	Total Thickness
	E x F	C x D	A x B	G
60	200 x 200 up to 600 x 600	162 x 162 up to 562 x 562	294 x 294 up to 694 x 694	72,5
120				87,5

#### DOCUMENTATION nr. EFR-19-002200

The inspection hatches are tested with an indifferent direction of fire

#### PRODUCT DESCRIPTION

**GEOSYSTEM® V60 & V120** inspection hatches consist of a frame made of fire-resistant plasterboard and two successive leaves.

The first leaf, which acts as an aesthetic covering, is opened/closed by simply pressing on the hatch, while the second, which can be removed, is equipped with two steel pins to remove it.

#### APPLICATIONS

Easy to install and in compliance with current standards, **GEOSYSTEM® V60 & V120** inspection hatches, with fire resistance ratings EI 60 and EI 120 (FP1H and 2H), can be installed in technical ducts, solid walls or as passage openings in partition walls.


#### USAGE

The inspection hatches **GEOSYSTEM® V60 & V120** can be installed:

- **GEOTEC®** and **GEOFLAM®** protection of service ducts and shafts
- Solid walls
- Partitions or false walls
- Plasterboards walls

#### TRANSPORTATION AND STORAGE


Transport and store on a flat, protected surface. Keep away from water.

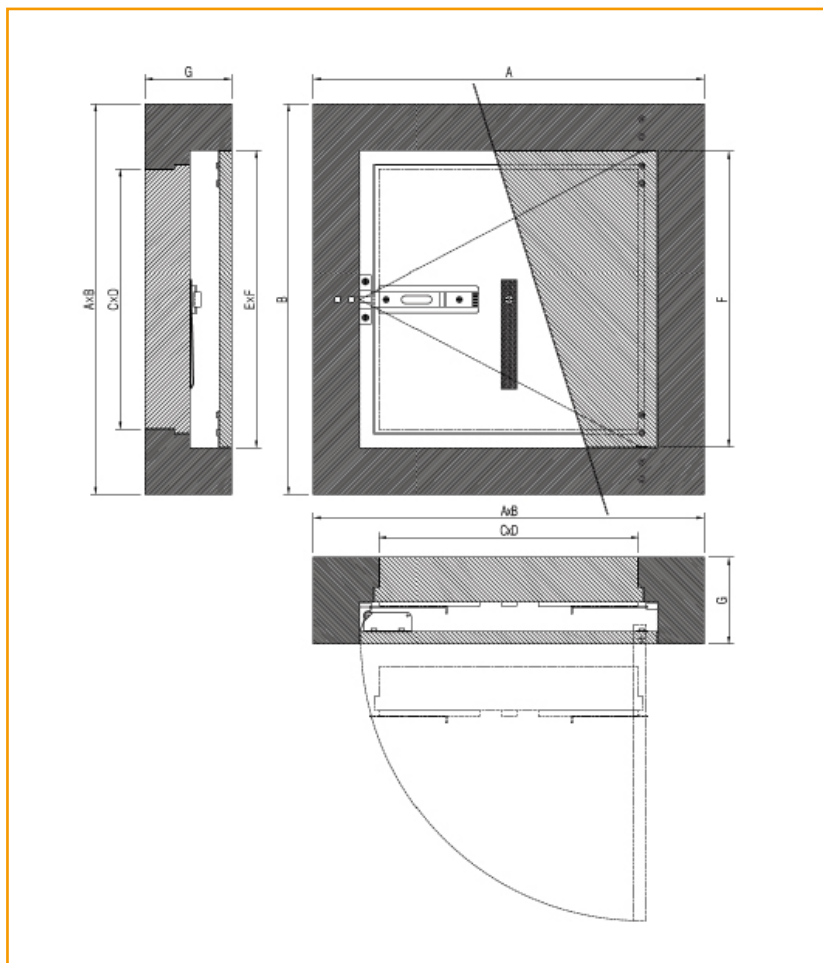


#### Overall dimensions

## 2. Assembly of GEOSYSTEM® Inspection hatches inside a GEOTEC® technical duct

### GEOSYSTEM® V60 for EI 60

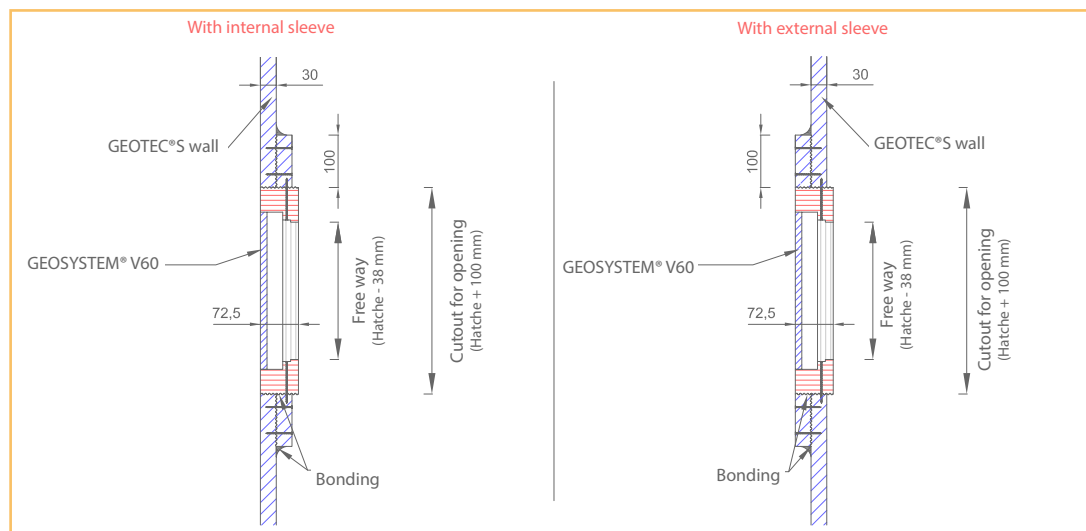

### GEOSYSTEM® V120 for EI 120

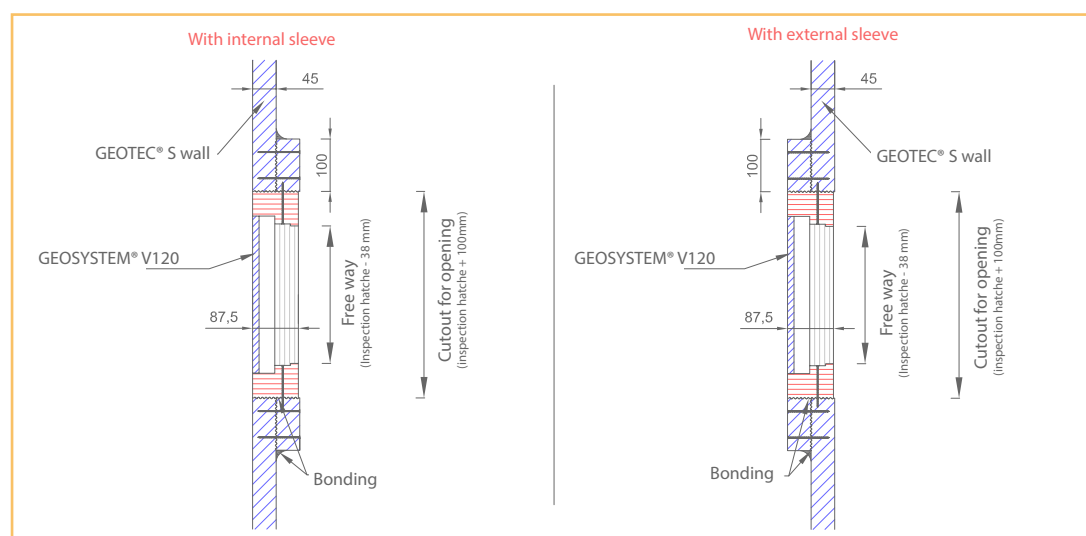

### Certificates : fire-resistance classification report


Tests in accordance with EN 1634-1	EFFECTIS classification documents	Dimensions (mm)	EI	
			60	120
EI 60 hatch	Document n° EFR-19-002200	200 x 200 up to 600 x 600	x	
EI 120 hatch				x

E = Fire sealing / I = Thermal insulation


Please consult us if you require fire-protection hatches installed horizontally

### 3. Assembly of GEOSYSTEM® Inspection hatches inside a plasterboards wall

#### GEOSYSTEM® V60

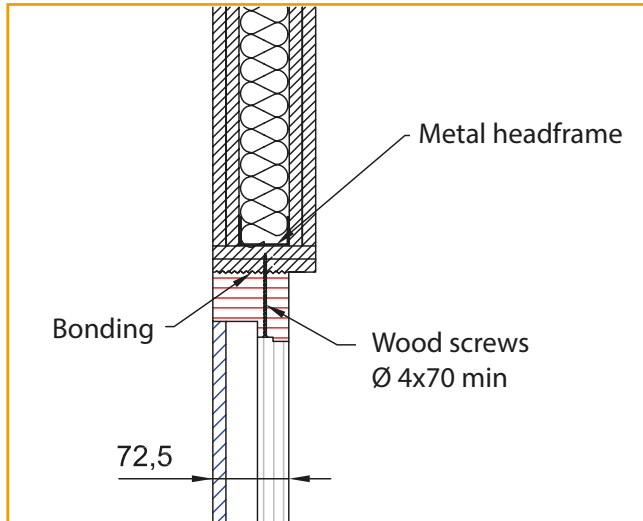


#### GEOSYSTEM® V120

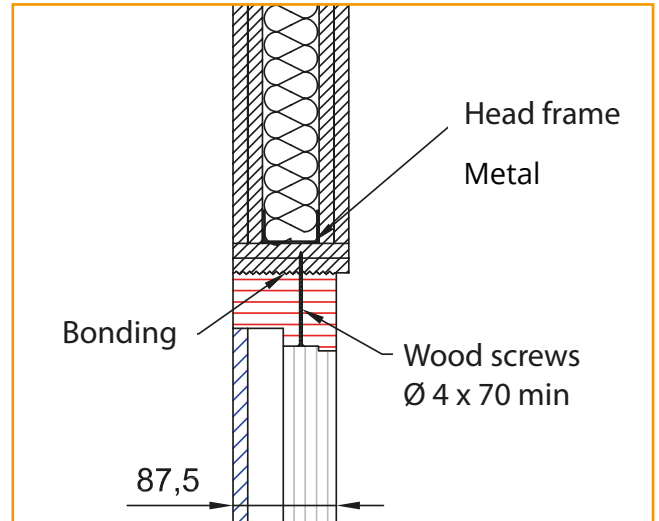


### 4. Assembly of GEOSYSTEM® Inspection hatches inside a shaft wall

#### GEOSYSTEM® V60

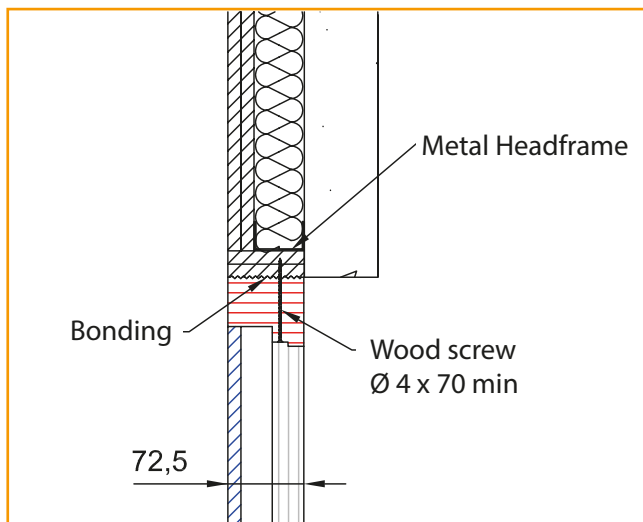


#### GEOSYSTEM® V120

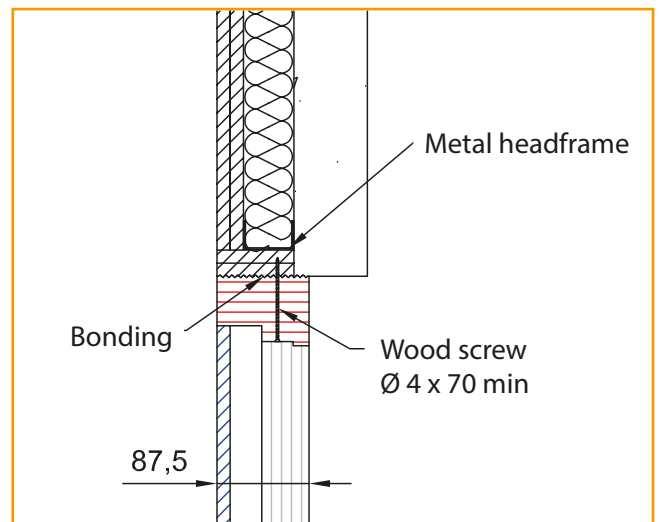




## 5. Assembly of GEOSYSTEM® Inspection hatches inside a cellular concrete wall or a plasterboards wall

### GEOSYSTEM® V60

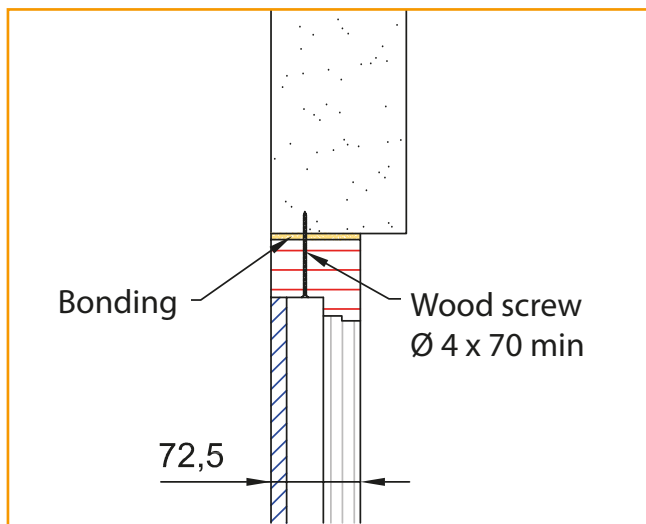


### GEOSYSTEM® V120

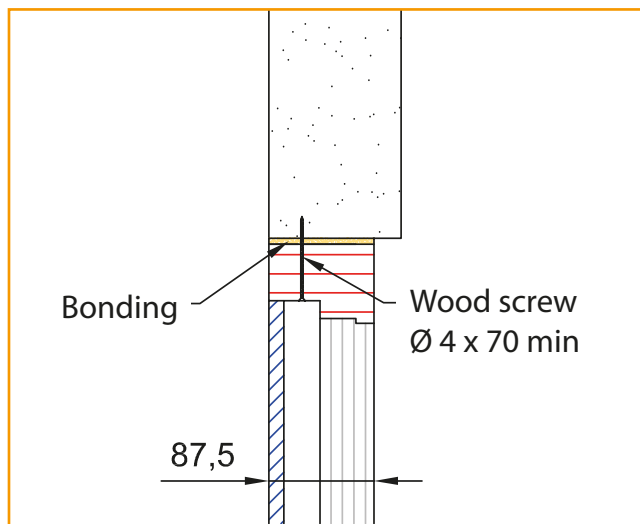


## 6. Assembly of GEOSYSTEM® Inspection hatches inside a massive wall

### GEOSYSTEM® V60

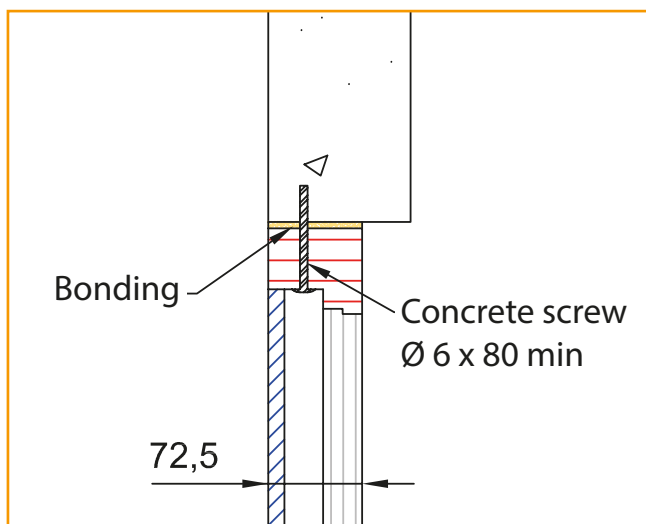


### GEOSYSTEM® V120

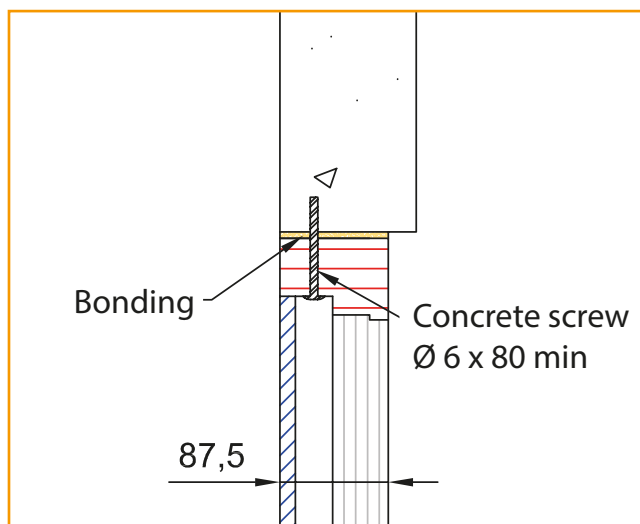

### 1.2. TCF V60-V120

#### 1. Technical datasheet

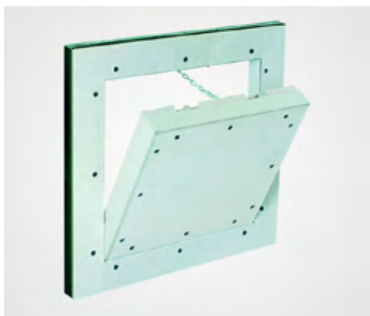

#### Dimensions

EI (mm)	Dimensions of the door	Thickness of the frame	Width of the frame	Thickness or height of the latch	Total Thickness
	AxB (mm)	C	D	E	Z
60	200 x 200 up to	30	55	-	45
120	1500 x 1000	50	55	30	80

Hatches of special dimensions may be constructed.

#### PRODUCT DESCRIPTION

The inspection hatch consists of two aluminium profile frames (1 fixed and 1 opening) and finished off with plasterboard.

The two frames of the inspection hatch comprise four aluminium profiles attached rigidly to one another by means of a special welding technique.

An intumescent seal is placed around the periphery of the door and the fixed frame.

The hatch is fitted with two locking systems (cable and snap-hook).

For safety, these systems must always be hooked up before closing the door panel. The invisible spring closures allow opening and closing by a simple pressure on the hatch.

#### APPLICATIONS

The **GEOSTAFF®** inspection hatches must be installed vertically in order to access the service ducts and shafts (Document 12-A-119 Rev.1 & Extensions 15/2 and 15/3). With a fire-protection time of EI 60 and 120 (1 hour and 2 hour fire-protection), our inspection hatches can be installed on our **GEOTEC®** and **GEOFLAM®** products.


#### USAGE

Installed in protective systems for service ducts and shafts, **GEOTEC®** and **GEOFLAM®**.


#### TRANSPORTATION AND STORAGE

Transport and store on a flat, protected surface. Keep away from water.

#### EI 60

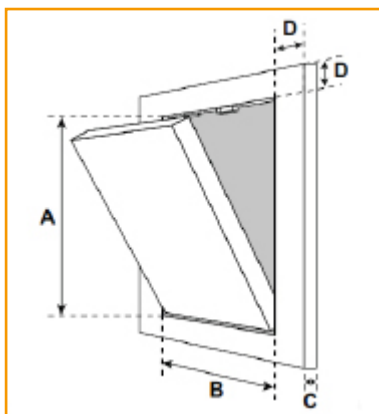

#### EI 120

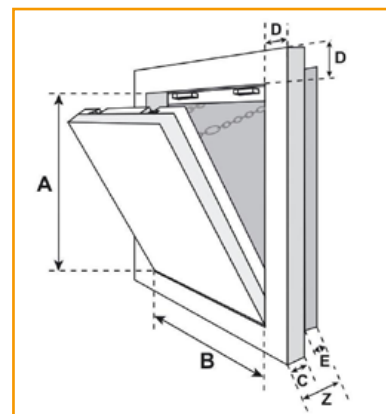


#### Available locks (only in EI 60)




## 2.Assembly principle

### EI 60

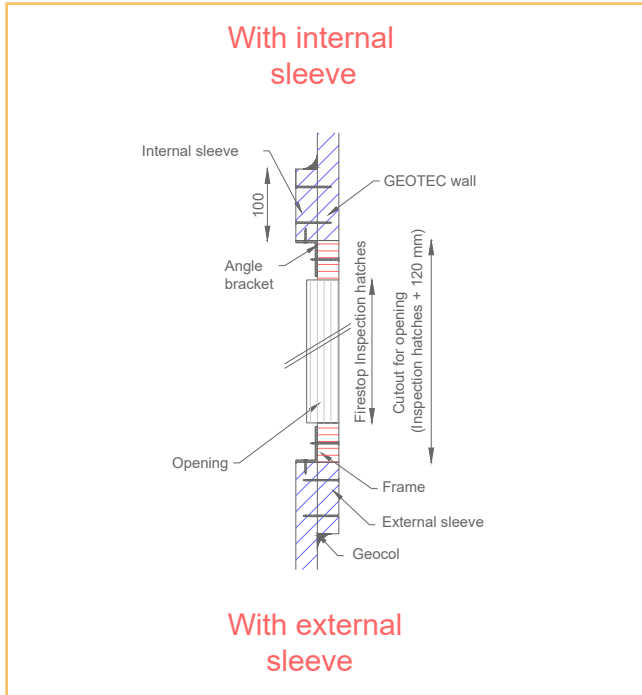

### EI 120

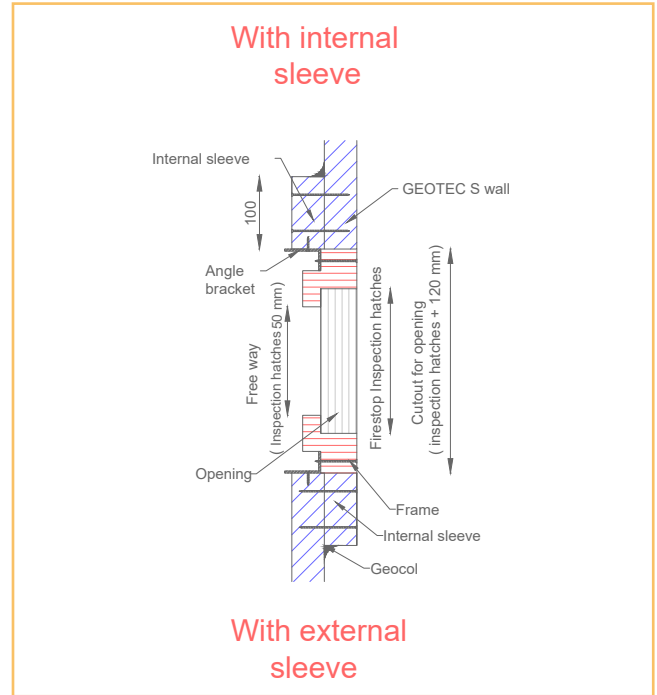

Please consult us if you require fire-protection hatches installed horizontally

### Certificates : fire-resistance classification report

Tests in accordance with EN 1634-1	EFFECTIS classification documents	Dimensions (mm)	EI	
			60	120
EI 120 hatch	Document 12-A119 Rev.1 + Ext. 15/3	200 x 200 à 1500 x 1000		x
EI 60 hatch	Ext. 15/2		x	

E = Fire sealing / I = Thermal insulation

## 2. Horizontal inspection hatches



### Product dimensions

EI (mm)	Dimensions of the opening AxB (mm)	Thickness of the frame C	Width of the frame D	Total Thickness Z
60	200 x 200 until 800 x 800	40	90	100
120		50	110	120

Hatches of special dimensions may be constructed.

### PRODUCT DESCRIPTION

The inspection hatch consists of two aluminium profile frames (1 fixed and 1 opening) and finished off with plasterboard.

The two frames of the inspection hatch comprise four aluminium profiles attached rigidly to one another by means of a special welding technique.

An intumescent seal is placed around the periphery of the door and the fixed frame.

The hatch is fitted with two locking systems (cable and snap-hook).

For safety, these systems must always be hooked up before closing the door panel. The invisible spring closures allow opening and closing by a simple pressure on the hatch.

### APPLICATIONS

The **GEOSTAFF®** inspection hatches must be installed horizontally in order to access the service ducts (Document 12-A-119 Rev.1 & Extensions 15/2 and 15/3). With a fire-break time of EI 60 and 120 (1 hour and 2 hour fire-protection), our inspection hatches can be installed on our **GEOTEC®** and **GEOFLAM®** products.


### USAGE

Installed in protective systems for service conduits, **GEOTEC®** and **GEOFLAM®**.

### TRANSPORTATION AND STORAGE

Transport and store on a flat, protected surface. Keep away from water.

### EI 60 / EI 120

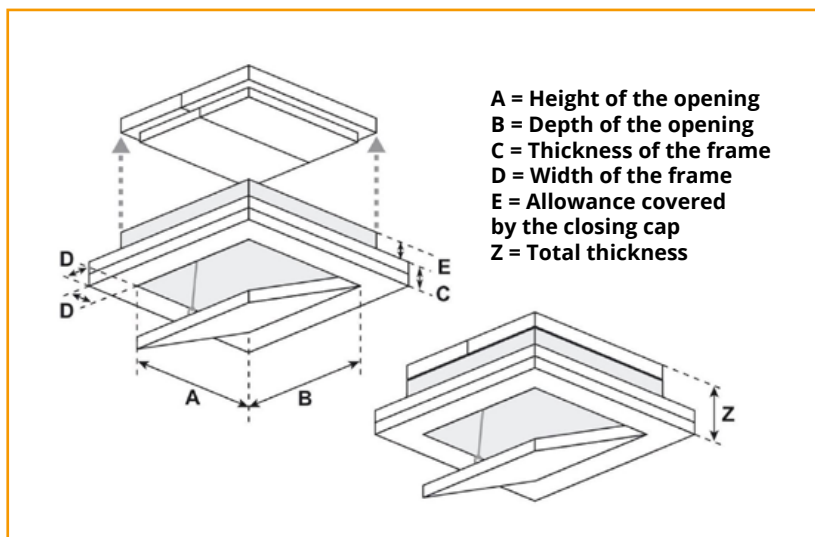

### Available locks (only in EI 60)



---

---

---

---

---

---

---

---

---

---

---

---

---

---

---

---

---

---

---

---

---

---

---

---

---

---

# NOTES

---

---

---

---

---

---

---

---

---

---

---

---

---

---

---

---

---

---

---

---

---

---

---

---





## HEAD OFFICE

6 bis, rue Jacques Kellner • 95150 TAVERNY - FRANCE

Tel. +33 (0)1 30 26 37 00 • com@geostaff.fr

### HEAD OFFICE

**ZAC du Chêne Bocquet**  
**6 bis, rue Jacques Kellner**  
**95150 TAVERNY**

Tel: +33(0)1 30 26 37 00  
Fax: +33(0)1 39 95 96 23

#### Opening hours

Monday to Thursday:  
9:00 - 12:30 / 13:30 - 18:00  
Friday:  
9:00 - 12:30 / 13:30 - 17:00

#### Contact us

com@geostaff.fr

### GEOSTAFF FACTORY

**Rue de St-Just**  
**60130 Catillon-Fumechon**

It may be possible to pick up some of our products from this address. Please contact us for further information.

### SALES DEPARTMENT

**Geostaff IDF**  
+33(0)1 30 26 37 00

**Geostaff Grand Est**  
+33(0)7 76 08 75 54

**Geostaff Grand Ouest**  
+33(0)7 77 41 87 65

**Geostaff Déco PACA**  
+33(0)6 80 72 09 85

### LOGISTICS DEPARTMENT

**ZAC du Chêne Bocquet**  
**6 bis, rue Jacques Kellner**  
**95150 TAVERNY**  
Tel: +33(0)1 30 26 36 90

#### Opening hours

Open from Monday to  
Thursday: 6:30 - 17:00  
Friday: 6:30 - 12:30

#### Contact us

com@geostaff.fr

For ease of collection in **the South of France**, there is a GEOSTAFF warehouse at **ZAC LA GRAVE 06150 CARROS** (Alpes-Maritimes).

Please contact us for further information.

www.geostaff.fr